

HUMIDIFIERS

Environmental Conditions	20.1
Enclosure Characteristics	20.2
Energy Considerations	20.3
Equipment	20.4
Controls	20.8

IN the selection and application of humidifiers, the designer considers (1) the environmental conditions of the occupancy or process and (2) the characteristics of the building enclosure. Because these may not always be compatible, a compromise solution is sometimes necessary, particularly in the case of existing buildings.

ENVIRONMENTAL CONDITIONS

A particular occupancy or process may dictate a specific relative humidity, a required range of relative humidity, or certain limiting maximum or minimum values. The following classifications explain the effects of relative humidity and provide guidance on the requirements for most applications.

Human Comfort

The complete effect of relative humidity on all aspects of human comfort has not yet been established. For thermal comfort, higher temperature is generally considered necessary to offset decreased relative humidity (see ASHRAE *Standard 55*).

Low relative humidity increases evaporation from the membranes of the nose and throat, drying the mucous membranes in the respiratory system; it also dries the skin and hair. The increased incidence of respiratory complaints during the winter months is often linked to low relative humidity. Epidemiological studies have found lower rates of respiratory illness reported among occupants of buildings with mid-range relative humidity than among occupants of buildings with low humidity.

Extremes of humidity are the most detrimental to human comfort, productivity, and health. [Figure 1](#) shows that the range between 30 and 60% rh (at normal room temperatures) provides the best conditions for human occupancy (Sterling et al. 1985). In this range, both the growth of bacteria and biological organisms and the speed at which chemical interactions occur are minimized.

Prevention and Treatment of Disease

Relative humidity has a significant effect on the control of airborne infection. At 50% rh, the mortality rate of certain organisms is highest, and the influenza virus loses much of its virulence. The mortality rate decreases both above and below this value. High humidity can support the growth of pathogenic or allergenic organisms. Relative humidity in habitable spaces should be maintained between 30 and 60%.

Potential Bacterial Growth

Certain microorganisms are occasionally present in poorly maintained humidifiers. To deter the propagation and spread of these detrimental microorganisms, periodic cleaning of the humidifier and draining of the reservoir (particularly at the end of the humidification season) are required. Cold water reservoir atomizing room humidifiers have been banned in some hospitals because of germ

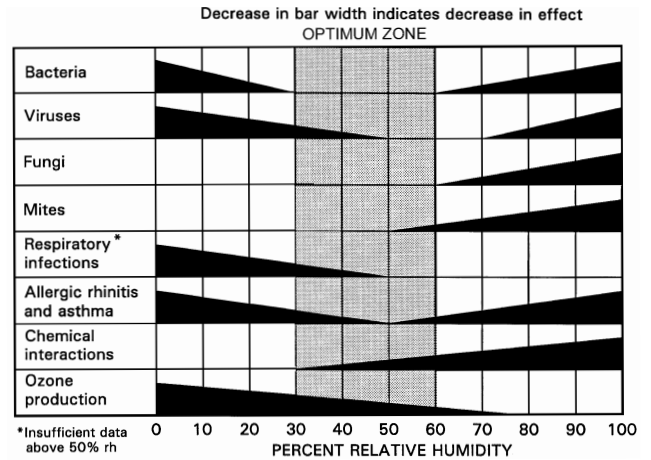


Fig. 1 Optimum Humidity Range for Human Comfort and Health
(Adapted from Sterling et al. 1985)

propagation. Research by Unz et al. (1993) on several types of plenum-mounted residential humidifiers showed no evidence of organism transmission originating from the humidifier. Ruud et al. (1993) also determined that humidifiers did not add particles to the heated airstream.

Electronic Equipment

Electronic data processing equipment requires controlled relative humidity. High relative humidity may cause condensation in the equipment, while low relative humidity may promote static electricity. Also, rapid changes in relative humidity should be avoided due to their effect on bar code readers, magnetic tapes, disks, and data processing equipment. Generally, computer systems have a recommended design and operating range of 35 to 55% rh. However, the manufacturer's recommendations should be adhered to for specific equipment operation.

Process Control and Materials Storage

The relative humidity required by a process is usually specific and related to one or more of several factors:

- Control of moisture content or regain
- Rate of chemical or biochemical reactions
- Rate of crystallization
- Product accuracy or uniformity
- Corrosion
- Static electricity

Typical conditions of temperature and relative humidity for the storage of certain commodities and the manufacturing and processing of others may be found in [Chapter 12 of the ASHRAE Handbook—Applications](#).

The preparation of this chapter is assigned to TC 8.7, Humidifying Equipment.

Low humidity in winter may cause drying and shrinking of furniture, wood floors, and interior trim. Winter humidification should be considered in order to maintain relative humidity closer to that experienced during manufacture or installation.

For storing hygroscopic materials, maintaining constant humidity is often as important as the humidity level itself. The design of the structure should always be considered. Temperature control is important due to the danger of condensation on products through a transient lowering of temperature.

Static Electricity

Electrostatic charges are generated when materials of high electrical resistance move against each other. The accumulation of such charges may have a variety of results: (1) unpleasant sparks caused by friction between two materials (e.g., stocking feet and carpet fibers); (2) difficulty in handling sheets of paper, fibers, and fabric; (3) objectionable dust clinging to oppositely charged objects (e.g., negatively charged metal nails or screws securing gypsum board to wooden studding in the exterior walls of a building that attract positively charged dust particles); (4) destruction of data stored on magnetic disks and tapes that require specifically controlled environments; and (5) hazardous situations if explosive gases are present, as in hospitals, research laboratories, or industrial clean rooms.

Increasing the relative humidity of the environment reduces the accumulation of electrostatic charges, but the optimum level of humidity depends to some extent on the materials involved. Relative humidity of 45% reduces or eliminates electrostatic effects in many materials, but wool and some synthetic materials may require a higher relative humidity.

Hospital operating rooms, where explosive mixtures of anesthetics are used, constitute a special and critical case. A relative humidity of at least 50% is usually required, with special grounding arrangements and restrictions on the types of clothing worn by occupants. Conditions of 72°F and 55% rh are usually recommended for comfort and safety.

Sound Wave Transmission

The air absorption of sound waves, which results in the loss of sound strength, is worst at 15 to 20% rh, and the loss increases as the frequency rises (Harris 1963). There is a marked reduction in sound absorption at 40% rh; above 50%, the effect of air absorption is negligible. Air absorption of sound does not significantly affect speech but may merit consideration in large halls or auditoriums where optimum acoustic conditions are required for musical performances.

Miscellaneous

Laboratories and test chambers, in which precise control of relative humidity over a wide range is desired, require special attention. Because of the interrelation between temperature and relative humidity, precise humidity control requires equally precise temperature control.

ENCLOSURE CHARACTERISTICS

Vapor Retarders

The maximum relative humidity level to which a building may be humidified in winter depends on the ability of its walls, roof, and other elements to prevent or tolerate condensation. Condensed moisture or frost on surfaces exposed to the building interior (visible condensation) can deteriorate the surface finish, cause mold growth and subsequent indirect moisture damage and nuisance, and reduce visibility through windows. If the walls and roof have not been specifically designed and properly protected with vapor retarders on the warm side to prevent the entry of moist air or vapor from the inside,

concealed condensation within these constructions is likely to occur, even at fairly low interior humidity, and cause serious deterioration.

Visible Condensation

Condensation forms on an interior surface when its temperature is below the dew-point temperature of the air in contact with it. The maximum relative humidity that may be maintained without condensation is thus influenced by the thermal properties of the enclosure and the interior and exterior environment.

Average surface temperatures may be calculated by the methods outlined in [Chapter 23 of the ASHRAE Handbook—Fundamentals](#) for most insulated constructions. However, local cold spots result from high-conductivity paths such as through-the-wall framing, projected floor slabs, and metal window frames that have no thermal breaks. The vertical temperature gradient in the air space and surface convection along windows and sections with a high thermal conductivity result in lower air and surface temperatures at the sill or floor. Drapes and blinds closed over windows lower surface temperature further, while heating units under windows raise the temperature significantly.

In most buildings, windows present the lowest surface temperature and the best guide to permissible humidity levels for no condensation. While calculations based on overall thermal coefficients provide reasonably accurate temperature predictions at mid-height, actual minimum surface temperatures are best determined by test. Wilson and Brown (1964) related the characteristics of windows with a **temperature index**, defined as $(t - t_o)/(t_i - t_o)$, where t is the inside window surface temperature, t_i is the indoor air temperature, and t_o is the outdoor air temperature.

The results of limited tests on actual windows indicate that the temperature index at the bottom of a double, residential-type window with a full thermal break is between 0.55 and 0.57, with natural convection on the warm side. Sealed, double-glazed units exhibit an index from 0.33 to 0.48 at the junction of glass and sash, depending on sash design. The index is likely to rise to 0.53 or greater only 1 in. above the junction.

With continuous under-window heating, the minimum index for a double window with a full break may be as high as 0.60 to 0.70. Under similar conditions, the index of a window with a poor thermal break may be increased by a similar increment.

[Figure 2](#) shows the relationship between temperature index and the relative humidity and temperature conditions at which condensation occurs. The limiting relative humidities for various outdoor temperatures intersect vertical lines representing particular temperature indexes. A temperature index of 0.55 has been selected to represent an average for double-glazed, residential windows; 0.22 represents an average for single-glazed windows. [Table 1](#) shows the limiting relative humidities for both types of windows at various outdoor air temperatures.

Table 1 Maximum Relative Humidity In a Space for No Condensation on Windows

Outdoor Temperature, °F	Limiting Relative Humidity, %	
	Single Glazing	Double Glazing
40	39	59
30	29	50
20	21	43
10	15	36
0	10	30
-10	7	26
-20	5	21
-30	3	17

Note: Natural convection, indoor air at 74°F.

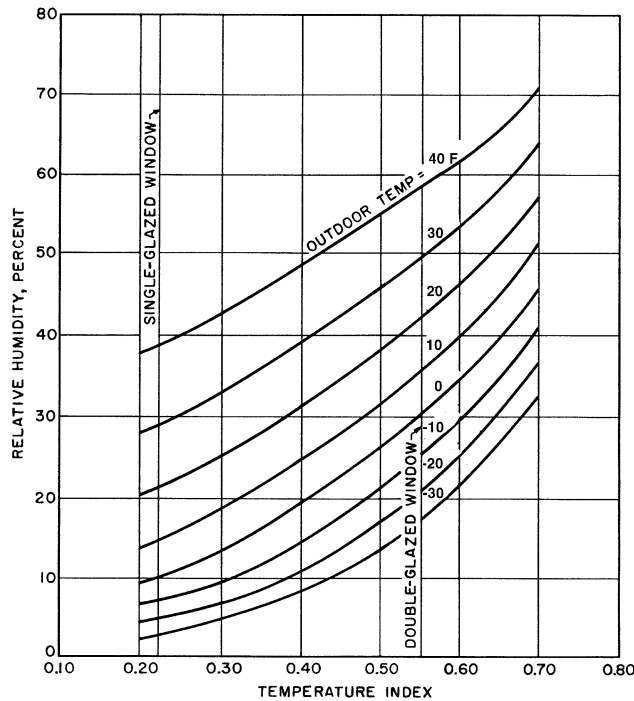


Fig. 2 Limiting Relative Humidity for No Window Condensation

Concealed Condensation

Vapor retarders are imperative in certain applications because the humidity level a building is able to maintain without serious concealed condensation may be much lower than that indicated by visible condensation. The migration of water vapor through the inner envelope by diffusion or air leakage brings the vapor into contact with surfaces at temperatures below its dew point. During the design of a building, the desired interior humidity may be determined by the ability of the building enclosure to handle internal moisture. This is particularly important when planning for building humidification in colder climates.

ENERGY CONSIDERATIONS

When calculating the energy requirement for a humidification system, the effect of the dry air environment on any material supplying it with moisture should be considered. The release of liquid in a hygroscopic material to a vapor state is an evaporative process that requires energy. The source of energy is the heat contained in the air. The heat lost from the air to evaporate moisture equals the heat necessary to produce an equal amount of moisture vapor with an efficient humidifier. If proper humidity levels are not maintained, moisture migration from hygroscopic materials can have destructive effects.

The true energy required for a humidification system must be calculated from the actual humidity level in the building, not from the theoretical level.

A study of residential heating and cooling systems showed a correlation between infiltration and inside relative humidity, indicating a significant energy saving from increasing the inside relative humidity, which reduced infiltration of outside air by up to 50% during the heating season (Luck and Nelson 1977). This reduction is apparently due to the sealing of window cracks by the formation of frost.

To assess accurately the total energy required to provide a desired level of humidity, all elements relating to the generation of

humidity and the maintenance of the final air condition must be considered. This is particularly true when comparing different humidifiers. For example, the cost of boiler steam should include generation and distribution losses; costs for an evaporative humidifier include electrical energy for motors or compressors, water conditioning, and the addition of reheat (when the evaporative cooling effect is not required).

Load Calculations

The humidification load depends primarily on the rate of natural infiltration of the space to be humidified or the amount of outside air introduced by mechanical means. Other sources of moisture gain or loss should also be considered. The **humidification load** H can be calculated by the following equations:

For ventilation systems having natural infiltration,

$$H = \rho VR(W_i - W_o) - S + L \quad (1)$$

For mechanical ventilation systems having a fixed quantity of outside air,

$$H = 60\rho Q_o(W_i - W_o) - S + L \quad (2)$$

For mechanical systems having a variable quantity of outside air,

$$H = 60\rho Q_t(W_i - W_o) \left(\frac{t_i - t_m}{t_i - t_o} \right) - S + L \quad (3)$$

where

H = humidification load, lb of water/h

V = volume of space to be humidified, ft³

R = infiltration rate, air changes per hour

Q_o = volumetric flow rate of outside air, cfm

Q_t = total volumetric flow rate of air (outside air plus return air), cfm

t_i = design indoor air temperature, °F

t_m = design mixed air temperature, °F

t_o = design outside air temperature, °F

W_i = humidity ratio at indoor design conditions, lb of water/lb of dry air

W_o = humidity ratio at outdoor design conditions, lb of water/lb of dry air

S = contribution of internal moisture sources, lb of water/h

L = other moisture losses, lb of water/h

ρ = density of air at sea level, 0.074 lb/ft³

Design Conditions

Interior design conditions are dictated by the occupancy or the process, as discussed in the preceding sections on Enclosure Characteristics and on Environmental Conditions. Outdoor relative humidity can be assumed to be 70 to 80% at temperatures below 32°F or 50% at temperatures above 32°F for winter conditions in most areas. Additional data on outdoor design data may be obtained from [Chapter 27 of the ASHRAE Handbook—Fundamentals](#). Absolute humidity values can be obtained either from [Chapter 6 of the ASHRAE Handbook—Fundamentals](#) or from an ASHRAE Psychrometric Chart.

For systems handling fixed outside air quantities, load calculations are based on outdoor design conditions. Equation (1) should be used for natural infiltration, and Equation (2) for mechanical ventilation.

For economizers that achieve a fixed mixed air temperature by varying outside air, special considerations are needed to determine the maximum humidification load. This load occurs at an outside air temperature other than the lowest design temperature because it is a function of the amount of outside air introduced and the existing moisture content of the air. Equation (3) should be solved for various

outside air temperatures to determine the maximum humidification load. It is also important to analyze the energy use of the humidifier (especially for electric humidifiers) when calculating the economizer setting in order to ensure that the energy saved by “free cooling” is greater than the energy consumed by the humidifier.

In residential load calculations, the actual outdoor design conditions of the locale are usually taken as 20°F and 70% rh, while indoor conditions are taken as 70°F and 35% rh. These values yield an absolute humidity difference ($W_i - W_o$) of 0.0040 lb per pound of dry air for use in Equation (1). However, the relative humidity may need to be less than 35% to avoid condensation at low outdoor temperatures (see [Table 1](#)).

Ventilation Rate

Ventilation of the humidified space may be due to either natural infiltration alone or natural infiltration in combination with intentional mechanical ventilation. Natural infiltration varies according to the indoor-outdoor temperature difference, wind velocity, and tightness of construction, as discussed in [Chapter 26 of the ASHRAE Handbook—Fundamentals](#). The rate of mechanical ventilation may be determined from building design specifications or estimated from fan performance data (see *ASHRAE Standard 62*).

In load calculations, the water vapor removed from the air during cooling by air-conditioning or refrigeration equipment must be considered. This moisture may have to be replaced by humidification equipment to maintain the desired relative humidity in certain industrial projects where the moisture generated by the process may be greater than that required for ventilation and heating.

Estimates of infiltration rate are made in calculating heating and cooling loads for buildings; these values also apply to humidification load calculations. For residences where such data are not available, it may be assumed that a tight house has an infiltration rate of 0.5 air changes per hour (ACH); an average house, 1 ACH; and a loose house, as many as 1.5 ACH. A tight house is assumed to be well insulated and to have vapor retarders, tight storm doors, windows with weather stripping, and a dampered fireplace. An average house is insulated and has vapor retarders, loose storm doors and windows, and a dampered fireplace. A loose house is generally one constructed before 1930 with little or no insulation, no storm doors, no insulated windows, no weather stripping, no vapor retarders, and often a fireplace without an effective damper. For building construction, refer to local codes and building specifications.

Additional Moisture Losses

Hygroscopic materials, which have a lower moisture content than materials in the humidified space, absorb moisture and place an additional load on the humidification system. An estimate of this load depends on the absorption rate of the particular material selected. [Table 2 in Chapter 12 of the ASHRAE Handbook—Applications](#) lists the equilibrium moisture content of hygroscopic materials at various relative humidities.

In cases where a certain humidity must be maintained regardless of condensation on exterior windows and walls, the dehumidifying effect of these surfaces constitutes a load that may need to be considered, if only on a transient basis. The loss of water vapor by diffusion through enclosing walls to the outside or to areas at a lower vapor pressure may also be involved in some applications. The properties of materials and flow equations given in [Chapter 23 of the ASHRAE Handbook—Fundamentals](#) can be applied in such cases. Normally, this diffusion constitutes a small load, unless openings exist between the humidified space and adjacent rooms at lower humidities.

Internal Moisture Gains

The introduction of a hygroscopic material can cause moisture gains to the space if the moisture content of the material is above

that of the space. Similarly, moisture may diffuse through walls separating the space from areas of higher vapor pressure or move by convection through openings in these walls (Brown et al. 1963).

Moisture contributed by human occupancy depends on the number of occupants and their degree of physical activity. As a guide for residential applications, the average rate of moisture production for a family of four has been taken as 0.7 lb/h. Unvented heating devices produce about 1 lb of vapor for each pound of fuel burned. These values may no longer apply because of changes in equipment as well as in living habits.

Industrial processes constitute additional moisture sources. Single-color offset printing presses, for example, give off 0.45 lb of water per hour. Information on process contributions can best be obtained from the manufacturer of the specific equipment.

Supply Water for Humidifiers

There are three major categories of supply water: potable (untreated) water, softened potable water, and demineralized [deionized (DI) or reverse osmosis (RO)] water. Either the application or the humidifier may require a certain water type; the humidifier manufacturer’s literature should be consulted.

In areas with water having a high mineral content, precipitated solids may be a problem. They clog nozzles, tubes, evaporative elements, and controls. In addition, solids allowed to enter the airstream via mist leave a fine layer of white dust over furniture, floors, and carpets. Some wetted media humidifiers bleed off and replace some or all of the water passing through the element to reduce the concentration of salts in the recirculating water.

Dust, scaling, biological organisms, and corrosion are all potential problems associated with water in humidifiers. Stagnant water can provide a fertile breeding ground for algae and bacteria, which have been linked to odor and respiratory ailments. Bacterial slime reacts with sulfates in the water to produce hydrogen sulfide and its characteristic bad odor. Regular maintenance and periodic disinfecting with approved microbicides may be required (Puckorius et al. 1995). This has not been a problem with residential equipment; however, regular maintenance is good practice since biocides are generally used only with atomizing humidifiers.

Scaling

Industrial pan humidifiers, when supplied with water that is naturally low in hardness, require little maintenance, provided a surface skimmer bleedoff is used.

Water softening is an effective means of eliminating mineral precipitation in a pan-type humidifier. However, the concentration of sodium left in a pan as a result of water evaporation must be held below the point of precipitation by flushing and diluting the tank with new softened water. The frequency and duration of dilution depend on the water hardness and the rate of evaporation. Dilution is usually accomplished automatically by a timer-operated drain valve and a water makeup valve.

Demineralized or reverse osmosis (RO) water may also be used. The construction materials of the humidifier and the piping must withstand the corrosive effects of this water. Commercial demineralizers or RO equipment removes hardness and other total dissolved solids completely from the humidifier makeup water. They are more expensive than water softeners, but no humidifier purging is required. Sizing is based on the maximum required water flow to the humidifier and the amount of total dissolved solids in the makeup water.

EQUIPMENT

Humidifiers can generally be classified as either residential or industrial, although residential humidifiers can be used for small industrial applications, and small industrial units can be used in large homes. Equipment designed for use in central air systems also

differs from that for space humidification, although some units are adaptable to both.

Air washers and direct evaporative coolers may be used as humidifiers; they are sometimes selected for additional functions such as air cooling or air cleaning, as discussed in [Chapter 19](#).

The capacities of residential humidifiers are generally based on gallons per day of operation; capacities of industrial and commercial humidifiers are based on pounds per hour of operation. Published evaporation rates established by equipment manufacturers through test criteria may be inconsistent. Rates and test methods should be evaluated when selecting equipment. The Air-Conditioning and Refrigeration Institute (ARI) has developed *Standard 610* for residential central system humidifiers and *Standard 640* for commercial and industrial humidifiers. Association of Home Appliance Manufacturers (AHAM) *Standard HU-1* addresses self-contained residential units.

Residential Humidifiers for Central Air Systems

Residential humidifiers designed for central air systems depend on airflow in the heating system for evaporation and distribution. General principles and description of equipment are as follows:

Pan Humidifiers. Capacity varies with temperature, humidity, and airflow.

- *Basic pan.* A shallow pan is installed within the furnace plenum. Household water is supplied to the pan through a control device.
- *Electrically heated pan.* Similar to the basic unit, this type adds an electric heater to increase water temperature and evaporation rate.
- *Pan with wicking plates.* Similar to the basic unit, this type includes fitted water-absorbent plates. The increased area of the plates provides greater surface area for evaporation to take place ([Figure 3A](#)).

Wetted Element Humidifiers. Capacity varies with temperature, humidity, and airflow. Air circulates over or through an open-textured, wetted medium. The evaporating surface may be a fixed pad wetted by either sprays or water flowing by gravity, or the surface may be a paddle-wheel, drum, or belt rotating through a water reservoir. The various types are differentiated by the way air flows through them:

- *Fan type.* A small fan or blower draws air from the furnace plenum, through the wetted pad, and back to the plenum. A fixed pad ([Figure 3B](#)) or a rotating drum-type pad ([Figure 3C](#)) may be used.
- *Bypass type.* These units do not have their own fan, but rather are mounted on the supply or return plenum of the furnace with an air connection to the return plenum ([Figure 3D](#)). The difference in static pressure created by the furnace blower circulates air through the unit.
- *Duct-mounted type.* These units are designed for installation within the furnace plenum or ductwork with a drum element rotated by either the air movement in the duct or a small electric motor.

Atomizing Humidifiers. The capacity of an atomizing humidifier does not depend on the air conditions. However, it is important not to oversaturate the air and allow liquid water to form in the duct. The ability of the air to absorb moisture depends on the temperature, flow rate, and moisture content of the air moving through the system. Small particles of water are formed and introduced into the airstream in one of the following ways:

- A spinning disk or cone throws a water stream centrifugally to the rim of the disk and onto deflector plates or a comb, where it is turned into a fine fog ([Figure 3E](#)).
- Spray nozzles rely on water pressure to produce a fine spray.
- Spray nozzles use compressed air to create a fine mist.
- Ultrasonic vibrations are used as the atomizing force.

Residential Humidifiers for Nonducted Applications

Many portable or room humidifiers are used in residences heated by nonducted hydronic or electric systems or in residences where the occupant is prevented from making a permanent installation. These humidifiers may be equipped with humidity controllers.

Portable units evaporate water by any of the previously described means, such as heated pan, fixed or moving wetted element, or atomizing spinning disk. They may be tabletop-sized or a larger, furniture-style appliance ([Figure 3F](#)). A multispeed motor on the fan or blower may be used to adjust output. Portable humidifiers usually require periodic filling from a bucket or filling hose.

Some portable units are offered with an auxiliary package for semipermanent water supply. This package includes a manual shut-off valve, a float valve, copper or other tubing with fittings, and so forth. Lack of drainage provision for water overflow may result in water damage.

Some units may be recessed into the wall between studs, mounted on wall surfaces, or installed below floor level. These units are permanently installed in the structure and use forced-air circulation. They may have an electric element for reheat when desired. Other types for use with hydronic systems involve a simple pan or pan plate, either installed within a hot water convector or using the steam from a steam radiator.

Industrial and Commercial Humidifiers for Central Air Systems

Humidifiers must be installed where the air can absorb the vapor; the temperature of the air being humidified must exceed the dew point of the space being humidified. When fresh or mixed air is humidified, the air may need to be preheated to allow absorption to take place.

Heated Pan Humidifiers. These units offer a broad range of capacities and may be heated by a heat exchanger supplied with either steam or hot water (see [Figure 4A](#)). They may be installed directly under the duct, or they may be installed remotely and feed vapor through a hose. In either case, a distribution manifold should be used.

Steam heat exchangers are commonly used in heated pan humidifiers, with steam pressures ranging from 5 to 15 psig. Hot water heat exchangers are also used in pan humidifiers; a water temperature below 240°F is not practical.

All pan-type humidifiers should have water regulation and some form of drain or flush system. When raw water is used, periodic cleaning is required to remove the buildup of minerals. (Use of softened or demineralized water can greatly extend time between cleanings.) Care should also be taken to ensure that all water is drained off when the system is not in use to avoid the possibility of bacterial growth in the stagnant water.

Direct Steam Injection Humidifiers. These units cover a wide range of designs and capacities. Steam is water vapor under pressure and at high temperature, so the process of humidification can be simplified by adding steam directly into the air. This method is an isothermal process because the temperature of the air remains almost constant as the moisture is added. For this type of humidification system, the steam source is usually a central steam boiler at low pressure. When steam is supplied from a source at a constant supply pressure, humidification responds quickly to system demand. A control valve may be modulating or two-position in response to a humidity sensor/controller. Steam can be introduced into the airstream through one of the following devices:

- *Single or multiple steam-jacketed manifolds* ([Figure 4B](#)), depending on the size of the duct or plenum. The steam jacket is designed to reevaporate any condensate droplets before they are discharged from the manifold.

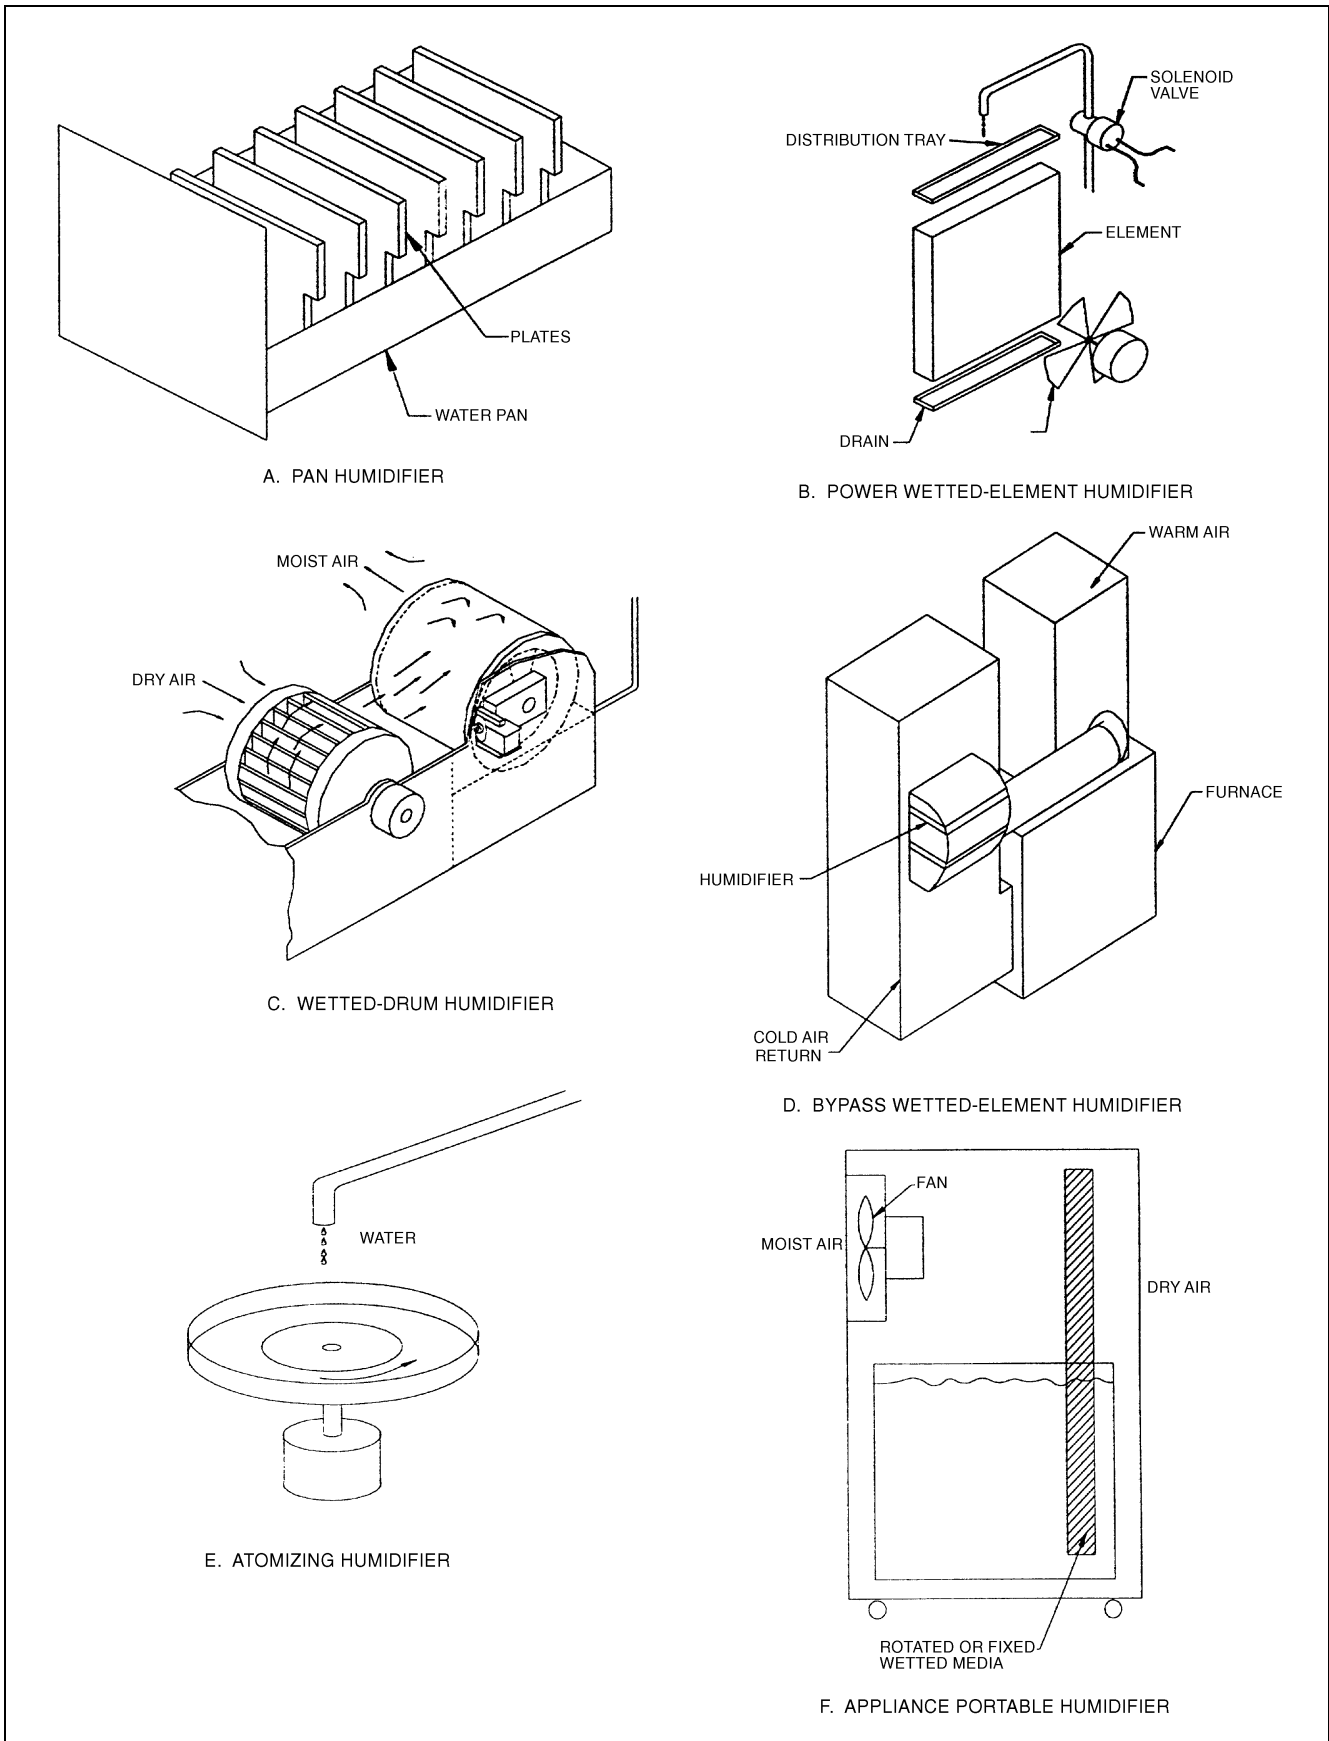


Fig. 3 Residential Humidifiers

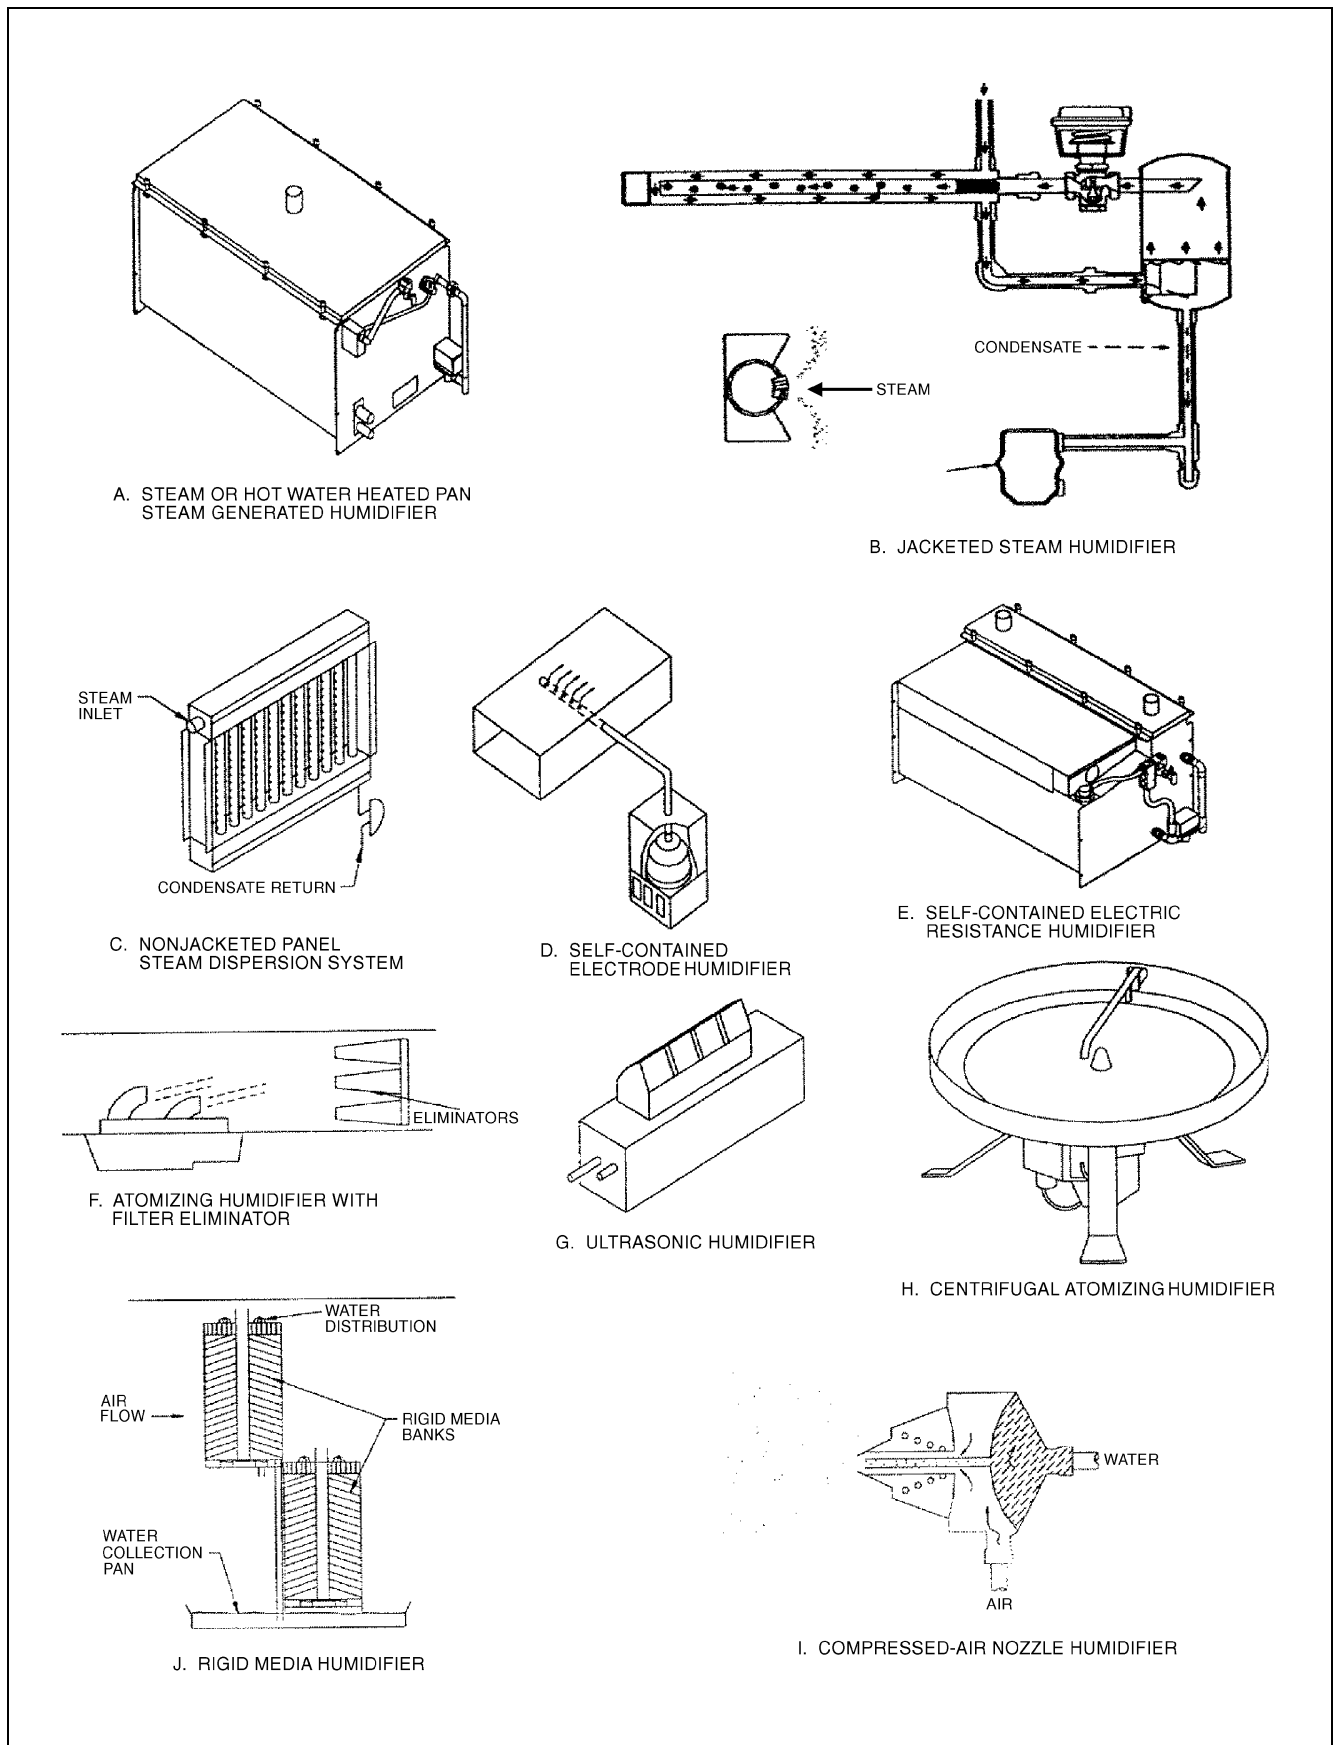


Fig. 4 Industrial Humidifiers

- *Nonjacketed manifold or panel-type distribution systems* (Figure 4C), with or without injection nozzles for distributing steam across the face of the duct or plenum.

Units must be installed where the air can absorb the discharged vapor before it comes into contact with components in the airstream, such as coils, dampers, or turning vanes. Otherwise, condensation can occur in the duct. Absorption distance varies according to the design of the humidifier distribution device and the air conditions within the duct. For proper psychrometric calculations, refer to [Chapter 6 of the ASHRAE Handbook—Fundamentals](#). Because these humidifiers inject steam from a central boiler source directly into the space or distribution duct, boiler treatment chemicals discharged into the air system may compromise indoor air quality. Chemicals should be checked for safety, and care should be taken to avoid contamination from the water or steam supplies.

Electrically Heated, Self-Contained Steam Humidifiers. These units convert ordinary city tap water to steam by electrical energy using either electrodes or resistance heater elements. The steam is generated at atmospheric pressure and discharged into the duct system through dispersion manifolds; if the humidifier is a freestanding unit, the steam is discharged directly into the air space through a fan unit. Some units allow the use of softened or demineralized water, which greatly extends the time between cleanings.

- *Electrode-type humidifiers* (Figure 4D) operate by passing an electric current directly into ordinary tap water, thereby creating heat energy to boil the water. The humidifier usually contains a polypropylene plastic bottle, either throwaway or cleanable, that is supplied with water through a solenoid valve. Water is drained off periodically to maintain a desirable solids concentration and the correct electrical flow. Manufacturers offer humidifiers with several different features, so their data should be consulted.
- *Resistance-type humidifiers* (Figure 4E) utilize one or more electrical elements that heat the water directly to produce steam. The water can be contained in a stainless steel or coated steel shell. The element and shell should be accessible for cleaning out mineral deposits. The high and low water levels should be controlled with either probes or float devices, and a blowdown drain system should be incorporated, particularly for off-operation periods.

Atomizing Humidifiers. Water treatment should be considered if mineral fallout from hard water is a problem. Optional filters may be required to remove the mineral dust from the humidified air (Figure 4F). Depending on the application and the water condition, atomizing humidifiers may require a reverse osmosis (RO) or a deionized (DI) water treatment system to remove the minerals. It is also important to note that wetted parts should be able to resist the corrosive effects of DI and RO water.

There are three main categories of atomizing humidifiers:

- *Ultrasonic humidifiers* (Figure 4G) utilize a piezoelectric transducer submerged in demineralized water. The transducer converts a high-frequency mechanical electric signal into a high-frequency oscillation. A momentary vacuum is created during the negative oscillation, causing the water to cavitate into vapor at low pressure. The positive oscillation produces a high-compression wave that drives the water particle from the surface to be quickly absorbed into the airstream. Because these types use demineralized water, no filter medium is required downstream. The ultrasonic humidifier is also manufactured as a freestanding unit.
- *Centrifugal humidifiers* (Figure 4H) use a high-speed disk, which slings the water to its rim, where it is thrown onto plates or a comb to produce a fine mist. The mist is introduced to the airstream, where it is evaporated.
- *Compressed-air nozzle humidifiers* can operate in two ways:

1. Compressed air and water are combined inside the nozzle and discharged onto a resonator to create a fine fog at the nozzle tip (Figure 4I).
2. Compressed air is passed through an annular orifice at the nozzle tip, and water is passed through a center orifice. The air creates a slight vortex at the tip, where the water breaks up into a fine fog on contact with the high-velocity compressed air.

Wetted Media Humidifiers. *Rigid media humidifiers* (Figure 4J) utilize a porous core. Water is circulated over the media while air is blown through the openings. These humidifiers are adiabatic, cooling the air as it is humidified. Rigid media cores are often used for the dual purpose of winter humidification and summer cooling. They depend on airflow for evaporation: the rate of evaporation varies with air temperature, humidity, and velocity.

The rigid media should be located downstream of any heating or cooling coils. For close humidity control, the element can be broken down into several (usually two to four) banks having separate water supplies. Solenoids controlling water flow to each bank are activated as humidification is required.

Rigid media humidifiers have inherent filtration and scrubbing properties due to the water-washing effect in the filter-like channels. Only pure water is evaporated; therefore, contaminants collected from the air and water must be flushed from the system. A continuous bleed or regular pan flushing is recommended to minimize accumulation of contaminants in the pan and on the media.

Evaporative Cooling. Atomizing and wetted media humidifiers discharge water at ambient temperature. The water absorbs heat from the surrounding air to evaporate the fog, mist, or spray at a rate of 1075 Btu per pound of water. This evaporative cooling effect (see [Chapter 19](#)) should be considered in the design of the system and if reheat is required to achieve the final air temperature. The ability of the surrounding air to efficiently absorb the fog, mist, or spray will also depend on its temperature, air velocity, and moisture content.

CONTROLS

Many humidity-sensitive materials are available. Some are organic, such as nylon, human hair, wood, and animal membranes that change length with humidity changes. Other sensors change electrical properties (resistance or capacitance) with humidity.

Mechanical Controls

Mechanical sensors depend on a change in the length or size of the sensor as a function of relative humidity. The most commonly used sensors are synthetic polymers or human hair. They can be attached to a mechanical linkage to control the mechanical, electrical, or pneumatic switching element of a valve or motor. This design is suitable for most human comfort applications, but it may lack the necessary accuracy for industrial applications.

A humidity controller is normally designed to control at a set point selected by the user. Some controllers have a setback feature that lowers the relative humidity set point as outdoor temperature drops to reduce condensation within the structure.

Electronic Controllers

Electrical sensors change electrical resistance as the humidity changes. They typically consist of two conductive materials separated by a humidity-sensitive, hygroscopic insulating material (polyvinyl acetate, polyvinyl alcohol, or a solution of certain salts). Small changes are detected as air passes over the sensing surface. Capacitive sensors use a dielectric material that changes its dielectric constant with relative humidity. The dielectric material is sandwiched between special conducting material that allows a fast response to changes in relative humidity.

Electronic control is common in laboratory or process applications requiring precise humidity control. It is also used to vary fan speed on portable humidifiers in order to regulate humidity in the space more closely and to reduce noise and draft to a minimum.

Electronic controls are now widely used for residential applications because of low-cost, accurate, and stable sensors that can be used with inexpensive microprocessors. They may incorporate methods of determining outside temperature so that relative humidity can be automatically reset to some predetermined algorithm intended to maximize human comfort and minimize any condensation problems (Pasch et al. 1996).

Along with a main humidity controller, the system may require other sensing devices:

- **High-limit sensors** may be required to ensure that duct humidity levels remain below the saturation or dew-point level. Sometimes cooler air is required to offset sensible heat gains. In these cases, the air temperature may drop below the dew point. Operating the humidifier under these conditions causes condensation in the duct or fogging in the room. High-limit sensors may be combined with a temperature sensor in certain designs.
- **Airflow sensors** should be used in place of a fan interlock. They sense airflow and disable the humidifier when insufficient airflow is present in the duct.
- **Steam sensors** are used to keep the control valve on direct-injection humidifiers closed when steam is not present at the humidifier. Either a pneumatic or an electric temperature-sensing switch is fitted between the separator and the steam trap to sense the temperature of the condensate and steam. When the switch senses steam temperature, it allows the control valve to function normally.

Humidity Control in Variable Air Volume (VAV) Systems

Control in VAV systems is much more demanding than in constant volume systems. VAV systems, common in large, central

station applications, control space temperature by varying the volume rather than the temperature of the supply air. Continual airflow variations to follow load changes within the building can create wide and rapid swings in space humidity. Due to the fast-changing nature and cooler supply air temperatures (55°F or lower) of most VAV systems, special modulating humidity controls should be applied.

Best results are obtained by using both space and duct modulating-type humidity sensors in conjunction with an integrating device, which in turn modulates the output of the humidifier. This allows the duct sensor to respond quickly to a rapid rise in duct humidity caused by reduced airflow to the space as temperature conditions are satisfied. The duct sensor at times overrides the space humidistat by reducing the humidifier output to correspond to decreasing air volumes. This type of system, commonly referred to as **anticipating control**, allows the humidifier to track the dynamics of the system and provide uniform control. Due to the operating duct static pressures of a VAV system, use of an **airflow proving device** is recommended to detect air movement.

Further information on the evaluation of humidity sensors can be found in ASHRAE (1992a).

Control Location

In centrally humidified structures, the humidity controller is most commonly mounted in a controlled space. Another method is to mount the controller in the return air duct of an air-handling system to sense average relative humidity. Figure 5 shows general recommended locations for the humidistat for a centrally air-conditioned room.

The manufacturer’s instructions regarding the use of the controller on counterflow furnaces should be followed because reverse airflow when the fan is off can substantially shift the humidity control point in a home. The sensor should be located where it will not be

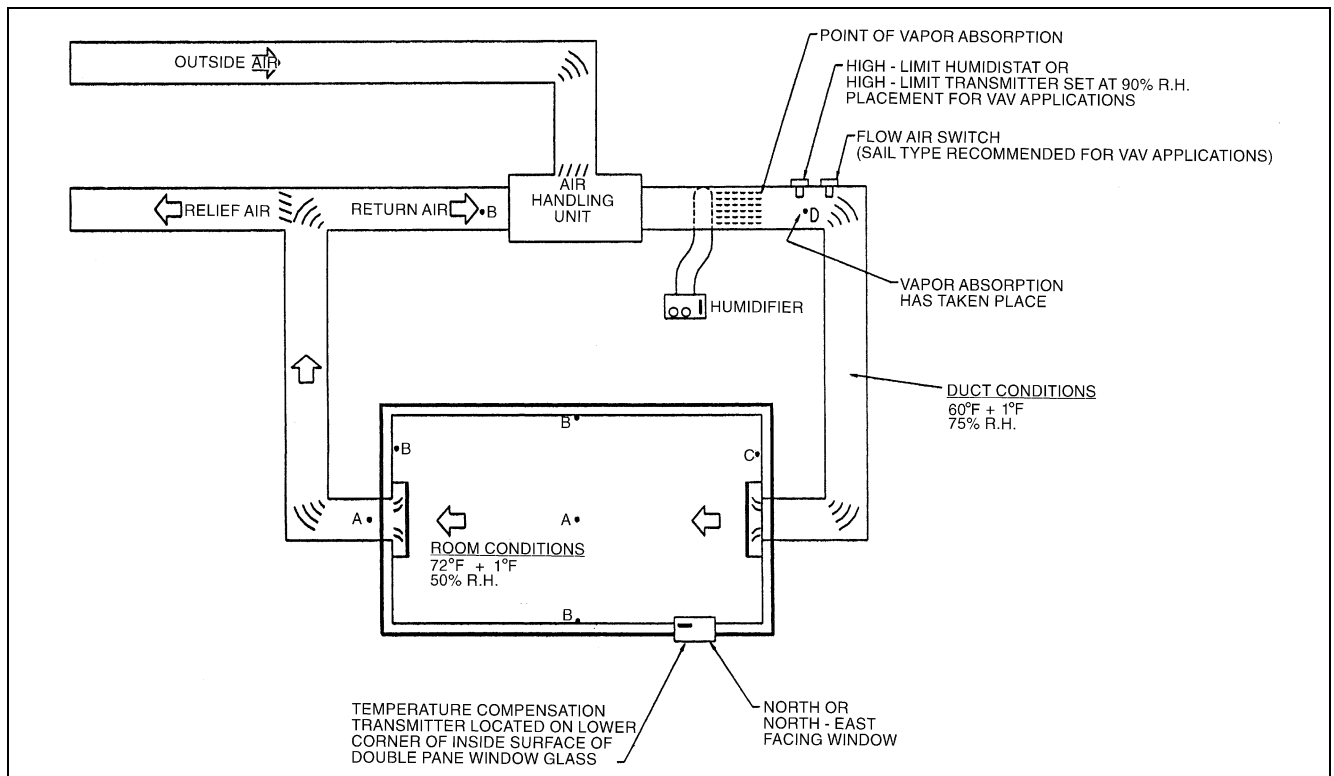


Fig. 5 Recommended Humidity Controller Location

affected by (1) air that exits the bypass duct of a bypass humidifier or (2) drafts or local heat or moisture sources.

REFERENCES

- AHAM. 1987. Appliance humidifiers. *Standard* HU-1. Association of Home Appliance Manufacturers, Chicago.
- ARI. 1996. Central system humidifiers for residential applications. ANSI/ARI *Standard* 610-96. Air-Conditioning and Refrigeration Institute, Arlington, VA.
- ARI. 1996. Commercial and industrial humidifiers. ANSI/ARI *Standard* 640-96.
- ASHRAE. 1992a. Control of humidity in buildings. *Technical Data Bulletin* 8(3).
- ASHRAE. 1992b. Thermal environmental conditions for human occupancy. ANSI/ASHRAE *Standard* 55-1992.
- ASHRAE. 1999. Ventilation for acceptable indoor air quality. *Standard* 62-1999.
- Berglund, L.G. 1998. Comfort and humidity. *ASHRAE Journal* 40(8):35-41.
- Brown, W.G., K.R. Solvason, and A.G. Wilson. 1963. Heat and moisture flow through openings by convection. *ASHRAE Journal* 5(9):49.
- Davis, J.W., C.O. Ruud, and R.F. Unz. 1993. Analysis of furnace-mount humidifier for microbiological and particle emissions—Part I: Test system development. *ASHRAE Transactions* 99(1):1377-86.
- Harris, C.M. 1963. Absorption of sound in air in the audio-frequency range. *Journal of the Acoustical Society of America* 35(January).
- Luck, J.R. and L.W. Nelson. 1977. The variation of infiltration rate with relative humidity in a frame building. *ASHRAE Transactions* 83(1):718-29.
- Pasch, R.M., M. Comins, and J.S. Hobbins. 1996. Field experiences in residential humidification control with temperature-compensated automatic humidistats. *ASHRAE Transactions* 102(2):628-32.
- Puckorius, P.R., P.T. Thomas, and R.L. Augspurger. 1995. Why evaporative coolers have not caused Legionnaires' disease. *ASHRAE Journal* 37(1):29-33.
- Ruud, C.O., J.W. Davis, and R.F. Unz. 1993. Analysis of furnace-mount humidifier for microbiological and particle emissions—Part II: Particle sampling and results. *ASHRAE Transactions* 99(1):1387-95.
- Sterling, E.M., A. Arundel, and T.D. Sterling. 1985. Criteria for human exposure to humidity in occupied buildings. *ASHRAE Transactions* 91(1B):611-22.
- Unz, R.F., J.W. Davis, and C.O. Ruud. 1993. Analysis of furnace-mount humidifiers for microbiological and particle emissions—Part III: Microbiological sampling and results. *ASHRAE Transactions* 99(1):1396-1404.
- Wilson, A.G. and W.P. Brown. 1964. Thermal characteristics of double windows. *Canadian Building Digest* No. 58. Division of Building Research, National Research Council, Ottawa, ON.