

CHAPTER 8

THERMAL COMFORT

<i>Human Thermoregulation</i>	8.1	<i>Secondary Factors Affecting Comfort</i>	8.15
<i>Energy Balance</i>	8.2	<i>Prediction of Thermal Comfort</i>	8.16
<i>Thermal Exchanges with the Environment</i>	8.3	<i>Environmental Indices</i>	8.19
<i>Engineering Data and Measurements</i>	8.6	<i>Special Environments</i>	8.22
<i>Conditions for Thermal Comfort</i>	8.12	<i>Symbols</i>	8.26
<i>Thermal Nonuniform Conditions and Local Discomfort</i>	8.13		

A PRINCIPAL purpose of heating, ventilating, and air-conditioning systems is to provide conditions for human thermal comfort. A widely accepted definition is, “Thermal Comfort is that condition of mind that expresses satisfaction with the thermal environment” (ASHRAE *Standard* 55). This definition leaves open what is meant by condition of mind or satisfaction, but it correctly emphasizes that the judgment of comfort is a cognitive process involving many inputs influenced by physical, physiological, psychological, and other processes.

The conscious mind appears to reach conclusions about thermal comfort and discomfort from direct temperature and moisture sensations from the skin, deep body temperatures, and the efforts necessary to regulate body temperatures (Hensel 1973, 1981; Hardy et al. 1971; Gagge 1937; Berglund 1995). In general, comfort occurs when body temperatures are held within narrow ranges, skin moisture is low, and the physiological effort of regulation is minimized.

Comfort also depends on behavioral actions that are initiated unconsciously or by the conscious mind and guided by thermal and moisture sensations to reduce discomfort. Some of the possible behavioral actions to reduce discomfort are altering clothing, altering activity, changing posture or location, changing the thermostat setting, opening a window, complaining, or leaving the space.

Surprisingly, although regional climate conditions, living conditions, and cultures differ widely throughout the world, the temperature that people choose for comfort under like conditions of clothing, activity, humidity, and air movement has been found to be very similar (Fanger 1972; de Dear et al. 1991; Busch 1992).

This chapter summarizes the fundamentals of human thermoregulation and comfort in terms useful to the engineer for operating systems and designing for the comfort and health of building occupants.

HUMAN THERMOREGULATION

The metabolic activities of the body result almost completely in heat that must be continuously dissipated and regulated to maintain normal body temperatures. Insufficient heat loss leads to overheating, also called **hyperthermia**, and excessive heat loss results in body cooling, also called **hypothermia**. Skin temperature greater than 45°C or less than 18°C causes pain (Hardy et al. 1952). Skin temperatures associated with comfort at sedentary activities are 33 to 34°C and decrease with increasing activity (Fanger 1968). In contrast, internal temperatures rise with activity. The temperature regulatory center in the brain is about 36.8°C at rest in comfort and increases to about 37.4°C when walking and 37.9°C when jogging. An internal temperature less than about 28°C can lead to serious cardiac arrhythmia and death, and a temperature greater than 46°C can cause irreversible brain damage. Therefore, the careful regulation of body temperature is critical to comfort and health.

The heat produced by a resting adult is about 100 W. Because most of this heat is transferred to the environment through the skin, it is often convenient to characterize metabolic activity in terms of heat production per unit area of skin. For the resting person, this is about 58 W/m² and is called 1 met. This is based on the average male European, with a skin surface area of about 1.8 m². For comparison, female Europeans have an average surface area of 1.6 m². Systematic differences in this parameter may occur between ethnic and geographical groups. Higher metabolic rates are often described in terms of the resting rate. Thus, a person working at metabolic rate five times the resting rate would have a metabolic rate of 5 met.

The **hypothalamus**, located in the brain, is the central control organ for body temperature. It has hot and cold temperature sensors and is bathed by arterial blood. Since the recirculation rate of blood in the body is rapid and returning blood is mixed together in the heart before returning to the body, arterial blood is indicative of the average internal body temperature. The hypothalamus also receives thermal information from temperature sensors in the skin and perhaps other locations as well (spinal cord, gut), as summarized by Hensel (1981).

The hypothalamus controls various physiological processes of the body to regulate body temperature. Its control behavior is primarily proportional to deviations from set-point temperatures with some integral and derivative response aspects. The most important and often used of the physiological processes is regulating blood flow to the skin. When internal temperatures rise above a set point, an increasing proportion of the total blood is directed to the skin. This **vasodilation** of skin blood vessels can increase skin blood flow by 15 times (from 1.7 mL/(s · m²) at resting comfort to 25 mL/(s · m²) in extreme heat) to carry internal heat to the skin for transfer to the environment. When body temperatures fall below the set point, skin blood flow is reduced (vasoconstricted) to conserve body heat. The effect of maximum vasoconstriction is equivalent to the insulating effect of a heavy sweater. At temperatures less than the set point, muscle tension increases to generate additional heat; where muscle groups are opposed, this may increase to visible shivering. Shivering can double the resting rate of heat production.

At elevated internal temperatures, sweating occurs. This defense mechanism is a powerful way to cool the skin and increase heat loss from the core. The sweating function of the skin and its control is more advanced in humans than in other animals and is increasingly necessary for comfort at metabolic rates above resting level (Fanger 1968). Sweat glands pump perspiration onto the skin surface for evaporation. If conditions are good for evaporation, the skin can remain relatively dry even at high sweat rates with little perception of sweating. At skin conditions less favorable for evaporation, the sweat must spread out on the skin about the sweat gland until the sweat-covered area is sufficient to evaporate the sweat coming to the surface. The fraction of the skin that is covered with water to account for the observed total evaporation rate is termed **skin wettedness** (Gagge 1937).

The preparation of this chapter is assigned to TC 2.1, Physiology and Human Environment.

Humans are quite good at sensing skin moisture from perspiration (Berglund and Cunningham 1986; Berglund 1994), and skin moisture correlates well with warm discomfort and unpleasantness (Winslow et al. 1937). It is rare for a sedentary or slightly active person to be comfortable with a skin wettedness greater than 25%. In addition to the perception of skin moisture, skin wettedness increases the friction between skin and fabrics, making clothing feel less pleasant and fabrics feel more coarse (Gwosdow et al. 1987). This also occurs with architectural materials and surfaces, particularly smooth, nonhygroscopic surfaces.

With repeated intermittent heat exposure, the set point for the onset of sweating decreases and the proportional gain or temperature sensitivity of the sweating system increases (Gonzalez et al. 1978, Hensel 1981). However, under long-term exposure to hot conditions, the set point increases, perhaps to reduce the physiological effort of sweating. Perspiration as secreted has a lower salt concentration than interstitial body fluid or blood plasma. After prolonged heat exposure, sweat glands further reduce the salt concentration of sweat to conserve salt.

At the surface, the water in sweat evaporates while the dissolved salt and other constituents remain and accumulate. Because salt lowers the vapor pressure of water and thereby impedes its evaporation, the accumulating salt results in increased skin wettedness with time. Some of the relief and pleasure of washing after a warm day is related to the restoration of a hypotonic sweat film and decreased skin wettedness. Other adaptations to heat are increased blood flow and sweating in peripheral regions where heat transfer is better. Such adaptations are examples of **integral control**.

The role of thermoregulatory effort in comfort is highlighted by the experiments of Chatonnet and Cabanac (1965) and observations of Kuno (1995). Chatonnet's experiments compared the sensation of placing the subject's hand in relatively hot or cold water (30 to 38°C) for 30 s given the subject at different thermal states. When the person was overheated or hyperthermic, the cold water was pleasant and the hot water was very unpleasant, but when the subject was in a cold or hypothermic state, the hand felt pleasant in hot water and unpleasant in cold water. Kuno (1995) describes similar observations during transient whole body exposures to hot and cold environment. When a subject is in a state of thermal discomfort, any move away from the thermal stress of the uncomfortable environment is perceived as pleasant during the transition.

ENERGY BALANCE

Figure 1 shows the thermal interaction of the human body with its environment. The total metabolic rate of work M produced within the body is the metabolic rate required for the person's activity M_{act} plus the metabolic level required for shivering M_{shiv} (should shivering occur). A portion of the body's energy production may be expended as external work done by the muscles W ; the net heat production $M - W$ is either stored (S), causing the body's temperature to rise, or dissipated to the environment through the skin surface (q_{sk}) and respiratory tract (q_{res}).

$$\begin{aligned} M - W &= q_{sk} + q_{res} + S \\ &= (C + R + E_{sk}) + (C_{res} + E_{res}) + (S_{sk} + S_{cr}) \end{aligned} \quad (1)$$

where

- M = rate of metabolic heat production, W/m²
- W = rate of mechanical work accomplished, W/m²
- q_{sk} = total rate of heat loss from skin, W/m²
- q_{res} = total rate of heat loss through respiration, W/m²
- $C + R$ = sensible heat loss from skin, W/m²
- E_{sk} = total rate of evaporative heat loss from skin, W/m²
- C_{res} = rate of convective heat loss from respiration, W/m²
- E_{res} = rate of evaporative heat loss from respiration, W/m²
- S_{sk} = rate of heat storage in skin compartment, W/m²
- S_{cr} = rate of heat storage in core compartment, W/m²

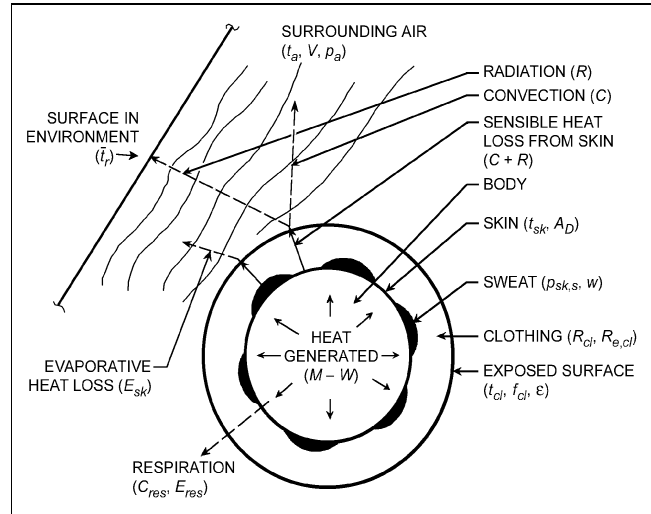


Fig. 1 Thermal Interaction of Human Body and Environment

Heat dissipation from the body to the immediate surroundings occurs by several modes of heat exchange: sensible heat flow $C + R$ from the skin; latent heat flow from the evaporation of sweat E_{rs} and from evaporation of moisture diffused through the skin E_{dif} ; sensible heat flow during respiration C_{res} ; and latent heat flow due to evaporation of moisture during respiration E_{res} . Sensible heat flow from the skin may be a complex mixture of conduction, convection, and radiation for a clothed person; however, it is equal to the sum of the convection C and radiation R heat transfer at the outer clothing surface (or exposed skin).

Sensible and latent heat losses from the skin are typically expressed in terms of environmental factors, skin temperature t_{sk} , and skin wettedness w . The expressions also incorporate factors that account for the thermal insulation and moisture permeability of clothing. The independent environmental variables can be summarized as air temperature t_a , mean radiant temperature $\bar{t}_r$, relative air velocity V , and ambient water vapor pressure p_a . The independent personal variables that influence thermal comfort are activity and clothing.

The rate of heat storage in the body equals the rate of increase in internal energy. The body can be considered as two thermal compartments, the skin and the core (see the section on Two-Node Model under Prediction of Thermal Comfort). The rate of storage can be written separately for each compartment in terms of thermal capacity and time rate of change of temperature in each compartment:

$$S_{cr} = \frac{(1 - \alpha_{sk})mc_{p,b}}{A_D} \frac{dt_{cr}}{d\theta} \quad (2)$$

$$S_{sk} = \frac{\alpha_{sk}mc_{p,b}}{A_D} \frac{dt_{sk}}{d\theta} \quad (3)$$

where

- α_{sk} = fraction of body mass concentrated in skin compartment
- m = body mass, kg
- $c_{p,b}$ = specific heat capacity of body = 3490 J/(kg · K)
- A_D = DuBois surface area, m²
- t_{cr} = temperature of core compartment, °C
- t_{sk} = temperature of skin compartment, °C
- θ = time, s

The fractional skin mass α_{sk} depends on the rate $\dot{m}_{bl}$ of blood flowing to the skin surface.

THERMAL EXCHANGES WITH THE ENVIRONMENT

Fanger (1967, 1970), Hardy (1949), Rapp and Gagge (1967), and Gagge and Hardy (1967) give quantitative information on calculating the heat exchange between people and the environment. A summary of the mathematical statements for various terms of heat exchange used in the heat balance equations (C , R , E_{sk} , C_{res} , E_{res}) follows. Terms describing the heat exchanges associated with the thermoregulatory control mechanisms ($q_{cr,sk}$, M_{shiv} , E_{rsw}), values for the coefficients, and appropriate equations for M_{act} and A_D are presented in later sections.

The mathematical description of the energy balance of the human body represents a combined rational/empirical approach to describing the thermal exchanges with the environment. Fundamental heat transfer theory is used to describe the various mechanisms of sensible and latent heat exchange, while empirical expressions are used to determine the values of the coefficients describing these rates of heat exchange. Empirical equations are also used to describe the thermophysiological control mechanisms as a function of skin and core temperatures in the body.

Body Surface Area

The terms in Equation (1) have units of power per unit area and refer to the surface area of the nude body. The most useful measure of nude body surface area, originally proposed by DuBois and DuBois (1916), is described by

$$A_D = 0.202m^{0.425}l^{0.725} \quad (4)$$

where

$$\begin{aligned} A_D &= \text{DuBois surface area, m}^2 \\ m &= \text{mass, kg} \\ l &= \text{height, m} \end{aligned}$$

A correction factor $f_{cl} = A_{cl}/A_D$ must be applied to the heat transfer terms from the skin (C , R , and E_{sk}) to account for the actual surface area A_{cl} of the clothed body. This factor can be found in Table 7 for various clothing ensembles. For a 1.73 m tall, 70 kg man, $A_D = 1.8 \text{ m}^2$. All terms in the basic heat balance equations are expressed per unit **DuBois surface area**.

Sensible Heat Loss from Skin

Sensible heat exchange from the skin surface must pass through clothing to the surrounding environment. These paths are treated in series and can be described in terms of heat transfer (1) from the skin surface, through the clothing insulation, to the outer clothing surface, and (2) from the outer clothing surface to the environment.

Both convective C and radiative R heat losses from the outer surface of a clothed body can be expressed in terms of a heat transfer coefficient and the difference between the mean temperature t_{cl} of the outer surface of the clothed body and the appropriate environmental temperature:

$$C = f_{cl}h_c(t_{cl} - t_a) \quad (5)$$

$$R = f_{cl}h_r(t_{cl} - \bar{t}_r) \quad (6)$$

where

$$\begin{aligned} h_c &= \text{convective heat transfer coefficient, W/(m}^2\cdot\text{K)} \\ h_r &= \text{linear radiative heat transfer coefficient, W/(m}^2\cdot\text{K)} \\ f_{cl} &= \text{clothing area factor } A_{cl}/A_D, \text{ dimensionless} \end{aligned}$$

The coefficients h_c and h_r are both evaluated at the clothing surface. Equations (5) and (6) are commonly combined to describe the total sensible heat exchange by these two mechanisms in terms of an operative temperature t_o and a combined heat transfer coefficient h :

$$C + R = f_{cl}h(t_{cl} - t_o) \quad (7)$$

where

$$t_o = \frac{h_r \bar{t}_r + h_c t_a}{h_r + h_c} \quad (8)$$

$$h = h_r + h_c \quad (9)$$

Based on Equation (8), operative temperature t_o can be defined as the average of the mean radiant and ambient air temperatures, weighted by their respective heat transfer coefficients.

The actual transport of sensible heat through clothing involves conduction, convection, and radiation. It is usually most convenient to combine these into a single thermal resistance value R_{cl} , defined by

$$C + R = (t_{sk} - t_{cl})/R_{cl} \quad (10)$$

where R_{cl} is the thermal resistance of clothing in $\text{m}^2\cdot\text{K/W}$.

Since it is often inconvenient to include the clothing surface temperature in calculations, Equations (7) and (10) can be combined to eliminate t_{cl} :

$$C + R = \frac{t_{sk} - t_o}{R_{cl} + 1/(f_{cl}h)} \quad (11)$$

where t_o is defined in Equation (8).

Evaporative Heat Loss from Skin

Evaporative heat loss E_{sk} from skin depends on the amount of moisture on the skin and the difference between the water vapor pressure at the skin and in the ambient environment:

$$E_{sk} = \frac{w(p_{sk,s} - p_a)}{R_{e,cl} + 1/(f_{cl}h_e)} \quad (12)$$

where

$$\begin{aligned} w &= \text{skin wettedness, dimensionless} \\ p_{sk,s} &= \text{water vapor pressure at skin, normally assumed to be that of saturated water vapor at } t_{sk}, \text{ kPa} \\ p_a &= \text{water vapor pressure in ambient air, kPa} \\ R_{e,cl} &= \text{evaporative heat transfer resistance of clothing layer (analogous to } R_{cl}), \text{ m}^2\cdot\text{kPa/W} \\ h_e &= \text{evaporative heat transfer coefficient (analogous to } h_c), \text{ W/(m}^2\cdot\text{kPa)} \end{aligned}$$

Procedures for calculating $R_{e,cl}$ and h_e are given in the section on Engineering Data and Measurements. The skin wettedness fraction is the ratio of the actual evaporative heat loss to the maximum possible evaporative heat loss E_{max} with the same conditions and a completely wet skin ($w = 1$). Skin wettedness is important in determining evaporative heat loss. Maximum evaporative potential E_{max} occurs when $w = 1$.

Evaporative heat loss from the skin is a combination of the evaporation of sweat secreted due to thermoregulatory control mechanisms E_{rsw} and the natural diffusion of water through the skin E_{dif} :

$$E_{sk} = E_{rsw} + E_{dif} \quad (13)$$

Evaporative heat loss by regulatory sweating is directly proportional to the rate of regulatory sweat generation:

$$E_{rsw} = \dot{m}_{rsw}h_{fg} \quad (14)$$

where

$$\begin{aligned} h_{fg} &= \text{heat of vaporization of water} = 2.43 \times 10^6 \text{ J/kg at } 30^\circ\text{C} \\ \dot{m}_{rsw} &= \text{rate at which regulatory sweat is generated, kg/(s}\cdot\text{m}^2) \end{aligned}$$

The portion w_{rsw} of a body that must be wetted to evaporate the regulatory sweat is

$$w_{rsw} = E_{rsw}/E_{max} \quad (15)$$

With no regulatory sweating, skin wettedness due to diffusion is approximately 0.06 for normal conditions. For large values of E_{max} or long exposures to low humidities, the value may drop to as low as 0.02, since dehydration of the outer skin layers alters its diffusive characteristics. With regulatory sweating, the 0.06 value applies only to the portion of skin not covered with sweat ($1 - w_{rsw}$); the diffusion evaporative heat loss is

$$E_{dif} = (1 - w_{rsw})0.06E_{max} \quad (16)$$

These equations can be solved for w , given the maximum evaporative potential E_{max} and the regulatory sweat generation E_{rsw} :

$$w = w_{rsw} + 0.06(1 - w_{rsw}) = 0.06 + 0.94E_{rsw}/E_{max} \quad (17)$$

Once skin wettedness is determined, evaporative heat loss from the skin is calculated from Equation (12), or by

$$E_{sk} = wE_{max} \quad (18)$$

To summarize, the following calculations determine w and E_{sk} :

E_{max}	Equation (12), with $w = 1.0$
E_{rsw}	Equation (14)
w	Equation (17)
E_{sk}	Equation (18) or (12)

Although evaporation from the skin E_{sk} as described in Equation (12) depends on w , the body does not directly regulate skin wettedness but, rather, regulates sweat rate $\dot{m}_{rsw}$ [Equation (14)]. Skin wettedness is then an indirect result of the relative activity of the sweat glands and the evaporative potential of the environment. Skin wettedness of 1.0 is the upper theoretical limit. If the aforementioned calculations yield a wettedness of more than 1.0, then Equation (14) is no longer valid because not all the sweat is evaporated. In this case, $E_{sk} = E_{max}$.

Skin wettedness is strongly correlated with warm discomfort and is also a good measure of thermal stress. Theoretically, skin wettedness can approach 1.0 while the body still maintains thermoregulatory control. In most situations, it is difficult to exceed 0.8 (Berglund and Gonzalez 1978). Azer (1982) recommends 0.5 as a practical upper limit for sustained activity for a healthy acclimatized person.

Respiratory Losses

During respiration, the body loses both sensible and latent heat by convection and evaporation of heat and water vapor from the respiratory tract to the inhaled air. A significant amount of heat can be associated with respiration because the air is inspired at ambient conditions and expired nearly saturated at a temperature only slightly cooler than t_{cr} .

The total heat and moisture losses due to respiration are

$$\begin{aligned} q_{res} &= C_{res} + E_{res} \\ &= \frac{\dot{m}_{res}(h_{ex} - h_a)}{A_D} \end{aligned} \quad (19)$$

$$\dot{m}_{w,res} = \frac{\dot{m}_{res}(W_{ex} - W_a)}{A_D} \quad (20)$$

where

$\dot{m}_{res}$ = pulmonary ventilation rate, kg/s
 h_{ex} = enthalpy of exhaled air, J/kg (dry air)

h_a = enthalpy of inspired (ambient) air, J/kg (dry air)

$\dot{m}_{w,res}$ = pulmonary water loss rate, kg/s

W_{ex} = humidity ratio of exhaled air, kg (water vapor)/kg (dry air)

W_a = humidity ratio of inspired (ambient) air, kg (water vapor)/kg (dry air)

Under normal circumstances, pulmonary ventilation rate is primarily a function of metabolic rate (Fanger 1970):

$$\dot{m}_{res} = K_{res}MA_D \quad (21)$$

where

M = metabolic rate, W/m²

K_{res} = proportionality constant (1.43×10^{-6} kg/J)

Respiratory air is nearly saturated and near the body temperature when exhaled. For typical indoor environments (McCutchan and Taylor 1951), the exhaled temperature and humidity ratio are given in terms of ambient conditions:

$$t_{ex} = 32.6 + 0.066t_a + 32W_a \quad (22)$$

$$W_{ex} = 0.0277 + 0.000065t_a + 0.2W_a \quad (23)$$

where ambient t_a and exhaled t_{ex} air temperatures are in °C. For extreme conditions, such as outdoor winter environments, different relationships may be required (Holmer 1984).

The humidity ratio of ambient air can be expressed in terms of total or barometric pressure p_t and ambient water vapor pressure p_a :

$$W_a = \frac{0.622p_a}{p_t - p_a} \quad (24)$$

Respiratory heat loss is often expressed in terms of sensible C_{res} and latent E_{res} heat losses. Two approximations are commonly used to simplify Equations (22) and (23) for that purpose. First, because the dry respiratory heat loss is relatively small compared to the other terms in the heat balance, an average value for t_{ex} is determined by evaluating Equation (22) at standard conditions of 20°C, 50% rh, sea level. Second, noting in Equation (23) that there is only a weak dependence on t_a , the second term in Equation (23) and the denominator in Equation (24) are evaluated at standard conditions. Using these approximations and substituting latent heat h_{fg} and specific heat of air $c_{p,a}$ at standard conditions, C_{res} and E_{res} can be determined by

$$C_{res} = 0.0014M(34 - t_a) \quad (25)$$

$$E_{res} = 0.0173M(5.87 - p_a) \quad (26)$$

where p_a is expressed in kPa and t_a is in °C.

Alternative Formulations

Equations (11) and (12) describe heat loss from skin for clothed people in terms of clothing parameters R_{cl} , $R_{e,cl}$, and f_{cl} ; parameters h and h_e describe outer surface resistances. Other parameters and definitions are also used. Although these alternative parameters and definitions may be confusing, note that the information presented in one form can be converted to another form. Table 1 presents common parameters and their qualitative descriptions. Table 2 presents equations showing their relationship to each other. Generally, parameters related to dry or evaporative heat flows are not independent because they both rely, in part, on the same physical processes. The **Lewis relation** describes the relationship between convective heat transfer and mass transfer coefficients for a surface [see Equation (39) in Chapter 5]. The Lewis relation can be used to relate convective and evaporative heat transfer coefficients defined in Equations (5) and (12) according to

Table 1 Parameters Used to Describe Clothing

Sensible Heat Flow	Evaporative Heat Flow
R_{cl} = intrinsic clothing insulation, the thermal resistance of a uniform layer of insulation covering the entire body that has the same effect on sensible heat flow as the actual clothing.	$R_{e,cl}$ = evaporative heat transfer resistance of the clothing, the impedance to transport of water vapor of a uniform layer of insulation covering the entire body that has the same effect on evaporative heat flow as the actual clothing.
R_t = total insulation, the total equivalent uniform thermal resistance between the body and the environment: clothing and boundary resistance.	$R_{e,t}$ = total evaporative resistance, the total equivalent uniform impedance to the transport of water vapor from the skin to the environment.
R_{cle} = effective clothing insulation, the increased body insulation due to clothing as compared to the nude state.	F_{pcl} = permeation efficiency, the ratio of the actual evaporative heat loss to that of a nude body at the same conditions, including an adjustment for the increase in surface area due to the clothing.
R_a = boundary insulation, the thermal resistance at the skin boundary for a nude body.	
$R_{a,cl}$ = outer boundary insulation, the thermal resistance at the outer boundary (skin or clothing).	
h' = overall sensible heat transfer coefficient, overall equivalent uniform conductance between the body (including clothing) and the environment.	Parameters Relating Sensible and Evaporative Heat Flows
h'_{cl} = clothing conductance, the thermal conductance of a uniform layer of insulation covering the entire body that has the same effect on sensible heat flow as the actual clothing.	i_{cl} = clothing vapor permeation efficiency, the ratio of the actual evaporative heat flow capability through the clothing to the sensible heat flow capability as compared to the Lewis ratio.
F_{cle} = effective clothing thermal efficiency, the ratio of the actual sensible heat loss to that of a nude body at the same conditions.	i_m = total vapor permeation efficiency, the ratio of the actual evaporative heat flow capability between the skin and the environment to the sensible heat flow capability as compared to the Lewis ratio.
F_{cl} = intrinsic clothing thermal efficiency, the ratio of the actual sensible heat loss to that of a nude body at the same conditions including an adjustment for the increase in surface area due to the clothing.	i_a = air layer vapor permeation efficiency, the ratio of the actual evaporative heat flow capability through the outer air layer to the sensible heat flow capability as compared to the Lewis ratio.

Table 2 Relationships Between Clothing Parameters

Sensible Heat Flow
$R_t = R_{cl} + 1/(hf_{cl}) = R_{cl} + R_a/f_{cl}$
$R_t = R_{cle} + 1/h = R_{cle} + R_a$
$h'_{cl} = 1/R_{cl}$
$h' = 1/R_t$
$h = 1/R_a$
$R_{a,cl} = R_a/f_{cl}$
$F_{cl} = h'/(hf_{cl}) = 1/(1 + f_{cl}hR_{cl})$
$F_{cle} = h'/h = f_{cl}/(1 + f_{cl}hR_{cl}) = f_{cl}F_{cl}$
Evaporative Heat Flow
$R_{e,t} = R_{e,cl} + 1/(h_e f_{cl}) = R_{e,cl} + R_{e,a}/f_{cl}$
$h_e = 1/R_{e,a}$
$h'_{e,cl} = 1/R_{e,cl}$
$h'_e = 1/R_{e,t} = f_{cl}F_{pcl}h_e$
$F_{pcl} = 1/(1 + f_{cl}h_e R_{e,cl})$
Parameters Relating Sensible and Evaporative Heat Flows
$i_{cl}LR = h'_{e,cl}/h'_{cl} = R_{cl}/R_{e,cl}$
$i_mLR = h'_e/h' = R_t/R_{e,t}$
$i_m = (R_{cl} + R_{a,cl})/[(R_{cl}/i_{cl}) + (R_{a,cl}/i_a)]$
$i_aLR = h_e/h$
$i_a = h_c/(h_c + h_r)$

$$h_e/h_c = LR \quad (27)$$

where LR is the **Lewis ratio** and, at typical indoor conditions, equals approximately 16.5 K/kPa. The Lewis relation applies to surface convection coefficients. Heat transfer coefficients that include the effects of insulation layers and/or radiation are still coupled, but the relationship may deviate significantly from that for a surface. The i terms in Tables 1 and 2 describe how the actual ratios of these parameters deviate from the ideal Lewis ratio (Woodcock 1962; Oohori et al. 1984).

Depending on the combination of parameters used, heat transfer from the skin can be calculated using several different formulations

Table 3 Skin Heat Loss Equations

Sensible Heat Loss
$C + R = (t_{sk} - t_o)[R_{cl} + 1/(f_{cl}h)]$
$C + R = (t_{sk} - t_o)/R_t$
$C + R = F_{cle}h(t_{sk} - t_o)$
$C + R = F_{cl}f_{cl}h(t_{sk} - t_o)$
$C + R = h'(t_{sk} - t_o)$
Evaporative Heat Loss
$E_{sk} = w(p_{sk,s} - p_a)[R_{e,cl} + 1/(f_{cl}h_e)]$
$E_{sk} = w(p_{sk,s} - p_a)/R_{e,t}$
$E_{sk} = wF_{pcl}f_{cl}h_e(p_{sk,s} - p_a)$
$E_{sk} = h'_e w(p_{sk,s} - p_a)$
$E_{sk} = h'w i_m LR(p_{sk,s} - p_a)$

(see Tables 2 and 3). If the parameters are used correctly, the end result will be the same regardless of the formulation used.

Total Skin Heat Loss

Total skin heat loss—sensible heat plus evaporative heat—can be calculated from any combination of the equations presented in Table 3. Total skin heat loss is used as a measure of the thermal environment; two combinations of parameters that yield the same total heat loss for a given set of body conditions (t_{sk} and w) are considered to be approximately equivalent. The fully expanded skin heat loss equation, showing each parameter that must be known or specified, is as follows:

$$q_{sk} = \frac{t_{sk} - t_o}{R_{cl} + R_{a,cl}} + \frac{w(p_{sk,s} - p_a)}{R_{e,cl} + 1/(LRh_c f_{cl})} \quad (28)$$

where t_o is the operative temperature and represents the temperature of a uniform environment ($t_a - \bar{t}_r$) that will transfer dry heat at the same rate as in the actual environment [$t_o = (\bar{t}_r h_r + t_a h_c)/(h_c + h_r)$]. After rearranging, Equation (28) becomes

$$q_{sk} = F_{cl}f_{cl}h(t_{sk} - t_o) + wLR F_{pcl}h_e(p_{sk,s} - p_a) \quad (29)$$

This equation allows the trade-off between any two or more parameters to be evaluated under given conditions. If the trade-off

between two specific variables is to be examined, then a simplified form of the equation suffices. The trade-off between operative temperature and humidity is often of interest. Equation (28) can be written in a simpler form for this purpose (Fobelets and Gagge 1988):

$$q_{sk} = h'[(t_{sk} + w i_m \text{LR} p_{sk,s}) - (t_o + w i_m \text{LR} p_a)] \quad (30)$$

Equation (30) can be used to define a combined temperature t_{com} , which reflects the combined effect of operative temperature and humidity for an actual environment:

$$t_{com} + w i_m \text{LR} p_{t_{com}} = t_o + w i_m \text{LR} p_a$$

or

$$t_{com} = t_o + w i_m \text{LR} p_a - w i_m \text{LR} p_{t_{com}} \quad (31)$$

where $p_{t_{com}}$ is a vapor pressure related in some fixed way to t_{com} and is analogous to $p_{wb,s}$ for t_{wb} . The term $w i_m \text{LR} p_{t_{com}}$ is constant to the extent that i_m is constant, and any combination of t_o and p_a that gives the same t_{com} will result in the same total heat loss.

Environmental indices are discussed in the section on Environmental Indices. Two of these, the humid operative temperature t_{oh} and the effective temperature ET^* , can be represented in terms of Equation (31). The humid operative temperature is that temperature which at 100% rh yields the same total heat loss as for the actual environment:

$$t_{oh} = t_o + w i_m \text{LR}(p_a - p_{oh,s}) \quad (32)$$

where $p_{oh,s}$ is saturated vapor pressure, in kPa, at t_{oh} .

The effective temperature is the temperature at 50% rh that yields the same total heat loss from the skin as for the actual environment:

$$ET^* = t_o + w i_m \text{LR}(p_a - 0.5 p_{ET^*,s}) \quad (33)$$

where $p_{ET^*,s}$ is saturated vapor pressure, in kPa, at ET^* .

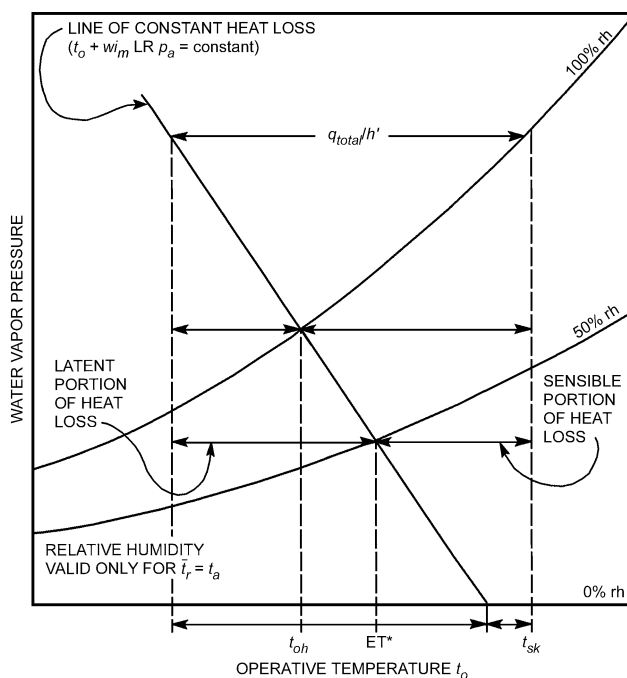


Fig. 2 Constant Skin Heat Loss Line and Its Relationship to t_{oh} and ET^*

The psychrometric chart in Figure 2 shows a constant total heat loss line and the relationship between these indices. This line represents only one specific skin wettedness and permeation efficiency index. The relationship between indices depends on these two parameters (see the section on Environmental Indices).

ENGINEERING DATA AND MEASUREMENTS

Applying the preceding basic equations to practical problems of the thermal environment requires quantitative estimates of the body's surface area, metabolic requirements for a given activity and the mechanical efficiency for the work accomplished, evaluation of the heat transfer coefficients h_r and h_c , and the general nature of the clothing insulation used. This section provides the necessary data and describes methods used to measure the parameters of the heat balance equation.

Metabolic Rate and Mechanical Efficiency

Maximum Capacity. In choosing optimal conditions for comfort and health, the rate of work done during routine physical activities must be known, because metabolic power increases in proportion to exercise intensity. Metabolic rate varies over a wide range, depending on the activity, the person, and the conditions under which the activity is performed. Table 4 lists typical metabolic rates for an average adult ($A_D = 1.8 \text{ m}^2$) for activities performed continuously. The highest power a person can maintain for any continuous period is approximately 50% of the maximal capacity to use oxygen (maximum energy capacity).

A unit used to express the metabolic rate per unit DuBois area is the **met**, defined as the metabolic rate of a sedentary person (seated, quiet): $1 \text{ met} = 58.1 \text{ W/m}^2 = 50 \text{ kcal/(h} \cdot \text{m}^2)$. A normal, healthy man has a maximum capacity of approximately $M_{act} = 12 \text{ met}$ at age 20, which drops to 7 met at age 70. Maximum rates for women are about 30% lower. Long-distance runners and trained athletes have maximum rates as high as 20 met. An average 35 year old who does not exercise has a maximum rate of about 10 met, and activities with $M_{act} > 5 \text{ met}$ are likely to prove exhausting.

Intermittent Activity. The activity of many people consists of a mixture of activities or a combination of work-rest periods. A weighted average metabolic rate is generally satisfactory, provided that activities alternate frequently (several times per hour). For example, a person typing 50% of the time, filing while seated 25% of the time, and walking about 25% of the time would have an average metabolic rate of $0.50 \times 65 + 0.25 \times 70 + 0.25 \times 100 = 75 \text{ W/m}^2$ (see Table 4).

Accuracy. Estimating metabolic rates is difficult. The values given in Table 4 indicate metabolic rates only for the specific activities listed. Some entries give a range and some a single value, depending on the source of the data. The level of accuracy depends on the value of M_{act} and how well the activity can be defined. For well-defined activities with $M_{act} < 1.5 \text{ met}$ (e.g., reading), Table 4 is sufficiently accurate for most engineering purposes. For values of $M_{act} > 3$, where a task is poorly defined or where there are a variety of ways of performing a task (e.g., heavy machine work), the values may be in error by as much as $\pm 50\%$ for a given application. Engineering calculations should thus allow for potential variations.

Measurement. When metabolic rates must be determined more accurately than is possible with tabulated data, physiological measurements with human subjects may be necessary. The rate of metabolic heat produced by the body is most accurately measured by the rate of respiratory oxygen consumption and carbon dioxide production. An empirical equation for metabolic rate is given by Nishi (1981):

Table 4 Typical Metabolic Heat Generation for Various Activities

	W/m ²	met ^a
Resting		
Sleeping	40	0.7
Reclining	45	0.8
Seated, quiet	60	1.0
Standing, relaxed	70	1.2
Walking (on level surface)		
3.2 km/h (0.9 m/s)	115	2.0
4.3 km/h (1.2 m/s)	150	2.6
6.4 km/h (1.8 m/s)	220	3.8
Office Activities		
Reading, seated	55	1.0
Writing	60	1.0
Typing	65	1.1
Filing, seated	70	1.2
Filing, standing	80	1.4
Walking about	100	1.7
Lifting/packing	120	2.1
Driving/Flying		
Car	60 to 115	1.0 to 2.0
Aircraft, routine	70	1.2
Aircraft, instrument landing	105	1.8
Aircraft, combat	140	2.4
Heavy vehicle	185	3.2
Miscellaneous Occupational Activities		
Cooking	95 to 115	1.6 to 2.0
Housecleaning	115 to 200	2.0 to 3.4
Seated, heavy limb movement	130	2.2
Machine work		
sawing (table saw)	105	1.8
light (electrical industry)	115 to 140	2.0 to 2.4
heavy	235	4.0
Handling 50 kg bags	235	4.0
Pick and shovel work	235 to 280	4.0 to 4.8
Miscellaneous Leisure Activities		
Dancing, social	140 to 255	2.4 to 4.4
Calisthenics/exercise	175 to 235	3.0 to 4.0
Tennis, singles	210 to 270	3.6 to 4.0
Basketball	290 to 440	5.0 to 7.6
Wrestling, competitive	410 to 505	7.0 to 8.7

Sources: Compiled from various sources. For additional information, see Buskirk (1960), Passmore and Durnin (1967), and Webb (1964).

^a1 met = 58.1 W/m²

$$M = \frac{21(0.23RQ + 0.77)Q_{O_2}}{A_D} \quad (34)$$

where

M = metabolic rate, W/m²

RQ = respiratory quotient; molar ratio of Q_{CO_2} exhaled to Q_{O_2} inhaled, dimensionless

Q_{O_2} = volumetric rate of oxygen consumption at conditions (STPD) of 0°C, 101.325 kPa, mL/s

The exact value of the respiratory quotient RQ used in Equation (34) depends on a person's activity, diet, and physical condition. It can be determined by measuring both carbon dioxide and oxygen in the respiratory airflows, or it can be estimated with reasonable accuracy. A good estimate for the average adult is $RQ = 0.83$ for light or sedentary activities ($M < 1.5$ met), increasing proportionately to $RQ = 1.0$ for extremely heavy exertion ($M = 5.0$ met). Estimation of RQ is generally sufficient for all except precision

Table 5 Heart Rate and Oxygen Consumption at Different Activity Levels

Level of Exertion	Heart Rate, bpm	Oxygen Consumed, mL/s
Light work	< 90	< 8
Moderate work	90 to 110	8 to 16
Heavy work	110 to 130	16 to 24
Very heavy work	130 to 150	24 to 32
Extremely heavy work	150 to 170	> 32

Source: Astrand and Rodahl (1977).

laboratory measurements since it does not strongly affect the value of the metabolic rate. A 10% error in estimating the respiratory quotient results in an error of less than 3% in the metabolic rate.

A second, much less accurate, method of estimating metabolic rate physiologically is to measure the heart rate. Table 5 shows the relationship between heart rate and oxygen consumption at different levels of physical exertion for a typical person. Once oxygen consumption is estimated from heart rate information, Equation (34) can be used to estimate the metabolic rate. A number of factors other than metabolic rate affect heart rate, such as physical condition, heat, emotional factors, muscles used, etc. Astrand and Rodahl (1977) show that heart rate is only a very approximate measure of metabolic rate and should not be the only source of information where accuracy is required.

Mechanical Efficiency. In the heat balance equation, the rate W of work accomplished must be in the same units as metabolism M and expressed in terms of A_D in W/m². The mechanical work done by the muscles for a given task is often expressed in terms of the body's mechanical efficiency $\mu = W/M$. It is unusual for μ to be more than 0.05 to 0.10; for most activities, it is close to zero. The maximum value under optimal conditions (e.g., bicycle ergometer) is $\mu = 0.20$ to 0.24 (Nishi 1981). It is common to assume that mechanical work is zero for several reasons: (1) the mechanical work produced is small compared to metabolic rate, especially for office activities; (2) estimates for metabolic rates can often be inaccurate; and (3) this assumption results in a more conservative estimate when designing air-conditioning equipment for upper comfort and health limits. More accurate calculation of heat generation may require estimation of the mechanical work produced for activities where it is significant (walking on a grade, climbing a ladder, bicycling, lifting, etc.). In some cases, it is possible to either estimate or measure the mechanical work. For example, a 90 kg person walking up a 5% grade at 1.0 m/s would be lifting an 882 N (90 kg $\times$ 9.8 N/kg) weight over a height of 0.05 m every second, for a work rate of 44 N·m/s = 44 W. This rate of mechanical work would then be subtracted from M to determine the net heat generated.

Heat Transfer Coefficients

Values for the linearized radiative heat transfer coefficient, convective heat transfer coefficient, and evaporative heat transfer coefficient are required to solve the equations describing heat transfer from the body.

Radiative Heat Transfer Coefficient. The linearized radiative heat transfer coefficient can be calculated by

$$h_r = 4\epsilon\sigma \frac{A_r}{A_D} \left[273.2 + \frac{t_{cl} + \bar{t}_r}{2} \right]^3 \quad (35)$$

where

h_r = radiative heat transfer coefficient, W/(m²·K)

ϵ = average emissivity of clothing or body surface, dimensionless

σ = Stefan-Boltzmann constant, 5.67×10^{-8} W/(m²·K⁴)

A_r = effective radiation area of body, m²

The ratio A_r/A_D is 0.70 for a sitting person and 0.73 for a standing person (Fanger 1967). Emissivity ε is close to unity (typically 0.95), unless special reflective materials are used or high-temperature sources are involved. It is not always possible to solve Equation (35) explicitly for h_r , since t_{cl} may also be an unknown. Some form of iteration may be necessary if a precise solution is required. Fortunately, h_r is nearly constant for typical indoor temperatures, and a value of $4.7 \text{ W}/(\text{m}^2 \cdot \text{K})$ suffices for most calculations. If the emissivity is significantly less than unity, the value should be adjusted by

$$h_r = 4.7\varepsilon \quad (36)$$

where ε represents the area-weighted average emissivity for the clothing/body surface.

Convective Heat Transfer Coefficient. Heat transfer by convection is usually caused by air movement within the living space or by body movements. Equations for estimating h_c under various conditions are presented in Table 6. Where two conditions apply (e.g., walking in moving air), a reasonable estimate can be obtained by taking the larger of the two values for h_c . Limits have been given to all equations. If no limits were given in the source, reasonable limits have been estimated. Care should be exercised in using these values for seated and reclining persons. The heat transfer coefficients may be accurate, but the effective heat transfer area may be substantially reduced due to body contact with a padded chair or bed.

Quantitative values of h_c are important, not only in estimating convection loss, but in evaluating (1) operative temperature t_o , (2) clothing parameters I_t and i_m , and (3) rational effective temperatures t_{oh} and ET^* . All heat transfer coefficients in Table 6 were evaluated at or near 101.33 kPa. These coefficients should be corrected as follows for atmospheric pressure:

$$h_{cc} = h_c(p_t/101.33)^{0.55} \quad (37)$$

where

h_{cc} = corrected convective heat transfer coefficient, $\text{W}/(\text{m}^2 \cdot \text{K})$
 p_t = local atmospheric pressure, kPa

The combined coefficient h is the sum of h_r and h_c , described in Equation (35) and Table 6, respectively. The coefficient h governs exchange by radiation and convection from the exposed body surface to the surrounding environment.

Table 6 Equations for Convection Heat Transfer Coefficients

Equation	Limits	Condition	Remarks/Sources
$h_c = 8.3V^{0.6}$	$0.2 < V < 4.0$	Seated with moving air	Mitchell (1974)
$h_c = 3.1$	$0 < V < 0.2$		
$h_c = 2.7 + 8.7V^{0.67}$	$0.15 < V < 1.5$	Reclining with moving air	Colin and Houdas (1967)
$h_c = 5.1$	$0 < V < 0.15$		
$h_c = 8.6V^{0.53}$	$0.5 < V < 2.0$	Walking in still air	V is walking speed (Nishi and Gagge 1970)
$h_c = 5.7(M - 0.8)^{0.39}$	$1.1 < M < 3.0$	Active in still air	Gagge et al. (1976)
$h_c = 6.5V^{0.39}$	$0.5 < V < 2.0$	Walking on treadmill in still air	V is treadmill speed (Nishi and Gagge 1970)
$h_c = 14.8V^{0.69}$	$0.15 < V < 1.5$	Standing person in moving air	Developed from data presented by Seppanen et al. (1972)
$h_c = 4.0$	$0 < V < 0.15$		

Note: h_c in $\text{W}/(\text{m}^2 \cdot \text{K})$, V in m/s, and M in mets, where 1 met = $58.1 \text{ W}/\text{m}^2$.

Evaporative Heat Transfer Coefficient. The evaporative heat transfer coefficient h_e for the outer air layer of a nude or clothed person can be estimated from the convective heat transfer coefficient using the Lewis relation given in Equation (27). If the atmospheric pressure is significantly different from the reference value (101.33 kPa), the correction to the value obtained from Equation (27) is

$$h_{ec} = h_e(101.33/p_t)^{0.45} \quad (38)$$

where h_{ec} is the corrected evaporative heat transfer coefficient in $\text{W}/(\text{m}^2 \cdot \text{kPa})$.

Clothing Insulation and Permeation Efficiency

Thermal Insulation. The most accurate methods for determining clothing insulation are (1) measurements on heated mannequins (McCullough and Jones 1984, Olesen and Nielsen 1983) and (2) measurements on active subjects (Nishi et al. 1975). For most routine engineering work, estimates based on tables and equations presented in this section are sufficient. Thermal mannequins can measure the sensible heat loss from the “skin” ($C + R$) in a given environment. Equation (11) can then be used to evaluate R_{cl} if the environmental conditions are well defined and f_{cl} is measured. Evaluation of clothing insulation on subjects requires measurement of t_{sk} , t_{cl} , and t_o . The clothing thermal efficiency is calculated by

$$F_{cl} = \frac{t_{cl} - t_o}{t_{sk} - t_o} \quad (39)$$

The intrinsic clothing insulation can then be calculated from mannequin measurements by the following relationship, provided f_{cl} is measured and conditions are sufficiently well defined to make an accurate determination of h :

$$R_{cl} = \frac{t_{sk} - t_o}{q} - \frac{1}{hf_{cl}} \quad (40)$$

where q is heat loss from the mannequin in W/m^2 .

Clothing insulation value may be expressed in clo units. In order to avoid confusion, the symbol I is used with the clo unit instead of the symbol R . The relationship between the two is

$$R = 0.155I \quad (41)$$

or 1.0 clo is equivalent to $0.155 \text{ m}^2 \cdot \text{K}/\text{W}$.

Because clothing insulation cannot be measured for most routine engineering applications, tables of measured values for various clothing ensembles can be used to select an ensemble comparable to the one(s) in question. Table 7 gives values for typical indoor clothing ensembles. More detailed tables are presented by McCullough and Jones (1984) and Olesen and Nielsen (1983). Accuracies for I_{cl} on the order of $\pm 20\%$ are typical if good matches between ensembles are found.

Often it is not possible to find an already measured clothing ensemble that matches the one in question. In this case, the ensemble insulation can be estimated from the insulation of individual garments. Table 8 gives a list of individual garments commonly worn. The insulation of an ensemble is estimated from the individual values using a summation formula (McCullough and Jones 1984):

$$I_{cl} = 0.835 \sum_i I_{clu,i} + 0.161 \quad (42)$$

where $I_{clu,i}$ is the effective insulation of garment i , and I_{cl} , as before, is the insulation for the entire ensemble. A simpler and nearly as accurate summation formula is (Olesen 1985)

Table 7 Typical Insulation and Permeation Efficiency Values for Clothing Ensembles

Ensemble Description ^a	I_{cl} (clo)	I_t^b (clo)	f_{cl}	i_{cl}	i_m^b
Walking shorts, short-sleeved shirt	0.36	1.02	1.10	0.34	0.42
Trousers, short-sleeved shirt	0.57	1.20	1.15	0.36	0.43
Trousers, long-sleeved shirt	0.61	1.21	1.20	0.41	0.45
Same as above, plus suit jacket	0.96	1.54	1.23		
Same as above, plus vest and T-shirt	1.14	1.69	1.32	0.32	0.37
Trousers, long-sleeved shirt, long-sleeved sweater, T-shirt	1.01	1.56	1.28		
Same as above, plus suit jacket and long underwear bottoms	1.30	1.83	1.33		
Sweat pants, sweat shirt	0.74	1.35	1.19	0.41	0.45
Long-sleeved pajama top, long pajama trousers, short 3/4 sleeved robe, slippers (no socks)	0.96	1.50	1.32	0.37	0.41
Knee-length skirt, short-sleeved shirt, panty hose, sandals	0.54	1.10	1.26		
Knee-length skirt, long-sleeved shirt, full slip, panty hose	0.67	1.22	1.29		
Knee-length skirt, long-sleeved shirt, half slip, panty hose, long-sleeved sweater	1.10	1.59	1.46		
Same as above, replace sweater with suit jacket	1.04	1.60	1.30	0.35	0.40
Ankle-length skirt, long-sleeved shirt, suit jacket, panty hose	1.10	1.59	1.46		
Long-sleeved coveralls, T-shirt	0.72	1.30	1.23		
Overalls, long-sleeved shirt, T-shirt	0.89	1.46	1.27	0.35	0.40
Insulated coveralls, long-sleeved thermal underwear, long underwear bottoms	1.37	1.94	1.26	0.35	0.39

Source: From McCullough and Jones (1984) and McCullough et al. (1989).

^aAll ensembles include shoes and briefs or panties. All ensembles except those with panty hose include socks unless otherwise noted.

^bFor $i_a = t_a$ and air velocity less than 0.2 m/s ($I_a = 0.72$ clo and $i_m = 0.48$ when nude).
1 clo = 0.155 m²·K/W.

$$I_{cl} = \sum_i I_{clu,i} \quad (43)$$

Either Equation (42) or (43) gives acceptable accuracy for typical indoor clothing. The main source of inaccuracy is in determining the appropriate values for individual garments. Overall accuracies are on the order of $\pm 25\%$ if the tables are used carefully. If it is important to include a specific garment that is not included in Table 8, its insulation can be estimated by (McCullough and Jones 1984)

$$I_{clu,i} = (0.534 + 0.135x_f)(A_G/A_D) - 0.0549 \quad (44)$$

where

x_f = fabric thickness, mm

A_G = body surface area covered by garment, m²

Values in Table 7 may be adjusted by information in Table 8 and a summation formula. Using this method, values of $I_{clu,i}$ for the selected items in Table 8 are then added to or subtracted from the ensemble value of I_{cl} in Table 7.

When a person is sitting, the chair generally has the effect of increasing clothing insulation by up to 0.15 clo, depending on the contact area A_{ch} between the chair and body (McCullough et al. 1994). A string webbed or beach chair has little or no contact area, and the insulation actually decreases by about 0.1 clo due likely to compression of the clothing in the contact area. In contrast, a cushioned executive chair has a large contact area that can increase the intrinsic clothing insulation by 0.15 clo. For other chairs, the increase in intrinsic insulation (ΔI_{cl}) can be estimated from

$$\Delta I_{cl} = 0.748A_{ch} - 0.1 \quad (45)$$

where A_{ch} is in m².

For example, a desk chair with a body contact area of 0.27 m² has a ΔI_{cl} of 0.1 clo. This amount should be added to the intrinsic insulation of the standing clothing ensemble to obtain the insulation of the ensemble when sitting in the desk chair.

Although sitting has the effect of increasing clothing insulation, walking decreases it (McCullough and Hong 1994). The change in

Table 8 Garment Insulation Values

Garment Description ^a	$I_{clu,i}$ clo ^b	Garment Description ^a	$I_{clu,i}$ clo ^b	Garment Description ^a	$I_{clu,i}$ clo ^b
Underwear		Long-sleeved, flannel shirt	0.34	Long-sleeved (thin)	0.25
Men's briefs	0.04	Short-sleeved, knit sport shirt	0.17	Long-sleeved (thick)	0.36
Panties	0.03	Long-sleeved, sweat shirt	0.34	Dresses and skirts^c	
Bra	0.01	Trousers and Coveralls	0.06	Skirt (thin)	0.14
T-shirt	0.08	Short shorts	0.08	Skirt (thick)	0.23
Full slip	0.16	Walking shorts	0.15	Long-sleeved shirtdress (thin)	0.33
Half slip	0.14	Straight trousers (thin)	0.24	Long-sleeved shirtdress (thick)	0.47
Long underwear top	0.20	Straight trousers (thick)	0.28	Short-sleeved shirtdress (thin)	0.29
Long underwear bottoms	0.15	Sweatpants	0.30	Sleeveless, scoop neck (thin)	0.23
Footwear		Overalls	0.49	Sleeveless, scoop neck (thick), i.e., jumper	0.27
Ankle-length athletic socks	0.02	Coveralls		Sleepwear and Robes	
Calf-length socks	0.03	Suit jackets and vests (lined)		Sleeveless, short gown (thin)	0.18
Knee socks (thick)	0.06	Single-breasted (thin)	0.36	Sleeveless, long gown (thin)	0.20
Panty hose	0.02	Single-breasted (thick)	0.44	Short-sleeved hospital gown	0.31
Sandals/thongs	0.02	Double-breasted (thin)	0.42	Long-sleeved, long gown (thick)	0.46
Slippers (quilted, pile-lined)	0.03	Double-breasted (thick)	0.48	Long-sleeved pajamas (thick)	0.57
Boots	0.10	Sleeveless vest (thin)	0.10	Short-sleeved pajamas (thin)	0.42
Shirts and Blouses		Sleeveless vest (thick)	0.17	Long-sleeved, long wrap robe (thick)	0.69
Sleeveless, scoop-neck blouse	0.12	Sweaters		Long-sleeved, short wrap robe (thick)	0.48
Short-sleeved, dress shirt	0.19	Sleeveless vest (thin)	0.13	Short-sleeved, short robe (thin)	0.34
Long-sleeved, dress shirt	0.25	Sleeveless vest (thick)	0.22		

^a"Thin" garments are made of light, thin fabrics worn in summer; "thick" garments are made of heavy, thick fabrics worn in winter.

^b1 clo = 0.155 m²·K/W

^cKnee-length

clothing insulation (ΔI_{cl}) can be estimated from the standing intrinsic insulation of the ensemble (I_{cl}) and the walking speed (Walkspeed) in steps per minute:

$$\Delta I_{cl} = -0.504 I_{cl} - 0.00281 (\text{Walkspeed}) + 0.24 \quad (46)$$

For example, the clothing insulation of a person wearing a winter business suit with a standing intrinsic insulation of 1 clo would decrease by 0.52 clo when the person walks at 90 steps per minute (about 3.7 km/h). Thus, when the person is walking, the intrinsic insulation of the ensemble would be 0.48 clo.

Permeation Efficiency. Permeation efficiency data for some clothing ensembles are presented in terms of i_{cl} and i_m in Table 7. The values of i_m can be used to calculate $R_{e,t}$ using the relationships in Table 2. Ensembles worn indoors generally fall in the range $0.3 < i_m < 0.5$, and assuming $i_m = 0.4$ is reasonably accurate (McCullough et al. 1989). This latter value may be used if a good match to ensembles in Table 7 cannot be made. The value of i_m or $R_{e,t}$ may be substituted directly into equations for body heat loss calculations (see Table 3). However, i_m for a given clothing ensemble is a function of the environment as well as the clothing properties. Unless i_m is evaluated at conditions very similar to the intended application, it is more rigorous to use i_{cl} to describe the permeation efficiency of the clothing. The value of i_{cl} is not as sensitive to environmental conditions; thus, given data are more accurate over a wider range of air velocity and radiant and air temperature combinations for i_{cl} than for i_m . The relationships in Table 2 can be used to determine $R_{e,cl}$ from i_{cl} , and i_{cl} or $R_{e,cl}$ can then be used for body heat loss calculations (see Table 3). McCullough et al. (1989) found an average value of $i_{cl} = 0.34$ for common indoor clothing; this value can be used when other data are not available.

Measurements of i_m or i_{cl} may be necessary if unusual clothing (e.g., impermeable or metallized) and/or extreme environments (e.g., high radiant temperatures or high air velocities) are to be addressed. There are three different methods for measuring the permeation efficiency of clothing: the first uses a wet mannequin to measure the effect of sweat evaporation on heat loss (McCullough 1986); the second uses permeation efficiency measurements on component fabrics as well as dry mannequin measurements (Umbach 1980); and the third uses measurements from sweating subjects (Nishi et al. 1975; Holmer 1984).

Clothing Surface Area. Many clothing heat transfer calculations require that clothing area factor f_{cl} be known. The most reliable approach is to measure it using photographic methods (Olesen et al. 1982). Other than actual measurements, the best method is to use previously tabulated data for similar clothing ensembles. Table 7 is adequate for most indoor clothing ensembles. No good method of estimating f_{cl} for a clothing ensemble from other information is available, although a rough estimate can be made by (McCullough and Jones 1984)

$$f_{cl} = 1.0 + 0.3 I_{cl} \quad (47)$$

Total Evaporative Heat Loss

The total evaporative heat loss (latent heat) from the body due to both respiratory losses and skin losses, $E_{sk} + E_{res}$, can be measured directly from the body's rate of mass loss as observed by a sensitive scale:

$$E_{sk} + E_{res} = \frac{h_{fg}}{A_D} \frac{dm}{d\theta} \quad (48)$$

where

h_{fg} = latent heat of vaporization of water, J/kg
 m = body mass, kg
 θ = time, s

When using Equation (48), adjustments should be made for any materials consumed (e.g., food and drink), body effluents (e.g., wastes), and metabolic mass losses. Metabolism contributes slightly to mass loss primarily because the oxygen absorbed during respiration is converted to heavier CO_2 and exhaled. It can be calculated by

$$\frac{dm_{ge}}{d\theta} = Q_{O_2} (1.977 RQ - 1.429) / 10^6 \quad (49)$$

where

$dm_{ge}/d\theta$ = rate of mass loss due to respiratory gas exchange, kg/s
 Q_{O_2} = oxygen uptake at STPD, mL/s
 RQ = respiratory quotient
 1.977 = density of CO_2 at STPD, kg/m³
 1.429 = density of O_2 at STPD, kg/m³
 $STPD$ = standard temperature and pressure of dry air at 0°C and 101.325 kPa

Environmental Parameters

The parameters describing the thermal environment that must be measured or otherwise quantified if accurate estimates of human thermal response are to be made are divided into two groups—those that can be measured directly and those that are calculated from other measurements.

Directly Measured. Seven of the parameters frequently used to describe the thermal environment are psychrometric and include (1) air temperature t_a ; (2) wet-bulb temperature t_{wb} ; (3) dew-point temperature t_{dp} ; (4) water vapor pressure p_a ; (5) total atmospheric pressure p_t ; (6) relative humidity (rh); and (7) humidity ratio W_a . These parameters are discussed in detail in Chapter 6, and methods for measuring them are discussed in Chapter 14. Two other important parameters include air velocity V and mean radiant temperature $\bar{t}_r$. Air velocity measurements are also discussed in Chapter 14. The radiant temperature is the temperature of an exposed surface in the environment. The temperatures of individual surfaces are usually combined into a mean radiant temperature $\bar{t}_r$. Finally, globe temperature t_g , which can also be measured directly, is a good approximation of the operative temperature t_o and is also used with other measurements to calculate the mean radiant temperature.

Calculated Parameters. The mean radiant temperature $\bar{t}_r$ is a key variable in making thermal calculations for the human body. It is the uniform temperature of an imaginary enclosure in which radiant heat transfer from the human body equals the radiant heat transfer in the actual nonuniform enclosure. Measurements of the globe temperature, air temperature, and air velocity can be combined to estimate the mean radiant temperature (see Chapter 14). The accuracy of the mean radiant temperature determined this way varies considerably depending on the type of environment and the accuracy of the individual measurements. Since the mean radiant temperature is defined with respect to the human body, the shape of the sensor is also a factor. The spherical shape of the globe thermometer gives a reasonable approximation of a seated person; an ellipsoid-shaped sensor gives a better approximation of the shape of a human, both upright and seated.

The mean radiant temperature can also be calculated from measured values of the temperature of the surrounding walls and surfaces and their positions with respect to the person. As most building materials have a high emittance ϵ , all the surfaces in the room can be assumed to be black. The following equation is then used:

$$\bar{T}_r^4 = T_1^4 F_{p-1} + T_2^4 F_{p-2} + \dots + T_N^4 F_{p-N} \quad (50)$$

where

$\bar{T}_r$ = mean radiant temperature, K
 T_N = surface temperature of surface N , K
 F_{p-N} = angle factor between a person and surface N

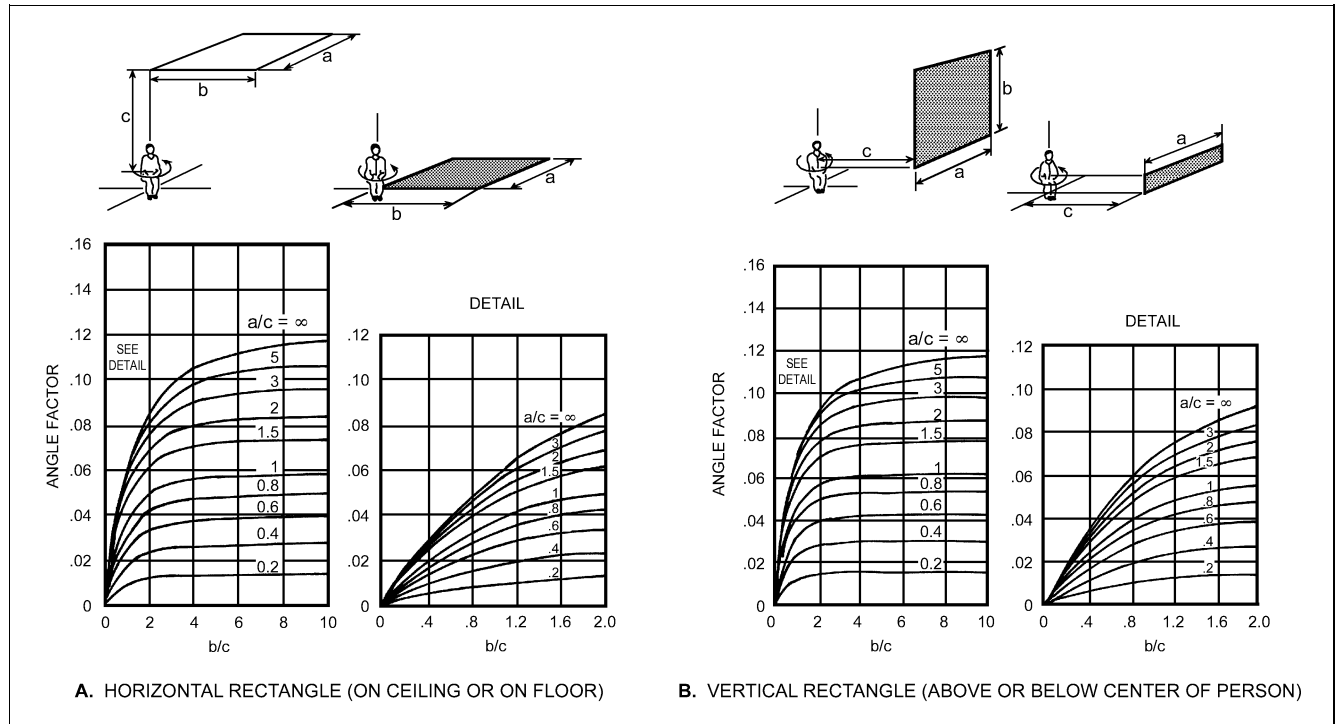


Fig. 3 Mean Value of Angle Factor Between Seated Person and Horizontal or Vertical Rectangle when Person is Rotated Around Vertical Axis
(Fanger 1982)

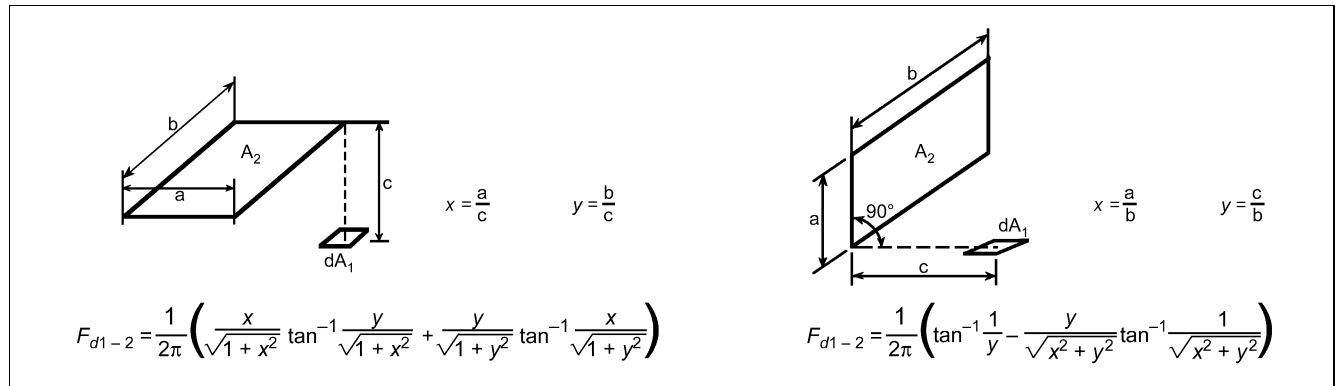


Fig. 4 Analytical Formulas for Calculating Angle Factor for Small Plane Element

Because the sum of the angle factors is unity, the fourth power of mean radiant temperature equals the mean value of the surrounding surface temperatures to the fourth power, weighted by the respective angle factors. In general, angle factors are difficult to determine, although Figures 3A and 3B may be used to estimate them for rectangular surfaces. The angle factor normally depends on the position and orientation of the person (Fanger 1982).

If relatively small temperature differences exist between the surfaces of the enclosure, Equation (50) can be simplified to a linear form:

$$\bar{t}_r = t_1 F_{p-1} + t_2 F_{p-2} + \dots + t_N F_{p-N} \quad (51)$$

Equation (51) always gives a slightly lower mean radiant temperature than Equation (50), but in many cases the difference is small. If, for example, half the surroundings ($F_{p-N} = 0.5$) has a temperature 5 K higher than the other half, the difference between the

calculated mean radiant temperatures—according to Equations (50) and (51)—is only 0.2 K. If, however, this difference is 100 K, the mean radiant temperature calculated by Equation (51) is 10 K too low.

The mean radiant temperature may also be calculated from the plane radiant temperature t_{pr} (defined below) in six directions (up, down, right, left, front, back) and for the projected area factors of a person in the same six directions. For a standing person, the mean radiant temperature may be estimated as

$$\begin{aligned} \bar{t}_r = & \{0.08[t_{pr}(\text{up}) + t_{pr}(\text{down})] + 0.23[t_{pr}(\text{right}) \\ & + t_{pr}(\text{left})] + 0.35[t_{pr}(\text{front}) + t_{pr}(\text{back})]\} \\ & \div [2(0.08 + 0.23 + 0.35)] \end{aligned} \quad (52)$$

For a seated person, the mean radiant temperature may be estimated as

$$\begin{aligned} \bar{t}_r = & \{0.18[t_{pr}(\text{up}) + t_{pr}(\text{down})] + 0.22[t_{pr}(\text{right}) \\ & + t_{pr}(\text{left})] + 0.30[t_{pr}(\text{front}) + t_{pr}(\text{back})]\} \\ & \div [2(0.18 + 0.22 + 0.30)] \end{aligned} \quad (53)$$

The **plane radiant temperature** t_{pr} , first introduced by Korsgaard (1949), is the uniform temperature of an enclosure in which the incident radiant flux on one side of a small plane element is the same as that in the actual environment. The plane radiant temperature describes the thermal radiation in one direction, and its value thus depends on the direction. In comparison, the mean radiant temperature $\bar{t}_r$ describes the thermal radiation for the human body from all directions. The plane radiant temperature can be calculated using Equations (50) and (51) with the same limitations. Area factors are determined from Figure 4.

The **radiant temperature asymmetry** Δt_{pr} is the difference between the plane radiant temperature of the opposite sides of a small plane element. This parameter describes the asymmetry of the radiant environment and is especially important in comfort conditions. Because it is defined with respect to a plane element, its value depends on the orientation of that plane. This orientation may be specified in some situations (e.g., floor to ceiling asymmetry) and not in others. If direction is not specified, the radiant asymmetry should be for the orientation that gives the maximum value.

CONDITIONS FOR THERMAL COMFORT

In addition to the previously discussed independent environmental and personal variables influencing thermal response and comfort, other factors may also have some effect. These factors, such as nonuniformity of the environment, visual stimuli, age, and outdoor climate are generally considered secondary factors. Studies by Rohles and Nevins (1971) and Rohles (1973) on 1600 college-age students revealed correlations between comfort level, temperature, humidity, sex, and length of exposure. Many of these correlations are given in Table 9. The thermal sensation scale developed for these studies is called the **ASHRAE thermal sensation scale**:

- +3 hot
- +2 warm
- +1 slightly warm
- 0 neutral
- 1 slightly cool
- 2 cool
- 3 cold

The equations in Table 9 indicate that the women of this study were more sensitive to temperature and less sensitive to humidity than the

Table 9 Equations for Predicting Thermal Sensation (Y) of Men, Women, and Men and Women Combined

Exposure Period, h	Subjects	Regression Equations ^{a, b}	
		t = dry-bulb temperature, °C	p = vapor pressure, kPa
1.0	Men	$Y = 0.220 t + 0.233 p - 5.673$	
	Women	$Y = 0.272 t + 0.248 p - 7.245$	
	Both	$Y = 0.245 t + 0.248 p - 6.475$	
2.0	Men	$Y = 0.221 t + 0.270 p - 6.024$	
	Women	$Y = 0.283 t + 0.210 p - 7.694$	
	Both	$Y = 0.252 t + 0.240 p - 6.859$	
3.0	Men	$Y = 0.212 t + 0.293 p - 5.949$	
	Women	$Y = 0.275 t + 0.255 p - 8.622$	
	Both	$Y = 0.243 t + 0.278 p - 6.802$	

^aY values refer to the ASHRAE thermal sensation scale.

^bFor young adult subjects with sedentary activity and wearing clothing with a thermal resistance of approximately 0.5 clo, $\bar{t}_r \approx t_a$ and air velocities < 0.2 m/s.

men. But in general about a 3 K change in temperature or a 3 kPa change in water vapor pressure is necessary to change a thermal sensation vote by one unit or temperature category.

Current and past studies are periodically reviewed to update *ASHRAE Standard 55*, Thermal Environmental Conditions for Human Occupancy. This standard specifies conditions or comfort zones where 80% of sedentary or slightly active persons find the environment thermally acceptable.

Because people typically change their clothing for the seasonal weather, *ASHRAE Standard 55* specifies summer and winter comfort zones appropriate for clothing insulation levels of 0.5 and 0.9 clo (0.078 and 0.14 m²·K/W), respectively (Figure 5) (Addendum 55a to *ASHRAE Standard 55*). The warmer and cooler temperature borders of the comfort zones are affected by humidity and coincide with lines of constant ET*. In the middle region of a zone, a typical person wearing the prescribed clothing would have a thermal sensation at or very near neutral. Near the boundary of the warmer zone, a person would feel about +0.5 warmer on the ASHRAE thermal sensation scale; near the boundary of the cooler zone, that person may have a thermal sensation of -0.5.

Comfort zones for other clothing levels can be approximated by decreasing the temperature borders of the zone by 0.6 K for each 0.1 clo increase in clothing insulation and vice versa. Similarly a zone's temperatures can be decreased by 1.4 K per met increase in activity above 1.2 met.

The upper and lower humidity levels of the comfort zones are less precise. Low humidity can lead to drying of the skin and mucous surfaces. Comfort complaints about dry nose, throat, eyes, and skin occur in low-humidity conditions, typically when the dew point is less than 0°C. Liviana et al. (1988) found eye discomfort increased with time in low-humidity environments (dew point < 2°C). Green (1982) quantified that respiratory illness and absenteeism increase in winter with decreasing humidity and found that any increase in humidity from very low levels decreased absenteeism in winter. In compliance with these and other discomfort observations, *ASHRAE Standard 55* recommends that the dew-point temperature of occupied spaces not be less than 2°C.

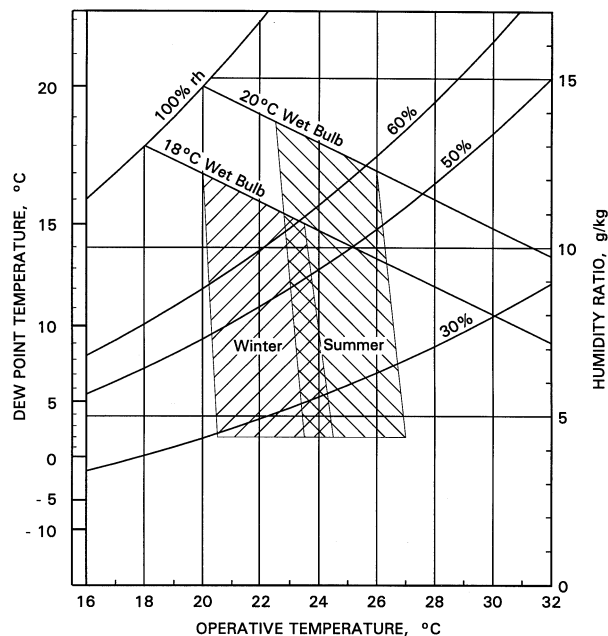


Fig. 5 ASHRAE Summer and Winter Comfort Zones

(Acceptable ranges of operative temperature and humidity for people in typical summer and winter clothing during primarily sedentary activity.)

At high humidity levels, too much skin moisture tends to increase discomfort (Gagge 1937, Berglund and Cunningham 1986), particularly skin moisture that is physiological in origin (water diffusion and perspiration). At high humidity levels, thermal sensation alone is not a reliable predictor of thermal comfort (Tanabe et al. 1987). The discomfort appears to be due to the feeling of the moisture itself, increased friction between skin and clothing with skin moisture (Gwosdow et al. 1986), and other factors. To prevent warm discomfort, Nevins et al. (1975) recommended that on the warm side of the comfort zone the relative humidity not exceed 60%.

The upper humidity limits of ASHRAE *Standard 55* were developed theoretically from limited data. However, thermal acceptability data gathered at medium and high humidity levels at summer comfort temperatures with subjects wearing 0.55 clo corroborated the shape of the upper limit and found it corresponded to an 80% thermal acceptability level (Berglund 1995).

THERMAL NONUNIFORM CONDITIONS AND LOCAL DISCOMFORT

A person may feel thermally neutral as a whole but still feel uncomfortable if one or more parts of the body are too warm or too cold. Nonuniformities may be due to a cold window, a hot surface, a draft, or a temporal variation of these. Even small variations in heat flow cause the thermal regulatory system to compensate, thus increasing the physiological effort of maintaining body temperatures. The boundaries of the comfort zones (Figure 5) of ASHRAE *Standard 55* provide a thermal acceptability level of 90% if the environment is thermally uniform. Because the standard's objective is to specify conditions for 80% acceptability, the standard permits nonuniformities to decrease acceptability by 10%. Fortunately for the designer and user, the effect of common thermal nonuniformities on comfort is quantifiable and predictable as discussed in the following sections. Furthermore, most humans are fairly insensitive to small nonuniformities.

Asymmetric Thermal Radiation

Asymmetric or nonuniform thermal radiation in a space may be caused by cold windows, uninsulated walls, cold products, cold or warm machinery, or improperly sized heating panels on the wall or ceiling. In residential buildings, offices, restaurants, etc., the most common reasons for discomfort due to asymmetric thermal radiation are large windows in the winter or improperly sized or installed

ceiling heating panels. At industrial workplaces, the reasons include cold or warm products, cold or warm equipment, etc.

The recommendations in ISO *Standard 7730* and ASHRAE *Standard 55* are based primarily on studies reported by Fanger et al. (1980). These standards include guidelines regarding the radiant temperature asymmetry from an overhead warm surface (heated ceiling) and a vertical cold surface (cold window). Among the studies conducted on the influence of asymmetric thermal radiation are those by McIntyre (1974, 1976), McIntyre and Griffiths (1975), Fanger and Langkilde (1975), McNall and Biddison (1970), and Olesen et al. (1972). These studies all used seated subjects. In these studies, the subjects were always in thermal neutrality and exposed only to the discomfort resulting from excessive asymmetry.

The subjects gave their reactions on their comfort sensation, and a relationship between the radiant temperature asymmetry and the number of subjects feeling dissatisfied was established (Figure 6). Radiant asymmetry, as defined in the section on Environmental Parameters, is the difference in radiant temperature of the environment on opposite sides of the person. More precisely, radiant asymmetry is the difference in radiant temperatures seen by a small flat element looking in opposite directions.

Figure 6 shows that people are more sensitive to asymmetry caused by an overhead warm surface than by a vertical cold surface. The influence of an overhead cold surface and a vertical warm surface is much less. These data are particularly important when applying radiant panels to provide comfort in spaces with large cold surfaces or cold windows.

Other studies of clothed persons in neutral environments found thermal acceptability unaffected by radiant temperature asymmetries of 10 K or less (Berglund and Fobelets 1987) and comfort unaffected by radiant temperature asymmetries of 20 K or less (McIntyre 1975).

Draft

Draft is an undesired local cooling of the human body caused by air movement. This is a serious problem, not only in many ventilated buildings but also in automobiles, trains, and aircraft. Draft has been identified as one of the most annoying factors in offices. When people sense draft, they often demand higher air temperatures in the room or that ventilation systems be stopped.

Fanger and Christensen (1986) aimed to establish the percentage of the population feeling draft when exposed to a given mean velocity. Figure 7 shows the percentage of subjects who felt draft on the head region (the dissatisfied) as a function of the mean air velocity at the neck. The head region comprises head, neck, shoulders, and back. The air temperature had a significant influence on the percentage of dissatisfied. There was no significant difference between responses of men and women to draft. The data in Figure 7 apply only to persons wearing normal indoor clothing and performing light, mainly sedentary work. Persons with higher activity levels are not as sensitive to draft (Jones et al. 1986).

A study of the effect of air velocity over the whole body found thermal acceptability unaffected in neutral environments by air speeds of 0.25 m/s or less (Berglund and Fobelets 1987). This study also found no interaction between air speed and radiant temperature asymmetry on subjective responses. This means that acceptability changes and the percent dissatisfied due to draft and radiant asymmetry are independent and additive.

Fanger et al. (1989) investigated the effect of turbulence intensity on sensation of draft. The turbulence intensity had a significant effect on the occurrence of draft sensation. The following model predicts the percentage of people dissatisfied because of draft intensity. The model can be used for quantifying draft risk in spaces and for developing air distribution systems with a low draft risk.

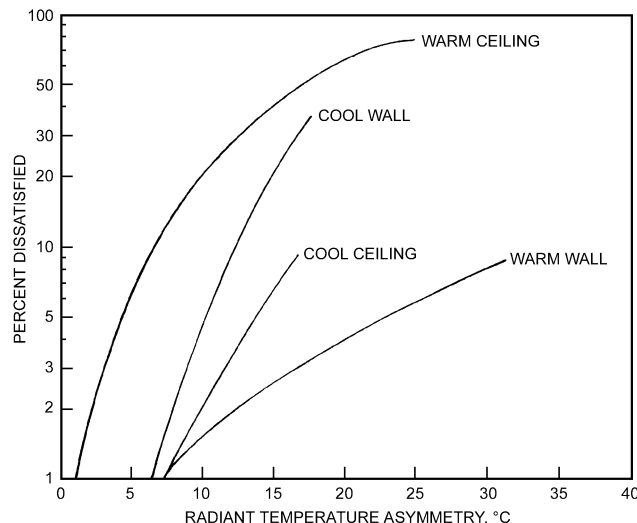


Fig. 6 Percentage of People Expressing Discomfort due to Asymmetric Radiation

$$PD = (34 - t_a)(V - 0.05)^{0.62}(0.37Vt_u + 3.14) \quad (54)$$

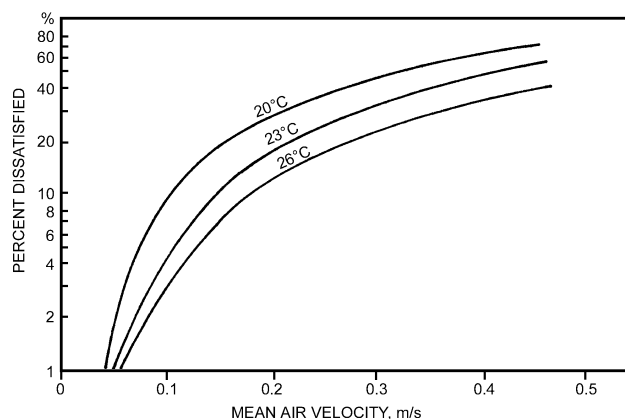


Fig. 7 Percentage of People Dissatisfied as Function of Mean Air Velocity

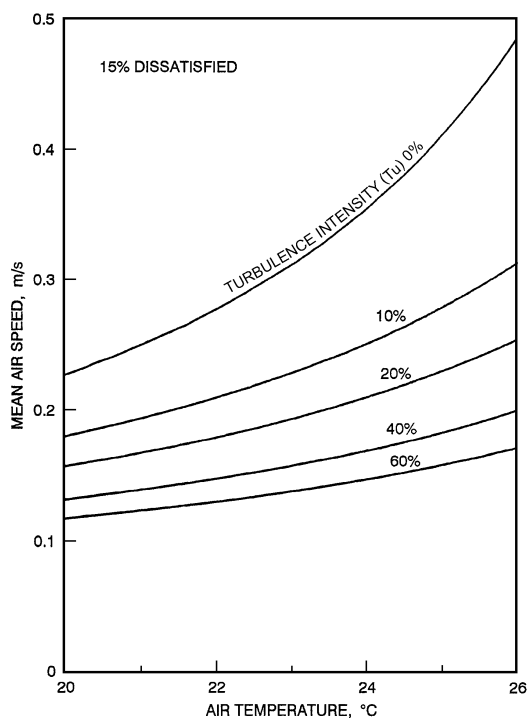


Fig. 8 Draft Conditions Dissatisfying 15% of Population

where Tu is the turbulence intensity in % defined by

$$Tu = 100 \frac{V_{sd}}{V} \quad (55)$$

For $V < 0.05$ m/s, insert $V = 0.05$; and for $PD > 100\%$, insert $PD = 100\%$. V_{sd} is the standard deviation of the velocity measured with an omnidirectional anemometer having a 0.2 s time constant.

The model extends the Fanger and Christensen (1986) draft chart model to include turbulence intensity. In this study, Tu decreases when V increases. This means that the effect of V for the experimental data to which the model is fitted are: $20 < t_a < 26^\circ\text{C}$, $0.05 < V < 0.5$ m/s, and $0 < Tu < 70\%$. Figure 8 gives more precisely the curves that result from intersections between planes of constant Tu and the surfaces of $PD = 15\%$.

Vertical Air Temperature Difference

In most spaces in buildings, the air temperature normally increases with height above the floor. If the gradient is sufficiently

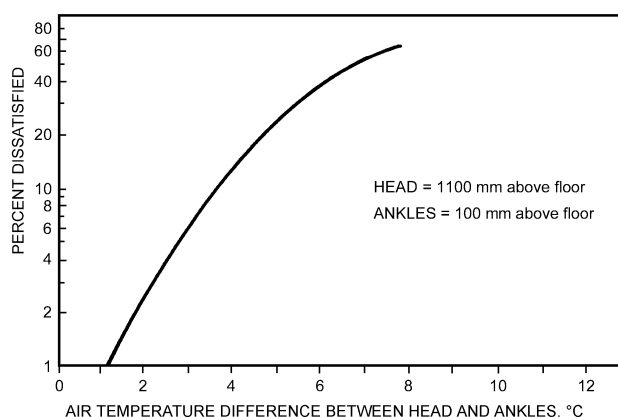


Fig. 9 Percentage of Seated People Dissatisfied as Function of Air Temperature Difference Between Head and Ankles

large, local warm discomfort can occur at the head and/or cold discomfort can occur at the feet, although the body as a whole is thermally neutral. Among the few studies of vertical air temperature differences and the influence of thermal comfort reported are Olesen et al. (1979), McNair (1973), McNair and Fishman (1974), and Eriksson (1975). Subjects were seated in a climatic chamber so they were individually exposed to different air temperature differences between head and ankles (Olesen et al. 1979). During the tests, the subjects were in thermal neutrality because they were allowed to change the temperature level in the test room whenever they desired; the vertical temperature difference, however, was kept unchanged. The subjects gave subjective reactions to their thermal sensation; Figure 9 shows the percentage of dissatisfied as a function of the vertical air temperature difference between head (1.1 m above the floor) and ankles (0.1 m above the floor).

The case where the air temperature at head level is lower than that at ankle level will not be as critical for the occupants. Eriksson (1975) indicated that his subjects could tolerate much greater differences if the head were cooler. This observation is verified in the experiments with asymmetric thermal radiation from a cooled ceiling (Fanger et al. 1985).

Warm or Cold Floors

Due to the direct contact between the feet and the floor, local discomfort of the feet can often be caused by a too-high or too-low floor temperature. Also, the floor temperature has a significant influence on the mean radiant temperature in a room. The floor temperature is greatly influenced by the way a building is constructed (e.g., insulation of the floor, above a basement, directly on the ground, above another room, use of floor heating, floors in radiant heated areas). If a floor is too cold and the occupants feel cold discomfort in their feet, a common reaction is to increase the temperature level in the room; in the heating season, this also increases energy consumption. A radiant system, which radiates heat from the floor, can also prevent discomfort from cold floors.

The most extensive studies of the influence of floor temperature on feet comfort were performed by Olesen (1977a, 1977b), who, based on his own experiments and reanalysis of the data from Nevins and Flinner (1958), Nevins et al. (1964), and Nevins and Feyerherm (1967), recorded the following results. For floors occupied by people with bare feet (in swimming halls, gymnasiums, dressing rooms, bathrooms, and bedrooms), flooring material is important. Ranges for some typical floor materials are as follows

Textiles (rugs)	21 to 28°C
Pine floor	22.5 to 28°C
Oak floor	24.5 to 28°C

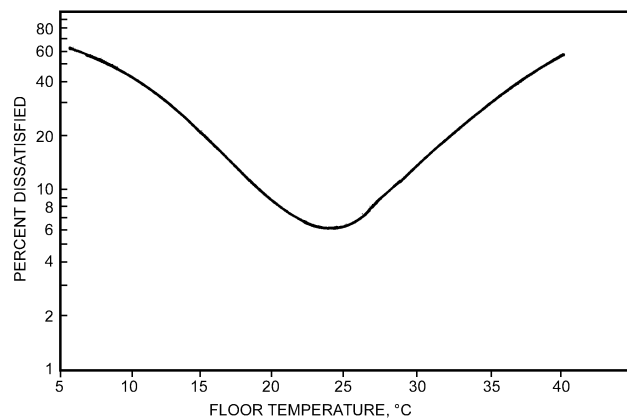


Fig. 10 Percentage of People Dissatisfied as Function of Floor Temperature

To save energy, flooring materials with a low contact coefficient (cork, wood, carpets), radiant heated floors, or floor heating systems can be used to eliminate the desire for higher ambient temperatures caused by cold feet. These recommendations should also be followed in schools, where children often play directly on the floor.

For floors occupied by people with normal indoor footwear, flooring material is insignificant. Olesen (1977b) found an optimal temperature of 25°C for sedentary and 23°C for standing or walking persons. At the optimal temperature, 6% of the occupants felt warm or cold discomfort in the feet. Figure 10 shows the relationship between floor temperature and percentage of dissatisfied, combining data from experiments with seated and standing subjects. In all experiments, the subjects were in thermal neutrality; thus, the percentage of dissatisfied is only related to the discomfort due to cold or warm feet. No significant difference in floor temperature was preferred by females and males.

SECONDARY FACTORS AFFECTING COMFORT

Temperature, air speed, humidity, their variation, and personal parameters of metabolism and clothing insulation are primary factors that directly affect energy flow and thermal comfort. However, many secondary factors, some of which are discussed in this section, may more subtly influence comfort.

Day-to-Day Variations

Fanger (1973) conducted an experiment with a group of subjects, where the preferred ambient temperature for each subject under identical conditions was determined on four different days. Since the standard deviation was only 0.6 K, Fanger concluded that the comfort conditions for the individual can be reproduced and will vary only slightly from day to day.

Age

Because metabolism decreases slightly with age, many have stated that comfort conditions based on experiments with young and healthy subjects cannot be used for other age groups. Fanger (1982), Fanger and Langkilde (1975), Langkilde (1979), Nevins et al. (1966), and Rohles and Johnson (1972) conducted comfort studies in Denmark and the United States on different age groups (mean age 21 to 84). The studies revealed that the thermal environments preferred by older people do not differ from those preferred by younger people. The lower metabolism in older people is compensated for by

a lower evaporative loss. Collins and Hoinville (1980) confirmed these results.

The fact that young and old people prefer the same thermal environment does not necessarily mean that they are equally sensitive to cold or heat. In practice, the ambient temperature level in the homes of older people is often higher than that for younger people. This may be explained by the lower activity level of elderly people, who are normally sedentary for a greater part of the day.

Adaptation

Many believe that people can acclimatize themselves by exposure to hot or cold surroundings, so that they prefer other thermal environments. Fanger (1982) conducted experiments involving subjects from the United States, Denmark, and tropical countries. The latter group was tested in Copenhagen immediately after their arrival by plane from the tropics where they had lived all their lives. Other experiments were conducted for two groups exposed to cold daily. One group comprised subjects who had been doing sedentary work in cold surroundings (in the meat-packing industry) for 8 h daily for at least 1 year. The other group consisted of winter swimmers who bathed in the sea daily.

Only slight differences in both the preferred ambient temperature and the physiological parameters in the comfort conditions were reported for the various groups. These results indicate that people cannot adapt to preferring warmer or colder environments. It is therefore likely that the same comfort conditions can be applied throughout the world. However, in determining the preferred ambient temperature from the comfort equations, a clo-value that corresponds to the local clothing habits should be used. A comparison of field comfort studies from different parts of the world shows significant differences in clothing habits depending on, among other things, the outdoor climate (Nicol and Humphreys 1972). According to these results, adaptation has little influence on the preferred ambient temperature. In uncomfortable warm or cold environments, however, adaptation will often have an influence. People used to working and living in warm climates can more easily accept and maintain a higher work performance in hot environments than people from colder climates.

Sex

Previously cited experiments by Fanger (1982), Fanger and Langkilde (1975), and Nevins et al. (1966) used equal numbers of male and female subjects, so comfort conditions for the two sexes can be compared. The experiments show that men and women prefer almost the same thermal environments. Women's skin temperature and evaporative loss are slightly lower than those for men, and this balances the somewhat lower metabolism of women. The reason that women often prefer higher ambient temperatures than men may be partly explained by the lighter clothing normally worn by women.

Seasonal and Circadian Rhythms

Since people cannot adapt to prefer warmer or colder environments, it follows that there is no difference between comfort conditions in winter and in summer. McNall et al. (1968) confirmed this in an investigation where results of winter and summer experiments showed no difference. On the other hand, it is reasonable to expect the comfort conditions to alter during the day because the internal body temperature has a daily rhythm—a maximum occurring late in the afternoon, and a minimum early in the morning.

In determining the preferred ambient temperature for each of 16 subjects both in the morning and in the evening, Fanger et al. (1974) and Ostberg and McNicholl (1973) observed no difference. Furthermore, Fanger et al. (1973) found only small fluctuations in the preferred ambient temperature during a simulated 8 h workday (sedentary work). There is a slight tendency to prefer somewhat

warmer surroundings before lunch, but none of the fluctuations are significant.

PREDICTION OF THERMAL COMFORT

Thermal comfort and thermal sensation can be predicted several ways. One way is to use [Figure 5](#) and [Table 9](#) and adjust for clothing and activity levels that differ from those of the figure. More numerical and rigorous predictions are possible by using the PMV-PPD and two-node models described in this section.

Steady-State Energy Balance

Fanger (1982) related the comfort data to physiological variables. At a given level of metabolic activity M , and when the body is not far from thermal neutrality, the mean skin temperature t_{sk} and sweat rate E_{rsW} are the only physiological parameters influencing the heat balance. However, heat balance alone is not sufficient to establish thermal comfort. In the wide range of environmental conditions where heat balance can be obtained, only a narrow range provides thermal comfort. The following linear regression equations based on data from Rohles and Nevins (1971) indicate values of t_{sk} and E_{rsW} that provide thermal comfort.

$$t_{sk,req} = 35.7 - 0.0275(M - W) \quad (56)$$

$$E_{rsW,req} = 0.42(M - W - 58.15) \quad (57)$$

At higher activity levels, sweat loss increases and the mean skin temperature decreases. Both reactions increase the heat loss from the body core to the environment. These two empirical relationships link the physiological and heat flow equations and thermal comfort perceptions. By substituting these values into Equation (11) for $C + R$, and into Equations (17) and (18) for E_{sk} , Equation (1), the energy balance equation, can be used to determine combinations of the six environmental and personal parameters that optimize comfort for steady-state conditions.

Fanger (1982) reduced these relationships to a single equation, which assumed all sweat generated is evaporated, eliminating clothing permeation efficiency i_{cl} as a factor in the equation. This assumption is valid for normal indoor clothing worn in typical indoor environments with low or moderate activity levels. At higher activity levels ($M_{act} > 3$ met), where a significant amount of sweating occurs even at optimum comfort conditions, this assumption may limit accuracy. The reduced equation is slightly different from the heat transfer equations developed here. The radiant heat exchange is expressed in terms of the Stefan-Boltzmann law (instead of using h_r), and diffusion of water vapor through the skin is expressed as a diffusivity coefficient and a linear approximation for saturated vapor pressure evaluated at t_{sk} . The combination of environmental and personal variables that produces a neutral sensation may be expressed as follows:

$$\begin{aligned} M - W = & 3.96 \times 10^{-8} f_{cl} [(t_{cl} + 273)^4 - (\bar{t}_r + 273)^4] \\ & + f_{cl} h_c (t_{cl} - t_a) \\ & + 3.05 [5.73 - 0.007(M - W) - p_a] \\ & + 0.42 [(M - W) - 58.15] \\ & + 0.0173 M (5.87 - p_a) \\ & + 0.0014 M (34 - t_a) \end{aligned} \quad (58)$$

where

$$\begin{aligned} t_{cl} = & 35.7 - 0.0275(M - W) \\ & - R_{cl} \{ (M - W) \\ & - 3.05 [5.73 - 0.007(M - W) - p_a] \\ & - 0.42 [(M - W) - 58.15] - 0.0173 M (5.87 - p_a) \\ & - 0.0014 M (34 - t_a) \} \end{aligned} \quad (59)$$

The values of h_c and f_{cl} can be estimated from tables and equations given in the section on Engineering Data and Measurements. Fanger used the following relationships:

$$h_c = \begin{cases} 2.38(t_{cl} - t_a)^{0.25} & 2.38(t_{cl} - t_a)^{0.25} > 12.1\sqrt{V} \\ 12.1\sqrt{V} & 2.38(t_{cl} - t_a)^{0.25} < 12.1\sqrt{V} \end{cases} \quad (60)$$

$$f_{cl} = \begin{cases} 1.0 + 0.2 I_{cl} & I_{cl} < 0.5 \text{ clo} \\ 1.05 + 0.1 I_{cl} & I_{cl} > 0.5 \text{ clo} \end{cases} \quad (61)$$

[Figures 11](#) and [12](#) show examples of how Equation (58) can be used.

Equation (58) is expanded to include a range of thermal sensations by using a **predicted mean vote (PMV) index**. The PMV index predicts the mean response of a large group of people according to the ASHRAE thermal sensation scale. Fanger (1970) related PMV to the imbalance between the actual heat flow from the body in a given environment and the heat flow required for optimum comfort at the specified activity by the following equation:

$$PMV = [0.303 \exp(-0.036M) + 0.028]L \quad (62)$$

where L is the thermal load on the body, defined as the difference between internal heat production and heat loss to the actual environment for a person hypothetically kept at comfort values of t_{sk} and E_{rsW} at the actual activity level. Thermal load L is then the difference between the left and right sides of Equation (58) calculated for the actual values of the environmental conditions. As part of this calculation, the clothing temperature t_{cl} is found by iteration as

$$\begin{aligned} t_{cl} = & 35.7 - 0.028(M - W) \\ & - R_{cl} \{ 39.6 \times 10^{-9} f_{cl} [(t_{cl} + 273)^4 - (\bar{t}_r + 273)^4] \\ & + f_{cl} h_c (t_{cl} - t_a) \} \end{aligned} \quad (63)$$

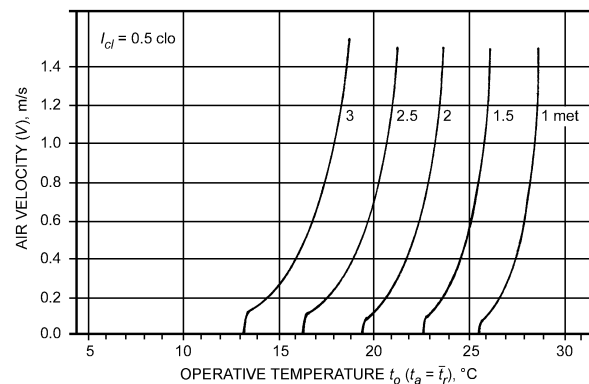


Fig. 11 Air Velocities and Operative Temperatures at 50% rh Necessary for Comfort (PMV = 0) of Persons in Summer Clothing at Various Levels of Activity

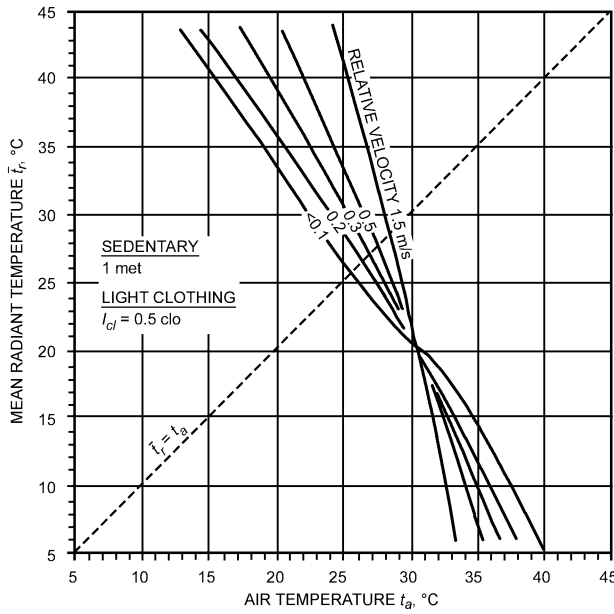


Fig. 12 Air Temperatures and Mean Radiant Temperatures Necessary for Comfort (PMV = 0) of Sedentary Persons in Summer Clothing at 50% rh

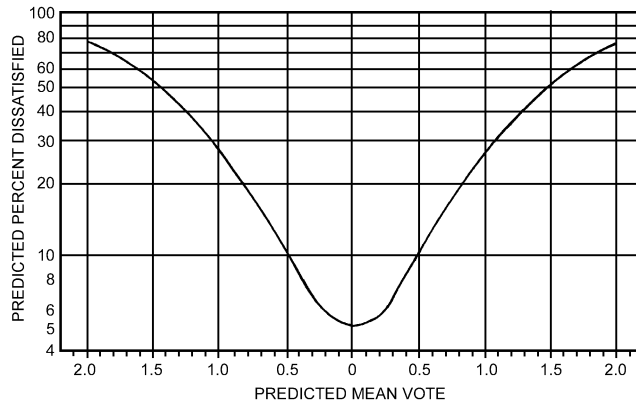


Fig. 13 Predicted Percentage of Dissatisfied (PPD) as Function of Predicted Mean Vote (PMV)

After estimating the PMV with Equation (62) or another method, the **predicted percent dissatisfied** (PPD) with a condition can also be estimated. Fanger (1982) related the PPD to the PMV as follows:

$$PPD = 100 - 95 \exp[-(0.03353 PMV^4 + 0.2179 PMV^2)] \quad (64)$$

where dissatisfied is defined as anybody not voting -1, +1, or 0. This relationship is shown in Figure 13. A PPD of 10% corresponds to the PMV range of ± 0.5 , and even with PMV = 0, about 5% of the people are dissatisfied.

The **PMV-PPD model** is widely used and accepted for design and field assessment of comfort conditions. ISO Standard 7730 includes a short computer listing that facilitates computing PMV and PPD for a wide range of parameters.

Two-Node Model

The PMV model is useful only for predicting steady-state comfort responses. The two-node model can be used to predict physiological responses or responses to transient situations, at least for low

and moderate activity levels in cool to very hot environments (Gagge et al. 1971, 1986). The two-node model is a simplification of more complex thermoregulatory models developed by Stolwijk and Hardy (1966). The simple, lumped parameter model considers a human as two concentric thermal compartments that represent the skin and the core of the body.

The **skin compartment** simulates the epidermis and dermis and is about 1.6 mm thick. Its mass, which is about 10% of the total body, depends on the amount of blood flowing through it for thermoregulation. The temperature in a compartment is assumed to be uniform so that the only temperature gradients are between compartments. In a cold environment, blood flow to the extremities may be reduced to conserve the heat of vital organs, resulting in axial temperature gradients in the arms, legs, hands, and feet. Heavy exercise with certain muscle groups or asymmetric environmental conditions may also cause nonuniform compartment temperatures and limit the accuracy of the model.

All the heat is assumed to be generated in the **core compartment**. In the cold, shivering and muscle tension may generate additional metabolic heat. This increase is related to skin and core temperature depressions from their set point values, or

$$M_{shiv} = 19.4(34 - t_{sk})(37 - t_{cr}) \quad (65)$$

where the temperature terms are set to zero if they become negative.

The core loses energy when the muscles do work on the surroundings. Heat is also lost from the core through respiration. The rate of respiratory heat loss is due to sensible and latent changes in the respired air and the ventilation rate as in Equations (19) and (20).

In addition, heat is conducted passively from the core to the skin. This is modeled as a massless thermal conductor [$K = 5.28 \text{ W/(m}^2 \cdot \text{K)}$]. A controllable heat loss path from the core consists of pumping variable amounts of warm blood to the skin for cooling. This peripheral blood flow Q_{bl} in $\text{L/h} \cdot \text{m}^2$ depends on skin and core temperature deviations from their respective set points:

$$Q_{bl} = \frac{BFN + c_{dil}(t_{cr} - 37)}{1 + S_{tr}(34 - t_{sk})} \quad (66)$$

The temperature terms can only be > 0 . If the deviation is negative, the term is set to zero. For average persons, the coefficients BFN, c_{dil} , and S_{tr} are 6.3, 175 and 0.5. Further, skin blood flow Q_{bl} is limited to a maximum of $90 \text{ L/(h} \cdot \text{m}^2)$.

Dry (sensible) heat loss q_{dry} from the skin flows through the clothing by conduction and then by parallel paths to the air and surrounding surfaces. Evaporative heat follows a similar path, flowing through the clothing and through the air boundary layer. Maximum evaporation E_{max} occurs if the skin is completely covered with sweat. The actual evaporation rate E_{sw} depends on the size w of the sweat film:

$$E_{sw} = w E_{max} \quad (67)$$

where w is E_{rsw}/E_{max} .

The rate of regulatory sweating E_{rsw} (rate at which water is brought to the surface of the skin in W/m^2) can be predicted by skin and core temperature deviations from their set points:

$$E_{rsw} = c_{sw}(t_b - t_{bset}) \exp[-(t_{sk} - 34)/10.7] \quad (68)$$

where $t_b = (1 - \alpha_{sk})t_{cr} + \alpha_{sk}t_{sk}$ and is the mean body temperature, and $c_{sw} = 170 \text{ W/(m}^2 \cdot \text{K)}$. The temperature deviation terms are set to zero when negative. α_{sk} is the fraction of the total body mass that is considered to be thermally in the skin compartment.

$$\alpha_{sk} = 0.0418 + \frac{0.745}{10.8Q_{bl} - 0.585} \quad (69)$$

Regulatory sweating Q_{rsww} in the model is limited to $1 \text{ L/h} \cdot \text{m}^2$ or 670 W/m^2 . E_{rsww} evaporates from the skin, but if E_{rsww} is greater than E_{max} , the excess drips off.

An energy balance on the core yields

$$M + M_{shiv} = W + q_{res} + (K + \text{SKBF}c_{p,bl})(t_{cr} - t_{sk}) + m_{cr}c_{cr}\frac{dt_{cr}}{d\theta} \quad (70)$$

and for the skin,

$$(K + \text{SKBF}c_{p,bl})(t_{cr} - t_{sk}) = q_{dry} + q_{evap} + m_{sk}c_{sk}\frac{dt_{sk}}{d\theta} \quad (71)$$

where c_{cr} , c_{sk} , and $c_{p,bl}$ are specific heats of core, skin, and blood [3500, 3500, and $4190 \text{ J/(kg} \cdot \text{K)}$], respectively], and SKBF is $\rho_{bl}Q_{bl}$, where ρ_{bl} is density of blood (12.9 kg/L).

Equations (70) and (71) can be rearranged in terms of $dt_{sk}/d\theta$ and $dt_{cr}/d\theta$ and numerically integrated with small time steps (10 to 60 s) from initial conditions or previous values to find t_{cr} and t_{sk} at any time.

After calculating values of t_{sk} , t_{cr} , and w , the model uses empirical expressions to predict thermal sensation (TSENS) and thermal discomfort (DISC). These indices are based on 11-point numerical scales, where positive values represent the warm side of neutral sensation or comfort, and negative values represent the cool side. TSENS is based on the same scale as PMV, but with extra terms for ± 4 (very hot/cold) and ± 5 (intolerably hot/cold). Recognizing the same positive/negative convention for warm/cold discomfort, DISC is defined as

- 5 intolerable
- 4 limited tolerance
- 3 very uncomfortable
- 2 uncomfortable and unpleasant
- 1 slightly uncomfortable but acceptable
- 0 comfortable

TSENS is defined in terms of deviations of mean body temperature t_b from cold and hot set points representing the lower and upper limits for the zone of evaporative regulation: $t_{b,c}$ and $t_{b,h}$, respectively. The values of these set points depend on the net rate of internal heat production and are calculated by

$$t_{b,c} = \frac{0.194}{58.15}(M - W) + 36.301 \quad (72)$$

$$t_{b,h} = \frac{0.347}{58.15}(M - W) + 36.669 \quad (73)$$

TSENS is then determined by

$$\text{TSENS} = \begin{cases} 0.4685(t_b - t_{b,c}) & t_b < t_{b,c} \\ 4.7\eta_{ev}(t_b - t_{b,c})/(t_{b,h} - t_{b,c}) & t_{b,c} \leq t_b \leq t_{b,h} \\ 4.7\eta_{ev} + 0.4685(t_b - t_{b,h}) & t_{b,h} < t_b \end{cases} \quad (74)$$

where η_{ev} is the evaporative efficiency (assumed to be 0.85).

DISC is numerically equal to TSENS when t_b is below its cold set point $t_{b,c}$ and it is related to skin wettedness when body temperature is regulated by sweating:

$$\text{DISC} = \begin{cases} 0.4685(t_b - t_{b,c}) & t_b < t_{b,c} \\ \frac{4.7(E_{rsww} - E_{rsww,req})}{E_{max} - E_{rsww,req} - E_{dif}} & t_{b,c} \leq t_b \end{cases} \quad (75)$$

where $E_{rsww,req}$ is calculated as in Fanger's model, using Equation (57).

Adaptive Models

Adaptive models do not actually predict comfort responses but rather the almost constant conditions under which people are likely to be comfortable in buildings. In general, people naturally adapt and may also make various adjustments to themselves and their surroundings to reduce discomfort and physiological strain. It has been observed that, through adaptive actions, an acceptable degree of comfort in residences and offices is possible over a range of air temperatures from about 17 to 31°C (Humphreys and Nicol 1998).

The adaptive adjustments are typically conscious behavioral actions such as altering clothing, posture, activity schedules, activity levels, rate of working, diet, ventilation, air movement, and local temperature. The adaptations may also include unconscious longer term changes to physiological set points and gains for the control of shivering, skin blood flow, and sweating, as well as adjustments to body fluid levels and salt loss. However, only limited documentation and information on such changes is available.

An important driving force behind the adaptive process is the pattern of outside weather conditions and the exposure to them. This is the principal input to the adaptive models that have evolved to date, and these models predict likely comfort temperatures t_c or ranges of t_c from monthly mean outdoor temperatures t_{out} . Such a model (Humphreys and Nicol 1998), based on data from a wide range of buildings, climates, and cultures is

$$t_c = 24.2 + 0.43(t_{out} - 22)\exp\left(-\frac{(t_{out} - 22)^2}{24\sqrt{2}}\right) \quad (76)$$

The adaptive models are useful to guide design and energy decisions. They may also be useful to specify building temperatures set points throughout the year. A recent ASHRAE-sponsored study on adaptive models compiled an extensive database from past field studies to study, develop, and test adaptive models. For climates and buildings where cooling and central heating are not required, the study suggests the following model (de Dear and Brager 1998):

$$t_{oc} = 18.9 + 0.255t_{out} \quad (77)$$

where t_{oc} is the operative comfort temperature.

In general, the value of using an adaptive model to specify set points or guide temperature control strategies is likely to increase with the freedom that occupants are given to adapt (e.g., by having flexible working hours, locations, or dress codes).

Zones of Comfort and Discomfort

The section on Two-Node Model shows that comfort and thermal sensation are not necessarily the same variable, especially for a person in the zone of evaporative thermal regulation. Figures 14 and 15 show this difference for the standard combination of met-clo-air movement used in the standard effective temperature. Figure 14 demonstrates that practically all basic physiological variables predicted by the two-node model are functions of ambient temperature and are relatively independent of vapor pressure. All exceptions occur at relative humidities above 80% and as the isotherms reach the $ET^* = 41.5^\circ\text{C}$ line, where regulation by evaporation fails. Figure 15 shows that lines of constant ET^* and wettedness are functions of both ambient temperature and vapor

pressure. Thus, human thermal responses are divided into two classes—those in Figure 14, which respond only to heat stress from the environment, and those in Figure 15, which respond to both the heat stress from the environment and the resultant heat strain (Stolwijk et al. 1968).

For warm environments, any index with isotherms parallel to skin temperature is a reliable index of thermal sensation alone, and not of discomfort caused by increased humidity. Indices with isotherms parallel to ET^* are reliable indicators of discomfort or dissatisfaction with thermal environments. For a fixed exposure time to cold, lines of constant t_{sk} , ET^* , and t_o are essentially identical, and cold sensation is no different from cold discomfort. For a state of comfort with sedentary or light activity, lines of constant t_{sk} and ET^* coincide. Thus comfort and thermal sensations coincide in this region as well. The upper and lower temperature limits for comfort at these levels can be specified either by thermal sensation (Fanger 1982) or by ET^* , as is done in ASHRAE Standard 55, since lines of constant comfort and lines of constant thermal sensation should be identical.

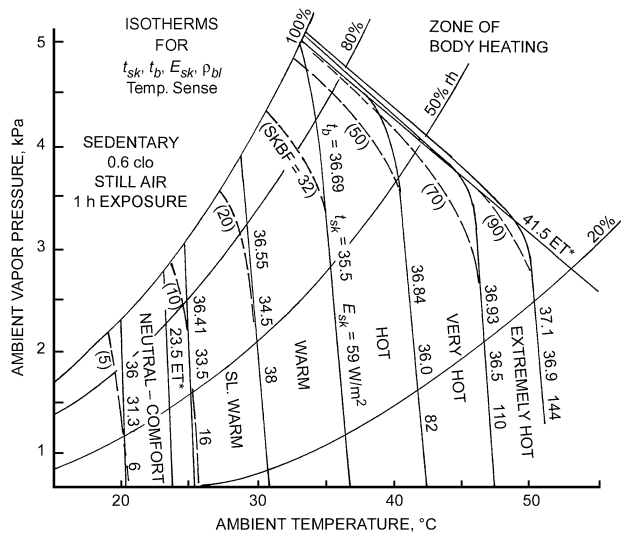


Fig. 14 Effect of Environmental Conditions on Physiological Variables

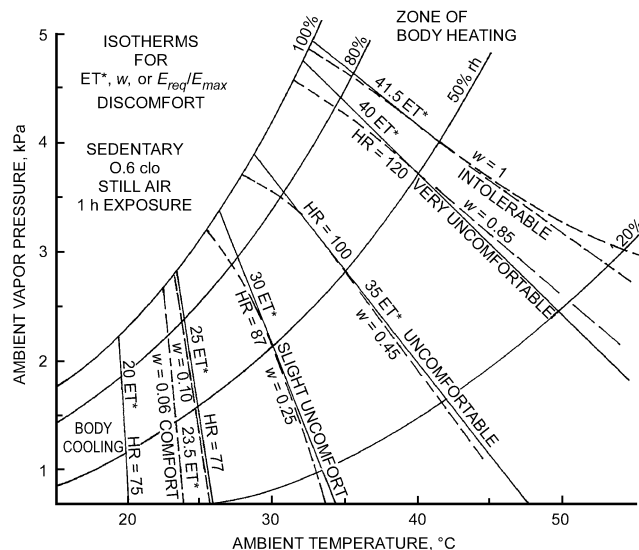


Fig. 15 Effect of Thermal Environment on Discomfort

ENVIRONMENTAL INDICES

An environmental index combines two or more parameters (e.g., air temperature, mean radiant temperature, humidity, or air velocity) into a single variable. Indices simplify the description of the thermal environment and the stress imposed by an environment. Environmental indices may be classified according to how they are developed. Rational indices are based on the theoretical concepts presented earlier. Empirical indices are based on measurements with subjects or on simplified relationships that do not necessarily follow theory. Indices may also be classified according to their application, generally either heat stress or cold stress.

Effective Temperature

The **effective temperature** ET^* is probably the most common environmental index, and it has the widest range of application. It combines temperature and humidity into a single index, so two environments with the same ET^* should evoke the same thermal response even though they have different temperatures and humidities; but they must have the same air velocities.

The original empirical effective temperature was developed by Houghten and Yaglou (1923). Gagge et al. (1971) defined a new effective temperature using a rational approach. Defined mathematically in Equation (33), this is the temperature of an environment at 50% rh that results in the same total heat loss E_{sk} from the skin as in the actual environment.

Because the index is defined in terms of operative temperature t_o , it combines the effects of three parameters (t_r , t_a , and p_a) into a single index. Skin wettedness w and the permeability index i_m must be specified and are constant for a given ET^* line for a particular situation. The two-node model is used to determine skin wettedness in the zone of evaporative regulation. At the upper limit of regulation, w approaches 1.0; at the lower limit, w approaches 0.06. Skin wettedness equals one of these values when the body is outside the zone of evaporative regulation. Since the slope of a constant ET^* line depends on skin wettedness and clothing moisture permeability, effective temperature for a given temperature and humidity may depend on the clothing and activity of the person. This difference is shown in Figure 16. At low skin wettedness, the air humidity has little influence, and lines of constant ET^* are nearly vertical. As skin wettedness increases due to activity and/or heat stress, the lines become more horizontal and the influence of humidity is much more pronounced. The ASHRAE comfort envelope shown in Figure 5 is described in terms of ET^* .

Since ET^* depends on clothing and activity, it is not possible to generate a universal ET^* chart. Calculation of ET^* can also be tedious, requiring the solution of multiple coupled equations to determine skin wettedness. A standard set of conditions representative of typical indoor applications is used to define a **standard effective temperature** SET^* . The standard effective temperature is then defined as the equivalent air temperature of an isothermal environment at 50% rh in which a subject, while wearing clothing standardized for the activity concerned, has the same heat stress (skin temperature t_{sk}) and thermoregulatory strain (skin wettedness w) as in the actual environment.

Humid Operative Temperature

The **humid operative temperature** t_{oh} is the temperature of a uniform environment at 100% rh in which a person loses the same total amount of heat from the skin as in the actual environment. This index is defined mathematically in Equation (32). It is analogous to ET^* , the only difference being that it is defined at 100% rh and 0% rh rather than at 50% rh. Figures 2 and 16 indicate that lines of constant ET^* are also lines of constant t_{oh} . However, the values of these two indices differ for a given environment.

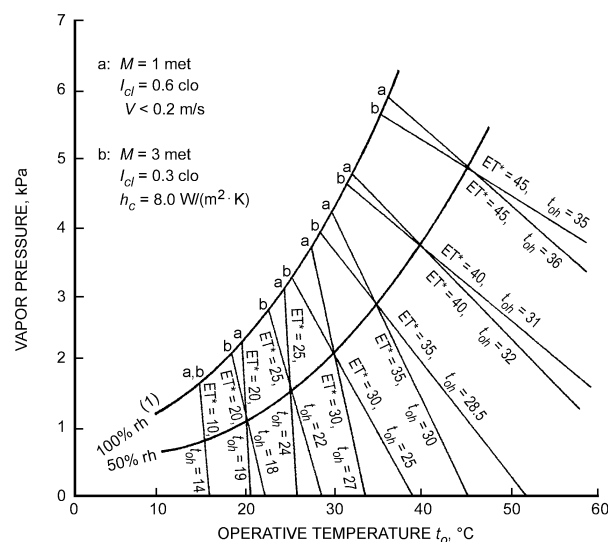
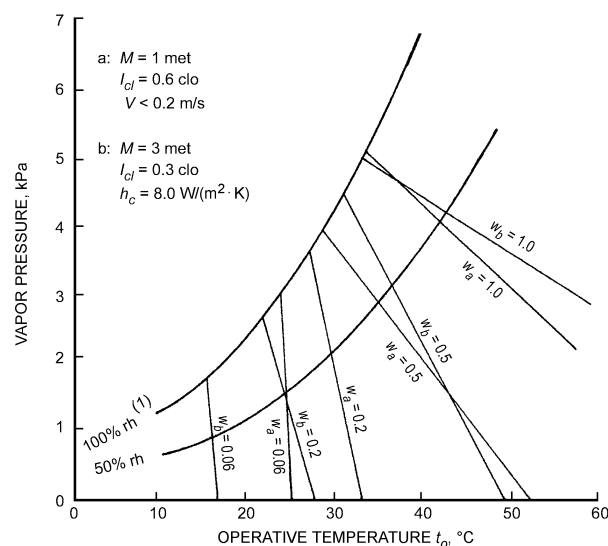
A. EFFECT OF CONDITIONS ON ET^* , t_{oh} B. EFFECT OF CONDITIONS ON WETTEDNESS, w

Fig. 16 Effective Temperature ET^* and Skin Wettedness w
 [Adapted from Nishi et al. (1975) and Gonzalez et al. (1978)]

Heat Stress Index

Originally proposed by Belding and Hatch (1955), this rational index is the ratio of the total evaporative heat loss E_{sk} required for thermal equilibrium (the sum of metabolism plus dry heat load) to the maximum evaporative heat loss E_{max} possible for the environment, multiplied by 100, for steady-state conditions (S_{sk} and S_{cr} are zero) and with t_{sk} held constant at 35°C. The ratio E_{sk}/E_{max} equals skin wettedness w [Equation (18)]. When **heat stress index (HSI)** > 100, body heating occurs; when HSI < 0, body cooling occurs. Belding and Hatch (1955) limited E_{max} to 700 W/m², which corresponds to a sweat rate of approximately 280 mg/(s·m²). When t_{sk} is constant, loci of constant HSI coincide with lines of constant ET^* on a psychrometric chart. Other indices based on wettedness have the same applications (Gonzalez et al. 1978, Belding 1970, ISO Standard 7933) but differ in their treatment of E_{max} and the effect of clothing. Table 10 describes physiological factors associated with HSI values.

Table 10 Evaluation of Heat Stress Index

Heat Stress Index	Physiological and Hygienic Implications of 8 h Exposures to Various Heat Stresses
0	No thermal strain.
10	Mild to moderate heat strain. If job involves higher intellectual functions, dexterity, or alertness, subtle to substantial decrements in performance may be expected. In performing heavy physical work, little decrement is expected, unless ability of individuals to perform such work under no thermal stress is marginal.
20	
30	
40	Severe heat strain involving a threat to health unless men are physically fit. Break-in period required for men not previously acclimatized. Some decrement in performance of physical work is to be expected. Medical selection of personnel desirable, because these conditions are unsuitable for those with cardiovascular or respiratory impairment or with chronic dermatitis. These working conditions are also unsuitable for activities requiring sustained mental effort.
50	
60	
70	Very severe heat strain. Only a small percentage of the population may be expected to qualify for this work. Personnel should be selected: (a) by medical examination, and (b) by trial on the job (after acclimatization). Special measures are needed to assure adequate water and salt intake. Amelioration of working conditions by any feasible means is highly desirable, and may be expected to decrease the health hazard while increasing job efficiency. Slight "indisposition," which in most jobs would be insufficient to affect performance, may render workers unfit for this exposure.
80	
90	
100	The maximum strain tolerated daily by fit, acclimatized young men.

Index of Skin Wettedness

Skin wettedness w is the ratio of observed skin sweating E_{sk} to the E_{max} of the environment as defined by t_{sk} , t_a , humidity, air movement, and clothing in Equation (12). Except for the factor of 100, it is essentially the same as HSI. Skin wettedness is more closely related to the sense of discomfort or unpleasantness than to temperature sensation (Gagge et al. 1969a,b; Gonzalez et al. 1978).

Wet-Bulb Globe Temperature

The WBGT is an environmental heat stress index that combines dry-bulb temperature t_{db} , a **naturally ventilated** (not aspirated) wet-bulb temperature t_{nwb} , and black globe temperature t_g , according to the relation (Dukes-Dobos and Henschel 1971, 1973)

$$WBGT = 0.7t_{nwb} + 0.2t_g + 0.1t_a \quad (78)$$

This form of the equation is usually used where solar radiation is present. The naturally ventilated wet-bulb thermometer is left exposed to the sunlight, but the air temperature t_a sensor is shaded. In enclosed environments, Equation (78) is simplified by dropping the t_a term and using a 0.3 weighting factor for t_g .

The black globe thermometer responds to air temperature, mean radiant temperature, and air movement, while the naturally ventilated wet-bulb thermometer responds to air humidity, air movement, radiant temperature, and air temperature. Thus, WBGT is a function of all four environmental factors affecting human environmental heat stress.

The WBGT is a better index of heat stress than the old ET; it shows almost as good a correlation with sweat rate as do the later corrected effective temperature (CET) and effective temperature with radiation (ETR) indices (Minard 1961); the CET and ETR both require direct measurement of wind velocity which, for accuracy, requires special instruments and trained technicians.

The WBGT index is widely used for estimating the heat stress potential of industrial environments (Davis 1976). In the United States, the National Institute of Occupational Safety and Health (NIOSH) developed criteria for a heat-stress-limiting standard (NIOSH 1986). ISO Standard 7243 also uses the WBGT. Figure 17 graphically summarizes the permissible heat exposure limits,

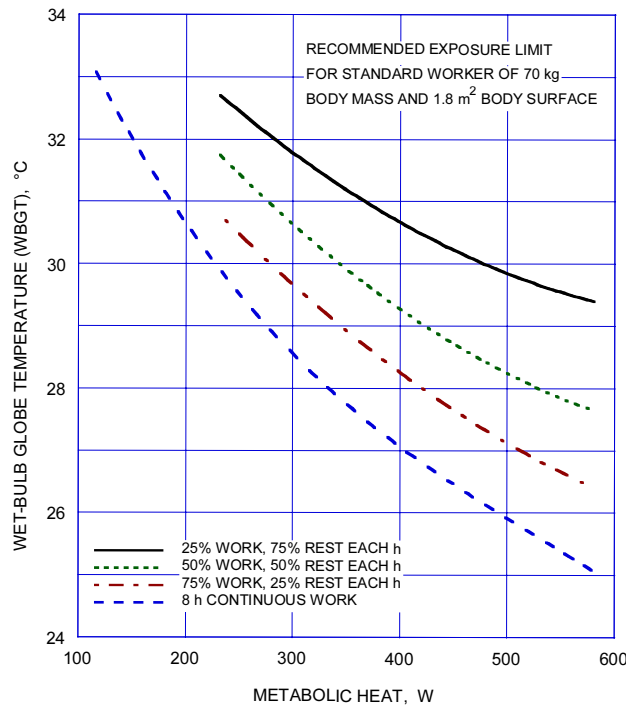


Fig. 17 Recommended Heat Stress Exposure Limits for Heat Acclimatized Workers
[Adapted from NIOSH (1986)]

expressed as working time per hour, for a fit individual, as specified for various WBGT levels. Values apply for normal permeable clothing (0.6 clo) and must be adjusted for heavy or partly vapor-permeable clothing. The USAF has recommended adjusting the measured WBGT upwards by 6 K for personnel wearing chemical protective clothing or body armor. This type of clothing increases the resistance to sweat evaporation about threefold (higher if it is totally impermeable), requiring an adjustment in WBGT level to compensate for reduced evaporative cooling at the skin.

Several mathematical models are available for predicting WBGT from the environmental factors: air temperature, psychrometric wet-bulb temperature, mean radiant temperature, and air motion (Azer and Hsu 1977; Sullivan and Gorton 1976). A simpler approach, involving plotting WBGT lines on a psychrometric chart, is recommended. Isotherms of WBGT are parallel and have negative slopes varying from 0.17 kPa/K for still air to 0.20 kPa/K for air motion greater than 1 m/s. By comparison, psychrometric wet-bulb lines have negative slopes of about 0.07 kPa/K, or about 35% as steep.

Wet-Globe Temperature

The WGT, introduced by Botsford (1971), is a simpler approach to measuring environmental heat stress than the WBGT. The measurement is made with a wetted globe thermometer called a Botsball, which consists of a 65 mm black copper sphere covered with a fitted wet black mesh fabric, into which the sensor of a dial thermometer is inserted. A polished stem attached to the sphere supports the thermometer and contains a water reservoir for keeping the sphere covering wet. This instrument is suspended by the stem at the indoor (or outdoor) site to be measured.

Onkaram et al. (1980) have shown that WBGT can be predicted with reasonable accuracy from WGT for temperate to warm environments with medium to high humidities. With air temperatures between 20 and 35°C, dew points ranging from 7 to 25°C (relative

humidities above 30%), and wind speeds of 7 m/s or less, the experimental regression equation ($r = 0.98$) in °C for an outdoor environment is

$$\text{WBGT} = 1.044(\text{WGT}) - 0.187 \quad (79)$$

This equation should not be used outside the experimental range given because data from hot-dry desert environments show differences between WBGT and WGT that are too large (6 K and above) to be adjusted by Equation (79) (Matthew et al. 1986). At very low humidity and high wind, WGT approaches the psychrometric wet-bulb temperature, which is greatly depressed below t_a . However, in the WBGT, t_{nwb} accounts for only 70% of the index value, with the remaining 30% at or above t_a .

Ciriello and Snook (1977) handle the problem by providing a series of regression equations, the choice depending on the levels of wind speed, humidity, and radiant heat. They report an accuracy of conversion from WGT to WBGT within 0.4 K (90% confidence level), if good estimates of wind speed, humidity, and radiation level are available.

Wind Chill Index

The wind chill index (WCI) is an empirical index developed from cooling measurements obtained in Antarctica on a cylindrical flask partly filled with water (Siple and Passel 1945). The index describes the rate of heat loss from the cylinder by radiation and convection for a surface temperature of 33°C, as a function of ambient temperature and wind velocity. As originally proposed,

$$\text{WCI} = \frac{(10.45 + 10\sqrt{V} - V)(33 - t_a)}{1.162} \text{ in } \text{W/m}^2 \quad (80)$$

where V and t_a are in m/s and °C, respectively. The 33°C surface temperature was chosen to be representative of the mean skin temperature of a resting human in comfortable surroundings.

A number of valid objections have been raised about this formulation. Cooling rate data from which it was derived were measured on a 57 mm diameter plastic cylinder, making it unlikely that WCI would be an accurate measure of heat loss from exposed flesh, which has different characteristics from the plastic (curvature, roughness, and radiation exchange properties) and is invariably below 33°C in a cold environment. Moreover, values given by the equation peak at 90 km/h, then decrease with increasing velocity.

Nevertheless, for velocities below 80 km/h, this index reliably expresses combined effects of temperature and wind on subjective discomfort. For example, if the calculated WCI is less than 1400 and actual air temperature is above -10°C, there is little risk of frostbite during brief exposures (1 h or less), even for bare skin. However, at a WCI of 2000 or more, the probability is high that exposed flesh will begin to freeze in 1 min or less unless measures are taken to shield the exposed skin (such as a fur ruff to break up the wind around the face).

Rather than using the WCI to express the severity of a cold environment, meteorologists use an index derived from the WCI called the **equivalent wind chill temperature**. This is the ambient temperature that would produce, in a calm wind (defined for this application as 6.4 km/h), the same WCI as the actual combination of air temperature and wind velocity. Equivalent wind chill temperature $t_{eq,wc}$ can be calculated by

$$t_{eq,wc} = -0.04544(\text{WCI}) + 33 \quad (81)$$

where $t_{eq,wc}$ is in °C (and frequently referred to as a **wind chill factor**), thus distinguishing it from WCI, which is given either as a

Table 11 Equivalent Wind Chill Temperatures of Cold Environments

Wind Speed, km/h	Actual Thermometer Reading, °C													
	10	5	0	−5	−10	−15	−20	−25	−30	−35	−40	−45	−50	
	Equivalent Wind Chill Temperature, °C													
Calm	10	5	0	−5	−10	−15	−20	−25	−30	−35	−40	−45	−50	
10	8	2	−3	−9	−14	−20	−25	−31	−37	−42	−48	−53	−59	
20	3	−3	−10	−16	−23	−29	−35	−42	−48	−55	−61	−68	−74	
30	1	−6	−13	−20	−27	−34	−42	−49	−56	−63	−70	−77	−84	
40	−1	−8	−16	−23	−31	−38	−46	−53	−60	−68	−75	−83	−90	
50	−2	−10	−18	−25	−33	−41	−48	−56	−64	−71	−79	−87	−94	
60	−3	−11	−19	−27	−35	−42	−50	−58	−66	−74	−82	−90	−97	
70	−4	−12	−20	−28	−35	−43	−51	−59	−67	−75	−83	−91	−99	
Little danger: In less than 5 h, with dry skin. Maximum danger from false sense of security.					Increasing danger: Danger of freezing exposed flesh within 1 min.					Great danger: Flesh may freeze within 30 s.				
(WCI < 1400)					(1400 ≤ WCI ≤ 2000)					(WCI > 2000)				

Source: U.S. Army Research Institute of Environmental Medicine.

Notes: Cooling power of environment expressed as an equivalent temperature under calm conditions [Equation (81)].

Winds greater than 70 km/h have little added chilling effect.

cooling rate or as a plain number with no units. For velocities less than 6.4 km/h (1.8 m/s), Equation (81) does not apply, and the wind chill temperature is equal to the air temperature.

Equation (81) does not imply cooling to below ambient temperature, but recognizes that, because of wind, the cooling rate is increased as though it were occurring at the lower equivalent wind chill temperature. Wind accelerates the rate of heat loss, so that the skin surface is cooling faster toward the ambient temperature. Table 11 shows a typical wind chill chart, expressed in equivalent wind chill temperature.

SPECIAL ENVIRONMENTS

Infrared Heating

Optical and thermal properties of skin must be considered in studies concerning the effects of infrared radiation in (1) producing changes in skin temperature and skin blood flow, and (2) evoking sensations of temperature and comfort (Hardy 1961). Although the body can be considered to have the properties of water, thermal sensation and heat transfer with the environment require a study of the skin and its interaction with visible and infrared radiation.

Figure 18 shows how skin reflectance and absorptance vary for a blackbody heat source at the temperature (in K) indicated. These curves show that darkly pigmented skin is heated more by direct radiation from a high-intensity heater at 2500 K than is lightly pigmented skin. With low-temperature and low-intensity heating equipment used for total area heating, there is minimal, if any, difference. Also, in practice, clothing minimizes differences.

Changes in skin temperature caused by high-intensity infrared radiation depend on the thermal conductivity, density, and specific heat of the living skin (Lipkin and Hardy 1954). Modeling of skin heating with the heat transfer theory yields a parabolic relation between exposure time and skin temperature rise for nonpenetrating radiation:

$$t_{sf} - t_{si} = \Delta t = 2J\alpha\sqrt{\theta/(\pi k\rho c_p)} \quad (82)$$

where

t_{sf} = final skin temperature, °C

t_{si} = initial skin temperature, °C

J = irradiance from source radiation temperatures, W/m²

θ = time, h

k = specific thermal conductivity of tissue, W/(m·K)

ρ = density, kg/m³

c_p = specific heat, J/kg·K

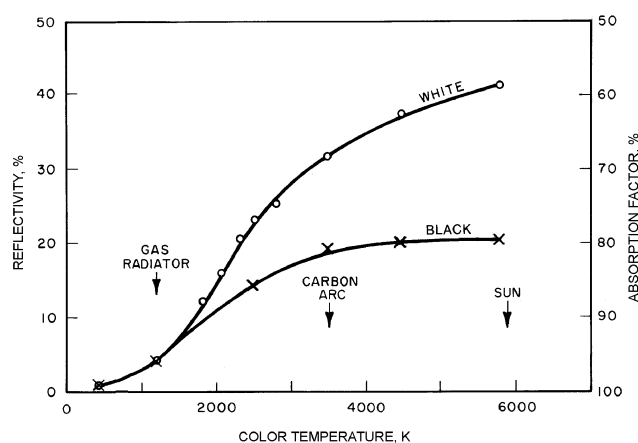


Fig. 18 Variation in Skin Reflection and Absorptivity for Blackbody Heat Sources

α = skin absorptance at radiation temperatures, dimensionless

Product kpc_p is the physiologically important quantity that determines temperature elevation of skin or other tissue on exposure to nonpenetrating radiation. Fatty tissue, because of its relatively low specific heat, is heated more rapidly than moist skin or bone. Experimentally, kpc_p values can be determined by plotting ΔT^2 against $1.13J^2\theta$ (Figure 19). The relationship is linear, and the slopes are inversely proportional to the kpc_p of the specimen. Comparing leather and water with body tissues suggests that thermal inertia values depend largely on tissue water content.

Living tissues do not conform strictly to this simple mathematical formula. Figure 20 compares excised skin with living skin with normal blood flow, and skin with blood flow occluded. For short exposure times, the kpc_p of normal skin is the same as that in which blood flow has been stopped; excised skin heats more rapidly due to unavoidable dehydration that occurs postmortem. However, with longer exposure to thermal radiation, vasodilation increases blood flow, cooling the skin. For the first 20 s of irradiation, skin with normally constricted blood vessels has a kpc_p value one-fourth that for skin with fully dilated vessels.

Skin temperature is the best single index of thermal comfort. The most rapid changes in skin temperature occur during the first 60 s of exposure to infrared radiation. During this initial period, thermal

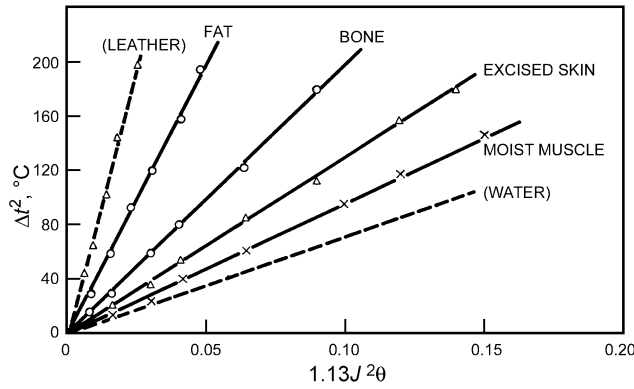


Fig. 19 Comparing Thermal Inertia of Fat, Bone, Moist Muscle, and Excised Skin to That of Leather and Water

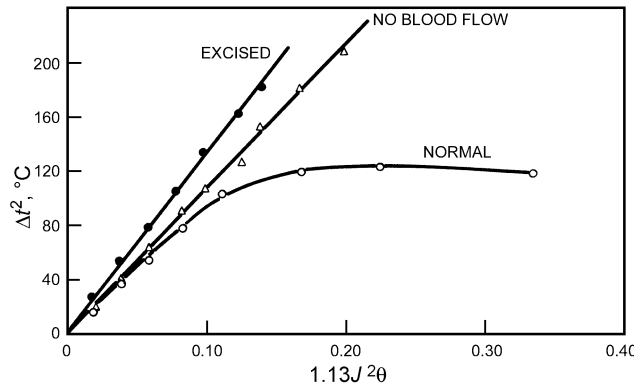


Fig. 20 Thermal Inertias of Excised, Bloodless, and Normal Living Skin

sensation and the heating rate of the skin vary with the quality of infrared radiation (color temperature in K). Because radiant heat from a gas-fired heater is absorbed at the skin surface, the same unit level of absorbed radiation during the first 60 s of exposure can cause an even warmer initial sensation than penetrating solar radiation. Skin heating curves tend to level off after a 60 s exposure (Fig. 20); this means that a relative balance is quickly created between heat absorbed, heat flow to the skin surface, and heat loss to the ambient environment. Therefore, the effects of radiant heating on thermal comfort should be examined for conditions approaching thermal equilibrium.

Stolwijk and Hardy (1966) described an unclothed subject's response for a 2 h exposure to temperatures of 5 to 35°C. Nevins et al. (1966) showed a relation between ambient temperatures and thermal comfort of clothed, resting subjects. For any given uniform environmental temperature, both initial physiological response and degree of comfort can be determined for a subject at rest.

Physiological implications for radiant heating can be defined by two environmental temperatures: (1) mean radiant temperature $\bar{t}_r$ and (2) ambient air temperature t_a . For this discussion on radiant heat, assume that (1) relative humidity is less than 50%, and (2) air movement is low and constant, with an equivalent convection coefficient of 2.9 W/(m²·K).

The equilibrium equation, describing heat exchange between skin surface at mean temperature t_{sk} and the radiant environment, is given in Equation (28), and can be transformed to give (see Table 2)

$$M' - E_{sk} - F_{cle}[h_r(t_{sk} - \bar{t}_r) + h_c(t_{sk} - t_o)] = 0 \quad (83)$$

where M' is the net heat production ($M - W$) less respiratory losses.

By algebraic transformation, Equation (83) can be rewritten as

$$M' + \text{ERF} \cdot F_{cle} = E_{sk} + (h_r + h_c)(t_{sk} - t_a)F_{cle} \quad (84)$$

where $\text{ERF} = h_r(\bar{t}_r - t_a)$ is the effective radiant field and represents the additional radiant exchange with the body when $\bar{t}_r \neq t_a$.

The last term in Equation (84) describes heat exchange with an environment uniformly heated to temperature t_a . The term h_r , evaluated in Equation (35), is also a function of posture, for which factor A_r/A_D can vary from 0.67 for crouching to 0.73 for standing. For preliminary analysis, a useful value for h_r is 4.7 W/(m²·K), which corresponds to a normally clothed (at 24°C) sedentary subject. Ambient air movement affects h_c , which appears only in the right-hand term of Equation (84).

Although the linear radiation coefficient h_r is used in Equations (83) and (84), the same definition of ERF follows if the fourth power radiation law is used. By this law, assuming emissivity of the body surface is unity, the ERF term in Equation (84) is

$$\text{ERF} = \sigma(A_r/A_D)[(\bar{t}_r + 273)^4 - (t_a + 273)^4]F_{cle} \quad (85)$$

where σ is the Stefan-Boltzmann constant, 5.67×10^{-8} W/(m²·K⁴).

Because $\bar{t}_r$ equals the radiation of several surfaces at different temperatures ($T_1, T_2, \dots, T_j$),

$$\text{ERF} = (\text{ERF})_1 + (\text{ERF})_2 + \dots + (\text{ERF})_j \quad (86)$$

where

$$\begin{aligned} \text{ERF}_j &= \sigma(A_r/A_D)\alpha_j F_{m-j}(T_j^4 - T_a^4)F_{cle} \\ \alpha_j &= \text{absorptance of skin or clothing surface for source radiating at temperature } T_j \\ F_{m-j} &= \text{angle factor to subject } m \text{ from source } j \\ T_a &= \text{ambient air temperature, K} \end{aligned}$$

ERF is the sum of the fields caused by each surface T_j [e.g., T_1 may be an infrared beam heater; T_2 , a heated floor; T_3 , a warm ceiling; T_4 , a cold plate glass window ($T_4 < T_a$); etc.]. Only surfaces with T_j differing from T_a contribute to the ERF.

Comfort Equations for Radiant Heating

The **comfort equation for radiant heat** (Gagge et al. 1967a,b) follows from definition of ERF and Equation (8):

$$t_o \text{ (for comfort)} = t_a + \text{ERF (for comfort)}/h \quad (87)$$

Thus, operative temperature for comfort is the temperature of the ambient air plus a temperature increment ERF/h , a ratio that measures the effectiveness of the incident radiant heating on occupants. Higher air movement (which increases the value of h or h_c) reduces the effectiveness of radiant heating systems. Clothing lowers t_o for comfort and for thermal neutrality.

Values for ERF and h must be determined to apply the comfort equation for radiant heating. Table 3 may be used to estimate h . One method of determining ERF is to calculate it directly from radiometric data that give (1) radiation emission spectrum of the source, (2) concentration of the beam, (3) radiation from the floor, ceiling, and windows, and (4) corresponding angle factors involved. This analytical approach is described in Chapter 53 of the *ASHRAE Handbook—Applications*.

For direct measurement, a skin-colored or black globe, 150 mm in diameter, can measure the radiant field ERF for comfort, by the following relation:

$$\text{ERF} = (A_r/A_D)[6.1 + 13.6\sqrt{V}](t_g - t_a) \quad (88)$$

where t_g is uncorrected globe temperature in °C and V is air movement in m/s. The average value of A_r/A_D is 0.7. For a skin-colored

globe, no correction is needed for the quality of radiation. For a black globe, ERF must be multiplied by α for the exposed clothing/skin surface. For a subject with 0.6 to 1.0 clo, t_o for comfort should agree numerically with t_a for comfort in Figure 5. When t_o replaces t_a in Figure 5, humidity is measured in vapor pressure rather than relative humidity, which refers only to air temperature.

Other methods may be used to measure ERF. The most accurate is by physiological means. In Equation (84), when M , $t_{sk} - t_a$, and the associated transfer coefficients are experimentally held constant,

$$\Delta E = \Delta \text{ERF} \quad (89)$$

The variation in evaporative heat loss E (rate of mass loss) caused by changing the wattage of two T-3 infrared lamps is a measure in absolute terms of the radiant heat received by the body.

A third method uses a directional radiometer to measure ERF directly. For example, radiation absorbed at the body surface [in W/m^2] is

$$\text{ERF} = \alpha(A_i/A_D)J \quad (90)$$

where irradiance J can be measured by a directional (Hardy-type) radiometer; α is the surface absorptance effective for the source used; and A_i is the projection area of the body normal to the directional irradiance. Equation (90) can be used to calculate ERF only for the simplest geometrical arrangements. For a human subject lying supine and irradiated uniformly from above, A_i/A_D is 0.3. Figure 18 shows variance of α for human skin with blackbody temperature (in K) of the radiating source. When irradiance J is uneven and coming from many directions, as is usually the case, the previous physiological method can be used to obtain an effective A_i/A_D from the observed ΔE and $\Delta(\alpha J)$.

Hot and Humid Environments

Tolerance limits to high temperature vary with the ability to (1) sense temperature, (2) lose heat by regulatory sweating, and (3) move heat from the body core by blood flow to the skin surface, where cooling is the most effective. Many interrelating processes are involved in heat stress (Figure 21).

Skin surface temperatures of 46°C trigger pain receptors in the skin; direct contact with metal at this temperature is painful. How-

ever, since thermal insulation of the air layer around the skin is high, much higher dry air temperatures can be tolerated. For lightly clothed subjects at rest, tolerance times of nearly 50 min have been reported at 82°C dry-bulb temperature; 33 min at 93°C ; 26 min at 104°C ; and 24 min at 115°C . In each case, dew points were lower than 30°C . Many individuals are stimulated by brief periods of exposure to 85°C dry air in a sauna. Short exposures to these extremely hot environments are tolerable because of cooling by sweat evaporation. However, when ambient vapor pressure approaches 6.0 kPa (36°C dew point, typically found on sweating skin), tolerance is drastically reduced. Temperatures of 50°C can be intolerable if the dew-point temperature is greater than 25°C , and both deep body temperature and heart rate rise within minutes (Gonzalez et al. 1978).

The rate at which and length of time a body can sweat are limited. The maximum rate of sweating for an average man is about 0.5 g/s. If all this sweat evaporates from the skin surface under conditions of low humidity and air movement, maximum cooling is about 675 W/m^2 . However, this value does not normally occur because sweat rolls off the skin surface without evaporative cooling or is absorbed by or evaporated within clothing. A more typical cooling limit is 6 mets, 350 W/m^2 , representing approximately 0.3 g/s (1 L/h) of sweating for the average man.

Thermal equilibrium is maintained by dissipation of resting heat production (1 met) plus any radiant and convective load. If the environment does not limit heat loss from the body during heavy activity, decreasing skin temperature compensates for the core temperature rise. Therefore, mean body temperature is maintained, although the gradient from core to skin is increased. Blood flow through the skin is reduced, but muscle blood flow necessary for exercise is preserved. The upper limit of skin blood flow is about 25 g/s (Burton and Bazett 1936).

Body heat storage of 335 kJ (or a rise in t_b of 1.4 K) for an average-sized man represents an average voluntary tolerance limit. Continuing work beyond this limit increases the risk of heat exhaustion. Collapse can occur at about 670 kJ of storage (2.8 K rise); few individuals can tolerate heat storage of 920 kJ (3.8 K above normal).

The cardiovascular system affects tolerance limits. In normal, healthy subjects exposed to extreme heat, heart rate and cardiac output increase in an attempt to maintain blood pressure and supply of blood to the brain. At a heart rate of about 180 bpm, the short time between contractions prevents adequate blood supply to the heart

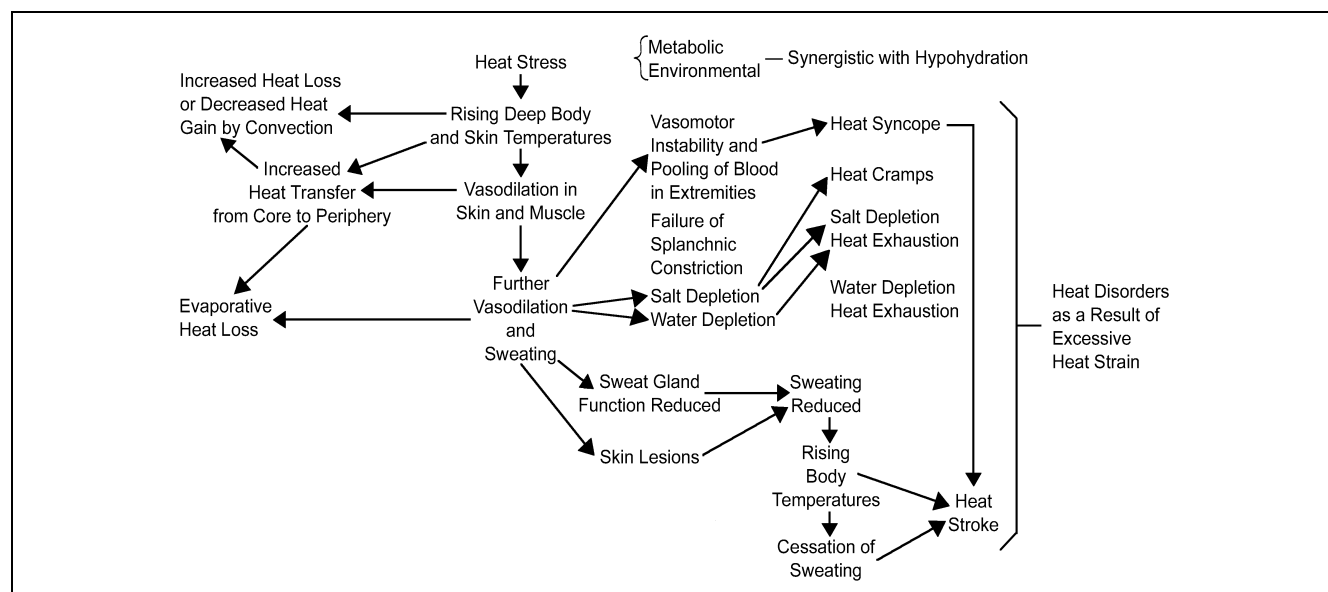


Fig. 21 Schematic Design of Heat Stress and Heat Disorders

[Modified by Buskirk from scale diagram by Belding (1967) and Leithead and Lind (1964)]

chambers. As heart rate continues to increase, cardiac output drops, causing inadequate convective blood exchange with the skin and, perhaps more important, inadequate blood supply to the brain. Victims of this heat exhaustion faint or black out. Accelerated heart rate can also result from inadequate venous return to the heart caused by pooling of blood in the skin and lower extremities. In this case, cardiac output is limited because not enough blood is available to refill the heart between beats. This occurs most frequently when an overheated individual, having worked hard in the heat, suddenly stops working. The muscles no longer massage the blood back past the valves in the veins toward the heart. Dehydration compounds the problem, since fluid volume in the vascular system is reduced.

If core temperature t_{cr} increases above 41°C , critical hypothalamic proteins can be damaged, resulting in inappropriate vasoconstriction, cessation of sweating, increased heat production by shivering, or some combination of these. Heat stroke damage is frequently irreversible and carries a high risk of fatality.

A final problem, hyperventilation, occurs predominantly in hot-wet conditions, when too much CO_2 is washed from the blood. This can lead to tingling sensations, skin numbness, and vasoconstriction in the brain with occasional loss of consciousness.

Since a rise in heart rate or rectal temperature is essentially linear with ambient vapor pressure above a dew point of 25°C , these two changes can measure severe heat stress. Although individual heart rate and rectal temperature responses to mild heat stress vary, severe heat stress saturates physiological regulating systems, producing uniform increases in heart rate and rectal temperature. In contrast, sweat production measures stress under milder conditions but becomes less useful under more severe stress. The maximal sweat rate compatible with body cooling varies with (1) degree of heat acclimatization, (2) duration of sweating, and (3) whether the sweat evaporates or merely saturates the skin and drips off. Total sweat rates in excess of 2 L/h can occur in short exposures, but about 1 L/h is an average maximum sustainable level for an acclimatized man.

Figure 22 illustrates the decline in heart rate, rectal temperature, and skin temperature when exercising subjects are exposed to 40°C over a period of days. Acclimatization can be achieved by working in the heat for 100 min each day—30% improvement occurs after the first day, 50% after 3 days, and 95% after 6 or 7 days. Increased sweat secretion while working in the heat can be induced by rest. Although reducing salt intake during the first few days in the heat can conserve sodium, heat cramps may result. Working regularly in the heat improves cardiovascular efficiency, sweat secretion, and sodium conservation. Once induced, heat acclimatization can be maintained by as few as once-a-week workouts in the heat; otherwise, it diminishes slowly over a 2- to 3-week period and disappears.

Extreme Cold Environments

Human performance in extreme cold ultimately depends on maintaining thermal balance. Subjective discomfort is reported by a 70 kg man with 1.8 m^2 of body surface area when a heat debt of about 104 kJ is incurred. A heat debt of about 630 kJ is acutely uncomfortable; this represents a drop of approximately 2.6 K (or about 7% of total heat content) in mean body temperature.

This loss can occur during 1 to 2 h of sedentary activity outdoors. A sleeping individual will awake after losing about 314 kJ, decreasing mean skin temperature by about 3 K and deep body temperature by about 0.5 K. A drop in deep body temperature (e.g., rectal temperature) below 35°C threatens a loss of body temperature regulation, while 28°C is considered critical for survival, despite recorded survival from a deep body temperature of 18°C . Temperature is more crucial than rate of temperature change; Witherspoon et al. (1971) observed a rate of fall in the core temperature of 3 K per hour in subjects immersed in 10°C water, without residual effect.

Activity level also affects human performance. Subjective sensations reported by sedentary subjects at a mean skin temperature of 33.3°C , are comfortable; at 31°C , uncomfortably cold; at 30°C , shiv-

ering cold; and at 29°C , extremely cold. The critical subjective tolerance limit (without numbing) for mean skin temperature appears to be about 25°C . However, during moderate to heavy activity, subjects reported the same skin temperatures as comfortable. Although mean skin temperature is significant, the temperature of the extremities is more frequently the critical factor for comfort in the cold. Consistent with this, one of the first responses to cold exposure is vasoconstriction, which reduces circulatory heat input to the hands and feet. A hand-skin temperature of 20°C causes a report of uncomfortably cold; 15°C , extremely cold; and 5°C , painful. Identical verbal responses for the foot surface occur at approximately 1.5 to 2 K warmer temperatures.

An ambient temperature of -35°C is the lower limit for useful outdoor activity, even with adequate insulative clothing. At -50°C , almost all outdoor effort becomes exceedingly difficult; even with appropriate protective equipment, only limited exposure is possible. Reported exposures of 30 min at -75°C have occurred in the Antarctic without injury.

In response to extreme heat loss, maximal heat production becomes very important. When the less efficient vasoconstriction cannot prevent body heat loss, shivering is an automatic, more efficient defense against cold. This can be triggered by low deep body temperature, low skin temperature, rapid change of skin temperature, or some combination of all three. Shivering is usually preceded by an imperceptible increase in muscle tension and by noticeable gooseflesh produced by muscle contraction in the skin. It begins slowly in small muscle groups, initially increasing total heat

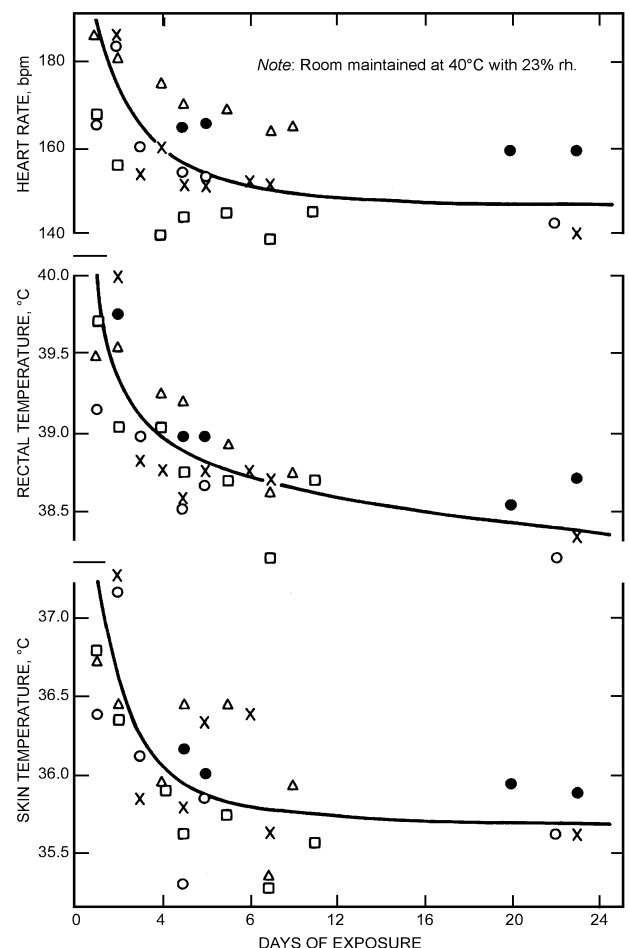


Fig. 22 Acclimatization to Heat Resulting from Daily Exposure of Five Subjects to Extremely Hot Room
(Robinson et al. 1943)

production by 1.5 to 2 times resting levels. As body cooling increases, the reaction spreads to additional body segments. Ultimately violent, whole body shivering causes maximum heat production of about 6 times resting levels, rendering the individual totally ineffective.

Given sufficient cold exposure, the body undergoes changes that indicate cold acclimatization. These physiological changes include, (1) endocrine changes (e.g., sensitivity to norepinephrine), causing nonshivering heat production by metabolism of free fatty acids released from adipose tissue; (2) improved circulatory heat flow to skin, causing an overall sensation of greater comfort; and (3) improved circulatory heat flow to the extremities, reducing the risk of injury and permitting activities at what ordinarily would be severely uncomfortable temperatures in the extremities. Generally, these physiological changes are minor and are induced only by repeated extreme exposures. Nonphysiological factors, including training, experience, and selection of adequate protective clothing, are more useful and may be safer than dependence on physiological changes.

The energy requirement for adequately clothed subjects in extreme cold is only slightly greater than that for subjects living and working in temperate climates. This greater requirement results from added work caused by (1) carrying the weight of heavy clothing (energy cost for heavy protective footwear may be six times that of an equivalent weight on the torso); and (2) the inefficiency of walking in snow, snowshoeing, or skiing, which can increase energy cost up to 300%.

To achieve proper protection in low temperatures, a person must either maintain high metabolic heat production by activity or reduce heat loss by controlling the body's microclimate with clothing. Other protective measures include spot radiant heating, showers of hot air for work at a fixed site, and warm-air-ventilated or electrically heated clothing. The extremities, such as fingers and toes, pose more of a problem than the torso because, as thin cylinders, they are particularly susceptible to heat loss and difficult to insulate without increasing the surface for heat loss. Vasoconstriction can reduce circulatory heat input to extremities by over 90%.

Although there is no ideal insulating material for protective clothing, radiation-reflective materials are promising. Insulation is primarily a function of clothing thickness; the thickness of trapped air, rather than fibers used, determines insulation effectiveness.

Protection for the respiratory tract seems unnecessary in healthy individuals, even at -45°C . However, asthmatics or individuals with mild cardiovascular problems may benefit from a face mask that warms inspired air. Masks are unnecessary for protecting the face because heat to facial skin is not reduced by local vasoconstriction, as it is for hands. If wind chill is great, there is always a risk of cold injury caused by freezing of exposed skin. Using properly designed torso clothing, such as a parka with a fur-lined hood to minimize wind penetration to the face, and 10 W of auxiliary heat to each hand and foot, inactive people can tolerate -55°C with a 16 km/h wind for more than 6 h. As long as the skin temperature of fingers remains above 15°C , manual dexterity can be maintained and useful work performed without difficulty.

SYMBOLS

A	= area, m^2
A_{ch}	= contact area between chair and body
A_{cl}	= surface area of clothed body
A_D	= DuBois surface area of nude body
A_G	= body surface area covered by garment
A_r	= effective radiation area of body
BFN	= neutral skin blood flow, $\text{L}/(\text{h} \cdot \text{m}^2)$
c	= specific heat, $\text{J}/(\text{kg} \cdot \text{K})$
c_{cr}	= body core
c_{sk}	= skin
c_p	= at constant pressure
$c_{p,a}$	= of air

$c_{p,b}$	= of body tissue
$c_{p,bl}$	= of blood
c_{dil}	= constant for skin blood flow
c_{sw}	= proportionality constant for sweat control
C	= convective heat loss, W/m^2
C_{res}	= sensible heat loss due to respiration, W/m^2
$C + R$	= total sensible heat loss from skin, W/m^2
E	= evaporative heat loss, W/m^2
E_{dif}	= due to moisture diffusion through skin
E_{max}	= maximum possible
E_{rsw}	= due to regulatory sweating
E_{res}	= due to respiration
$E_{rsw,req}$	= required for comfort
E_{sw}	= actual evaporation rate
E_{sk}	= total from skin
ERF	= effective radiant field, W/m^2
ET	= original effective temperature based on 100% rh, $^{\circ}\text{C}$
ET*	= effective temperature, based on 50% rh, $^{\circ}\text{C}$
f_{cl}	= clothing area factor, A_{cl}/A_D , dimensionless
F_{cl}	= intrinsic clothing thermal efficiency, dimensionless
F_{cle}	= effective clothing thermal efficiency, dimensionless
F_{pcl}	= permeation efficiency, dimensionless
F_{m-j}	= angle factor to person from source j , dimensionless
F_{p-N}	= angle factor between person and source N , dimensionless
h	= sensible heat transfer coefficient, $\text{W}/(\text{m}^2 \cdot \text{K})$
h	= total at surface
h'	= overall including clothing
h_c	= convection at surface
h_{cc}	= corrected convection at surface
h_r	= radiation
h_e	= evaporative heat transfer coefficient, $\text{W}/(\text{m}^2 \cdot \text{kPa})$
h_e	= at surface
h_{ec}	= at surface, corrected for atmospheric pressure
$h'_{e,cl}$	= clothing evaporative conductance, the evaporative conductance of a uniform layer of insulation covering the entire body that has same effect on evaporative heat flow as the actual clothing.
h'_e	= overall including clothing
h_a	= enthalpy of ambient air, J/kg (dry air)
h_{ex}	= enthalpy of exhaled air, J/kg (dry air)
h_{fg}	= heat of vaporization of water, J/kg
i	= vapor permeation efficiency, dimensionless
i_a	= air layer
i_{cl}	= clothing
i_m	= total
I	= thermal resistance in clo units, clo
All subscripts given for symbol R apply to symbol I	
$I_{clu,i}$	= effective insulation of garment i
J	= irradiance, W/m^2
k	= thermal conductivity of body tissue, $\text{W}/(\text{m} \cdot \text{K})$
K	= effective conductance between core and skin, $\text{W}/(\text{m}^2 \cdot \text{K})$
l	= height, m
L	= thermal load on body, W/m^2
LR	= Lewis ratio, K/kPa
m	= body mass, kg
m_{cr}	= mass of body core
m_{sk}	= mass of skin
m_{ge}	= mass to gas exchange, kg
$\dot{m}$	= mass flow, $\text{kg}/(\text{s} \cdot \text{m}^2)$
$\dot{m}_{res}$	= pulmonary ventilation flow rate, kg/s
$\dot{m}_{w,res}$	= pulmonary water loss rate, kg/s
$\dot{M}$	= metabolic heat production, W/m^2
M	= total
M'	= net ($M - W$)
M_{act}	= due to activity
M_{shiv}	= due to shivering
p	= water vapor pressure, kPa
p_a	= in ambient air
$p_{ET^*,s}$	= saturated at ET*
$p_{oh,s}$	= saturated at t_{oh}
$p_{sk,s}$	= saturated at t_{sk}
p_t	= atmospheric pressure, kPa
p_{tcom}	= related to t_{com}
q	= heat flow, W/m^2

q_{dry}	= sensible from skin
q_{evap}	= latent from skin
$q_{cr,sk}$	= from core to skin
q_{res}	= total due to respiration
q_{sk}	= total from the skin
Q_{bl}	= blood flow between core and skin, [L/(h·m ²)]
Q_{CO_2}	= volume rate of CO ₂ produced, mL/s
Q_{O_2}	= volume rate of O ₂ consumed, mL/s
Q_{rsw}	= rate of regulatory sweat generation, [L/(h·m ²)]
R	= radiative heat loss from skin, W/m ²
R	= thermal resistance, m ² ·K/W
R_a	= air layer on nude skin
$R_{a,cl}$	= air layer at outer surface
R_{cl}	= clothing
R_{cle}	= change due to clothing
R_e	= evaporative resistance, m ² ·kPa/W
$R_{e,a}$	= outer boundary layer air
$R_{e,cl}$	= clothing
$R_{e,t}$	= total
R_t	= total
RQ	= respiratory quotient, dimensionless
S	= heat storage, W/m ²
S_{cr}	= in core compartment
S_{sk}	= in skin compartment
S_{tr}	= constriction constant for skin blood flow
SET*	= standard effective temperature, °C
SKBF	= skin blood flow, g/(m ² ·s)
t	= temperature, °C
t_a	= ambient air
t_b	= average of body
$t_{b,c}$	= lower limit for evaporative regulation zone
$t_{b,h}$	= upper limit for evaporative regulation zone
t_c	= comfort
t_{cl}	= clothing surface
t_{com}	= combined temperature
t_{cr}	= core compartment
t_{db}	= dry bulb
t_{dp}	= dew point
$t_{eq,wc}$	= equivalent wind chill temperature
t_{ex}	= of exhaled air
t_g	= globe
t_N	= of surface N
t_{nwb}	= naturally ventilated wet bulb
t_o	= operative
t_{oc}	= operative comfort
t_{oh}	= humid operation
t_{out}	= monthly mean outside
t_{pr}	= plane radiant
$\bar{t}_r$	= mean radiant
t_{sf}	= final skin
t_{si}	= initial skin
t_{sk}	= skin compartment
$t_{sk,n}$	= at neutrality
$t_{sk,req}$	= required for comfort
t_{wb}	= wet bulb
T	= absolute temperature, K
All subscripts that apply to symbol t may apply to symbol T .	
Tu	= turbulence intensity, %
V	= air velocity, m/s
w	= skin wettedness, dimensionless
w_{rsw}	= required to evaporate regulatory sweat
W	= external work accomplished, W/m ²
W_a	= humidity ratio of ambient air, kg (water vapor)/kg (dry air)
W_{ex}	= humidity ratio of exhaled air, kg (water vapor)/kg (dry air)
WBGT	= wet-bulb globe temperature, °C
WCI	= wind chill index, W/m ²
WGT	= wet-globe temperature, °C
α	= skin absorptance, dimensionless
α_{sk}	= fraction of total body mass concentrated in skin compartment, dimensionless
ϵ	= emissivity, dimensionless
η_{ev}	= evaporative efficiency, dimensionless
μ	= body's mechanical efficiency = W/M , dimensionless
ρ	= density, kg/m ³

σ	= Stefan-Boltzmann constant = 5.67×10^{-8} W/(m ² ·K ⁴)
θ	= time, s

CODES AND STANDARDS

- ASHRAE. 1992. Thermal environmental conditions for human occupancy. ANSI/ASHRAE *Standard* 55-1992.
- ASHRAE. 1994. Addendum 55a. ANSI/ASHRAE *Standard* 55-1992.
- ISO. 1989. Hot environments—Analytical determination and interpretation of thermal stress using calculation of required sweat rates. *Standard* 7933. International Organization for Standardization, Geneva.
- ISO. 1989. Hot environments—Estimation of the heat stress on working man, based on the WBGT-index (wet bulb globe temperature). *Standard* 7243.
- ISO. 1994. Moderate thermal environments—Determination of the PMV and PPD indices and specification of the conditions for thermal comfort. *Standard* 7730.

REFERENCES

- Astrand, P. and K. Rodahl. 1977. *Textbook of work physiology: Physiological bases of exercise*. McGraw-Hill, New York.
- Azer, N.Z. 1982. Design guidelines for spot cooling systems: Part I—Assessing the acceptability of the environment. *ASHRAE Transactions* 88:1.
- Azer, N.Z. and S. Hsu. 1977. OSHA heat stress standards and the WBGT index. *ASHRAE Transactions* 83(2):30.
- Belding, H.D. 1967. Heat stress. In *Thermobiology*, ed. A.H. Rose. Academic Press, New York.
- Belding, H.S. 1970. The search for a universal heat stress index. *Physiological and Behavioral Temperature Regulation*, eds. J.D. Hardy et al. Springfield, IL.
- Belding, H.S. and T.F. Hatch. 1955. Index for evaluating heat stress in terms of resulting physiological strains. *Heating, Piping and Air Conditioning* 207:239.
- Berglund, L.G. 1994. Common elements in the design and operation of thermal comfort and ventilation systems. *ASHRAE Transactions* 100(1).
- Berglund, L.G. 1995. Comfort criteria: Humidity and standards. *Proceedings of Pan Pacific Symposium on Building and Urban Environmental Conditioning in Asia* 2:369-82. Architecture Department, University of Nagoya, Japan.
- Berglund, L.G. and D.J. Cunningham. 1986. Parameters of human discomfort in warm environments. *ASHRAE Transactions* 92(2):732-46.
- Berglund, L.G. and A. Fobelets. 1987. A subjective human response to low level air currents and asymmetric radiation. *ASHRAE Transactions* 93(1):497-523.
- Berglund, L.G. and R.R. Gonzalez. 1978. Evaporation of sweat from sedentary man in humid environments. *J. Appl. Physiol.: Respirat., Environ., Exercise Physiol.* 42(5): 767-72.
- Botsford, J.H. 1971. A wet globe thermometer for environmental heat measurement. *American Industrial Hygiene Association Journal* 32:1-10.
- Burton, A.C. and H.C. Bazett. 1936. A study of the average temperature of the tissues, the exchange of heat and vasomotor responses in man, by a bath calorimeter. *American Journal of Physiology* 117:36.
- Busch, J.F. 1992. A tale of two populations: Thermal comfort in air-conditioned and naturally ventilated offices in Thailand. *Energy and Buildings* 18:235-49.
- Buskirk, E.R. 1960. Problems related to the caloric cost of living. *Bulletin of the New York Academy of Medicine* 26:365.
- Chatonnet, J. and M. Cabanac. 1965. The perception of thermal comfort. *International Journal of Biometeorology* 9:183-93.
- Ciriello, V.M. and S.H. Snook. 1977. The prediction of WBGT from the Botsball. *American Industrial Hygiene Association Journal* 38:264.
- Colin, J. and Y. Houdas. 1967. Experimental determination of coefficient of heat exchange by convection of the human body. *Journal of Applied Physiology* 22:31.
- Collins, K.J. and E. Hoinville. 1980. Temperature requirements in old age. *Building Services Engineering Research and Technology* 1(4):165-72.
- Davis, W.J. 1976. Typical WBGT indexes in various industrial environments. *ASHRAE Transactions* 82(2):303.
- de Dear, R.J. and G.S. Brager. 1998. Developing an adaptive model of thermal comfort and preference. *ASHRAE Technical Data Bulletin* 14(1):27-49.
- de Dear, R., K. Leow, and A. Ameen. 1991. Thermal comfort in the humid tropics—Part I. *ASHRAE Transactions* 97(1):874-79.

- DuBois, D. and E.F. DuBois. 1916. A formula to estimate approximate surface area, if height and weight are known. *Archives of Internal Medicine* 17:863-71.
- Dukes-Dobos, F. and A. Henschel. 1971. The modification of the WBGT index for establishing permissible heat exposure limits in occupational work. HEW, USPHS, NIOSH, TR-69.
- Dukes-Dobos, F. and A. Henschel. 1973. Development of permissible heat exposure limits for occupational work. *ASHRAE Journal* 9:57.
- Eriksson, H.A. 1975. Heating and ventilating of tractor cabs. Presented at the 1975 Winter Meeting, American Society of Agricultural Engineers, Chicago.
- Fanger, P.O. 1967. Calculation of thermal comfort: Introduction of a basic comfort equation. *ASHRAE Transactions* 73(2):III.4.1.
- Fanger, P.O. 1970. *Thermal comfort analysis and applications in environmental engineering*. McGraw-Hill, New York.
- Fanger, P.O. 1972. *Thermal comfort*. McGraw-Hill, New York.
- Fanger, P.O. 1973. The variability of man's preferred ambient temperature from day to day. *Archives des Sciences Physiologiques* 27(4):A403.
- Fanger, P.O. 1982. *Thermal comfort*. Robert E. Krieger Publishing Company, Malabar, FL.
- Fanger, P.O., L. Banhihi, B.W. Olesen, and G. Langkilde. 1980. Comfort limits for heated ceilings. *ASHRAE Transactions* 86.
- Fanger, P.O. and N.K. Christensen. 1986. Perception of draught in ventilated spaces. *Ergonomics* 29(2):215-35.
- Fanger, P.O., J. Højbjørre, and J.O.B. Thomsen. 1974. Thermal comfort conditions in the morning and the evening. *International Journal of Biometeorology* 18(1):16.
- Fanger, P.O., J. Højbjørre, and J.O.B. Thomsen. 1973. Man's preferred ambient temperature during the day. *Archives des Sciences Physiologiques* 27(4): A395-A402.
- Fanger, P.O., B.M. Ipsen, G. Langkilde, B.W. Olesen, N.K. Christensen, and S. Tanabe. 1985. Comfort limits for asymmetric thermal radiation. *Energy and Buildings*.
- Fanger, P.O. and G. Langkilde. 1975. Interindividual differences in ambient temperature preferred by seated persons. *ASHRAE Transactions* 81(2): 140-47.
- Fanger, P.O., A.K. Melikov, H. Hanzawa, and J. Ring, J. 1989. Turbulence and draft. *ASHRAE Journal* 31(4):18-25.
- Fobelets, A.P.R. and A.P. Gagge. 1988. Rationalization of the ET* as a measure of the enthalpy of the human environment. *ASHRAE Transactions* 94:1.
- Gagge, A.P. 1937. A new physiological variable associated with sensible and insensible perspiration. *American Journal of Physiology* 20(2):277-87.
- Gagge, A.P., A.C. Burton, and H.D. Bazett. 1971. A practical system of units for the description of heat exchange of man with his environment. *Science* 94:428-30.
- Gagge, A.P. and J.D. Hardy. 1967. Thermal radiation exchange of the human by partitioned calorimetry. *Journal of Applied Physiology* 23:248.
- Gagge, A.P., A.P. Fobelets, and L.G. Berglund. 1986. A standard predictive index of human response to the thermal environment. *ASHRAE Transactions* 92(2B).
- Gagge, A.P., Y. Nishi, and R.G. Nevins. 1976. The role of clothing in meeting FEA energy conservation guidelines. *ASHRAE Transactions* 82(2): 234.
- Gagge, A.P., G.M. Rapp, and J.D. Hardy. 1967a. The effective radiant field and operative temperature necessary for comfort with radiant heating. *ASHRAE Transactions* 73(1):I.2.1.
- Gagge, A.P., G.M. Rapp, and J.D. Hardy. 1967b. The effective radiant field and operative temperature necessary for comfort with radiant heating. *ASHRAE Journal* 9(5):63.
- Gagge, A.P., J. Stolwijk, and Y. Nishi. 1971. An effective temperature scale based on a simple model of human physiological regulatory response. *ASHRAE Transactions* 77(1):247-62.
- Gagge, A.P., J.A.J. Stolwijk, and B. Saltin. 1969a. Comfort and thermal sensation and associated physiological responses during exercise at various ambient temperatures. *Environmental Research* 2:209.
- Gagge, A.P., J.A.J. Stolwijk, and Y. Nishi. 1969b. The prediction of thermal comfort when thermal equilibrium is maintained by sweating. *ASHRAE Transactions* 75(2):108.
- Gonzalez, R.R., L.G. Berglund, and A.P. Gagge. 1978. Indices of thermoregulatory strain for moderate exercise in the heat. *Journal of Applied Physiology* 44:889.
- Green, G.H. 1982. Positive and negative effects of building humidification. *ASHRAE Transactions* 88(1):1049-61.
- Gwosdow, A.R., J.C. Stevens, L. Berglund, and J.A.J. Stolwijk. 1986. Skin friction and fabric sensations in neutral and warm environments. *Textile Research Journal* 56:574-80.
- Hardy, J.D. 1949. Heat transfer. In *Physiology of heat regulation and science of clothing*. eds. L.H. Newburgh and W.B. Saunders Ltd., London, 78.
- Hardy, J.D. 1961. Physiological effects of high intensity infrared heating. *ASHRAE Journal* 4:11.
- Hardy, J.D., J.A.J. Stolwijk, and A.P. Gagge. 1971. Man. In *Comparative physiology of thermoregulation*, Chapter 5. Charles C. Thomas, Springfield, IL.
- Hardy, J.D., H.G. Wolf, and H. Goodell. 1952. *Pain sensations and reactions*. Williams and Wilkins, Baltimore.
- Hensel, H. 1973. Temperature reception and thermal comfort. *Archives des Sciences Physiologiques* 27:A359-A370.
- Hensel, H. 1981. *Thermoreception and temperature regulation*. Academic Press, London.
- Holmér, I. 1984. Required clothing insulation (IREQ) as an analytical index of cold stress. *ASHRAE Transactions* 90(1B):1116-28.
- Houghten, F.C. and C.P. Yaglou. 1923. ASHVE Research Report No. 673. *ASHVE Transactions* 29:361.
- Humphreys, M. and J.F. Nicol. 1998. Understanding the adaptive approach to thermal comfort. *ASHRAE Technical Data Bulletin* 14(1):1-14.
- Jones, B.W., K. Hsieh, and M. Hashinaga. 1986. The effect of air velocity on thermal comfort at moderate activity levels. *ASHRAE Transactions* 92:2.
- Korsgaard, V. 1949. Necessity of using a directional mean radiant temperature to describe thermal conditions in rooms. *Heating, Piping and Air Conditioning* 21(6):117-20.
- Kuno, S. 1995. Comfort and pleasantness. In *Proceedings of Pan Pacific Symposium on Building and Urban Environmental Conditioning in Asia*, 2:383-92. Architecture Department, University of Nagoya, Japan.
- Langkilde, G. 1979. Thermal comfort for people of high age. In *Confort thermique: Aspects physiologiques et psychologiques*, INSERM, Paris 75:187-93.
- Leithead, C.S. and A.R. Lind. 1964. *Heat stress and heat disorders*. Cassell & Co., London, 108. (F.A. Davis, Philadelphia, 1964).
- Lipkin, M. and J.D. Hardy 1954. Measurement of some thermal properties of human tissues. *Journal of Applied Physiology* 7:212.
- Liviana, J.E., F.H. Rohles, and O.D. Bullock. 1988. Humidity, comfort and contact lenses. *ASHRAE Transactions* 94(1):3-11.
- Matthew, W.H. et al. 1986. Botsball (WGT) performance characteristics and their impact on the implementation of existing military hot weather doctrine. U.S. Army Reserves Institute of Environmental Medicine *Technical Report T 9/86*, April.
- McCullough, E.A. 1986. An insulation data base for military clothing. Institute for Environmental Research *Report* 86-01, Kansas State University, Manhattan.
- McCullough, E.A. and S. Hong. 1994. A data base for determining the decrease in clothing insulation due to body motion. *ASHRAE Transactions* 100(1):765.
- McCullough, E.A. and B.W. Jones. 1984. A comprehensive data base for estimating clothing insulation. IER Technical Report 84-01, Institute for Environmental Research, Kansas State University, Manhattan. (Final report to *ASHRAE Research Project* 411-RP).
- McCullough, E.A., B.W. Jones, and T. Tamura. 1989. A data base for determining the evaporative resistance of clothing. *ASHRAE Transactions* 95(2).
- McCullough, E.A., B.W. Olesen, and S.W. Hong. 1994. Thermal insulation provided by chairs. *ASHRAE Transactions* 100(1):795-802.
- McCutchan, J.W. and C.L. Taylor. 1951. Respiratory heat exchange with varying temperature and humidity of inspired air. *Journal of Applied Physiology* 4:121-35.
- McIntyre, D.A. 1974. The thermal radiation field. *Building Science* 9:247-62.
- McIntyre, D.A. 1976. Overhead radiation and comfort. *The Building Services Engineer* 44:226-32.
- McIntyre, D.A. and I.D. Griffiths. 1975. The effects of uniform and asymmetric thermal radiation on comfort. *CLIMA 2000, 6th International Congress of Climaticity*, Milan.
- McNall, P.E., Jr. and R.E. Biddison. 1970. Thermal and comfort sensations of sedentary persons exposed to asymmetric radiant fields. *ASHRAE Transactions* 76(1):123.
- McNall, P.E., P.W. Ryan, and J. Jaax. 1968. Seasonal variation in comfort conditions for college-age persons in the Middle West. *ASHRAE Transactions* 74(1):IV.2.1-9.

- McNair, H.P. 1973. A preliminary study of the subjective effects of vertical air temperature gradients. British Gas Corporation *Report No. WH/T/R&D/73/94*, London.
- McNair, H.P. and D.S. Fishman. 1974. A further study of the subjective effects of vertical air temperature gradients. British Gas Corporation *Report No. WH/T/R&D/73/94*, London.
- Minard, D. 1961. Prevention of heat casualties in Marine Corps recruits. *Military Medicine* 126:261.
- Mitchell, D. 1974. Convective heat transfer in man and other animals. *Heat loss from animals and man*. Butterworth Publishing, London, 59.
- Nevins, R., R.R. Gonzalez, Y. Nishi, and A.P. Gagge. 1975. Effect of changes in ambient temperature and level of humidity on comfort and thermal sensations. *ASHRAE Transactions* 81(2).
- Nevins, R.G. and A.M. Feyerherm. 1967. Effect of floor surface temperature on comfort: Part IV, Cold floors. *ASHRAE Transactions* 73(2):III.2.1.
- Nevins, R.G. and A.O. Flinner. 1958. Effect of heated-floor temperatures on comfort. *ASHRAE Transactions* 64:175.
- Nevins, R.G., K.B. Michaels, and A.M. Feyerherm. 1964. The effect of floor surface temperature on comfort: Part I, College age males; Part II, College age females. *ASHRAE Transactions* 70:29.
- Nevins, R.G., F.H. Rohles, Jr., W.E. Springer, and A.M. Feyerherm. 1966. Temperature-humidity chart for thermal comfort of seated persons. *ASHRAE Transactions* 72(1):283.
- Nicol, J.F. and M.A. Humphreys. 1972. Thermal comfort as part of a self-regulating system. Proceedings of CIB symposium on thermal comfort, Building Research Station, London.
- NIOSH. 1986. Criteria for a recommended standard—Occupational exposure to hot environments, revised criteria. U.S. Dept. of Health and Human Services, USDHHS (NIOSH) *Publication* 86-113. Available from www.cdc.gov/NIOSH/86-113.html.
- Nishi, Y. 1981. Measurement of thermal balance of man. In *Bioengineering thermal physiology and comfort*, K. Cena and J.A. Clark, Elsevier, eds. New York.
- Nishi, Y. and A.P. Gagge. 1970. Direct evaluation of convective heat transfer coefficient by naphthalene sublimation. *Journal of Applied Physiology* 29:830.
- Nishi, Y., R.R. Gonzalez, and A.P. Gagge. 1975. Direct measurement of clothing heat transfer properties during sensible and insensible heat exchange with thermal environment. *ASHRAE Transactions* 81(2):183.
- Olesen, B.W. 1977a. Thermal comfort requirements for floors. In *Proceedings of Commissions B1, B2, E1 of the IIR*, Belgrade, 337-43.
- Olesen, B.W. 1977b. Thermal comfort requirements for floors occupied by people with bare feet. *ASHRAE Transactions* 83(2).
- Olesen, B.W. and R. Nielsen. 1983. Thermal insulation of clothing measured on a moveable manikin and on human subjects. Technical University of Denmark, Lyngby, Denmark.
- Olesen, B.W., M. Scholer, and P.O. Fanger. 1979. Vertical air temperature differences and comfort. In *Indoor climate*, eds. P.O. Fanger and O. Valbjorn, 561-79. Danish Building Research Institute, Copenhagen.
- Olesen, S., J.J. Bassing, and P.O. Fanger. 1972. Physiological comfort conditions at sixteen combinations of activity, clothing, air velocity and ambient temperature. *ASHRAE Transactions* 78(2):199.
- Olesen, B.W., E. Sliwiska, T.L. Madsen, and P.O. Fanger. 1982. Effect of posture and activity on the thermal insulation of clothing. Measurement by a movable thermal manikin. *ASHRAE Transactions* 82(2):791-805.
- Onkaram, B., L. Stroschein, and R.F. Goldman. 1980. Three instruments for assessment of WBGT and a comparison with WGT (Botsball). *American Industrial Hygiene Association* 41:634-41.
- Oohori, T., L.G. Berglund, and A.P. Gagge. 1984. Comparison of current two-parameter indices of vapor permeation of clothing—As factors governing thermal equilibrium and human comfort. *ASHRAE Transactions* 90(2).
- Ostberg, O. and A.G. McNicholl. 1973. The preferred thermal conditions for “morning” and “evening” types of subjects during day and night—Preliminary results. *Build International* 6(1):147-57.
- Passmore, R. and J.V.G. Durnin. 1967. *Energy, work and leisure*. Heinemann Educational Books, London.
- Rapp, G. and A.P. Gagge. 1967. Configuration factors and comfort design in radiant beam heating of man by high temperature infrared sources. *ASHRAE Transactions* 73(2):III.1.1.
- Robinson, et al. 1943. *American Journal of Physiology* 140:168.
- Rohles, F.H., Jr. 1973. The revised modal comfort envelope. *ASHRAE Transactions* 79(2):52.
- Rohles, F.H., Jr. and M.A. Johnson. 1972. Thermal comfort in the elderly. *ASHRAE Transactions* 78(1):131.
- Rohles, F.H., Jr. and R.G. Nevins. 1971. The nature of thermal comfort for sedentary man. *ASHRAE Transactions* 77(1):239.
- Seppanen, O., P.E. McNall, D.M. Munson, and C.H. Sprague. 1972. Thermal insulating values for typical indoor clothing ensembles. *ASHRAE Transactions* 78(1):120-30.
- Siple, P.A. and C.F. Passel. 1945. Measurements of dry atmospheric cooling in subfreezing temperatures. In *Proceedings of the American Philosophical Society* 89:177.
- Stolwijk, J.A.J., A.P. Gagge, and B. Saltin. 1968. Physiological factors associated with sweating during exercise. *Journal of Aerospace Medicine* 39:1101.
- Stolwijk, J.A.J. and J.D. Hardy. 1966. Partitional calorimetric studies of response of man to thermal transients. *Journal of Applied Physiology* 21:967.
- Sullivan, C.D. and R.L. Gorton. 1976. A method of calculating WBGT from environmental factors. *ASHRAE Transactions* 82(2):279.
- Tanabe, S., K. Kimura, and T. Hara. 1987. Thermal comfort requirements during the summer season in Japan. *ASHRAE Transactions* 93(1):564-77.
- Umbach, K.H. 1980. Measuring the physiological properties of textiles for clothing. *Melliand Textilberichte* (English edition) G1:543-48.
- Webb, P. 1964. *Bioastronautics data base*, NASA.
- Winslow, C.-E.A., L.P. Herrington, and A.P. Gagge. 1937. Relations between atmospheric conditions, physiological reactions and sensations of pleasantness. *American Journal of Hygiene* 26(1):103-15.
- Witherspoon, J.M., R.F. Goldman, and J.R. Breckenridge. 1971. Heat transfer coefficients of humans in cold water. *Journal de Physiologie*, Paris, 63:459.
- Woodcock, A.H. 1962. Moisture transfer in textile systems. *Textile Research Journal* 8:628-33.

BIBLIOGRAPHY

- Fanger, P.O., A. Melikov, H. Hanzawa, and J. Ring. 1988. Air turbulence and sensation of draught. *Energy and Buildings* 12:21-39.