



Standard Specification for Pressure-rated Polypropylene (PP) Piping Systems¹

This standard is issued under the fixed designation F2389; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ε) indicates an editorial change since the last revision or reapproval.

1. Scope*

1.1 This specification establishes requirements for polypropylene (PP) piping system components made to metric sizes and IPS schedule 80 sizes, and pressure rated for water service and distribution supply (see [Appendix X1](#)). Included are criteria for materials, workmanship, dimensions and tolerances, product tests, and marking for polypropylene (PP) piping system components such as pipe, fittings, valves, and manifolds.

1.2 The components governed by this specification shall be permitted for use in water service lines, hot-and-cold water distribution, hydronic heating, and irrigation systems.

1.3 The pipe and fittings produced under this specification shall be permitted to be used to transport industrial process fluids, effluents, slurries, municipal sewage, etc. The user shall consult the manufacturer to determine whether the material being transported is compatible with the polypropylene piping system and will not affect the service life beyond limits acceptable to the user.

1.4 *Units*—The values stated in inch-pound units are to be regarded as standard. The values given in parentheses are mathematical conversions to SI units that are provided for information only and are not considered standard.

1.5 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory requirements prior to use.*

2. Referenced Documents

2.1 ASTM Standards:²

[D792](#) Test Methods for Density and Specific Gravity (Relative Density) of Plastics by Displacement

[D1238](#) Test Method for Melt Flow Rates of Thermoplastics by Extrusion Plastometer

[D1505](#) Test Method for Density of Plastics by the Density-Gradient Technique

[D1598](#) Test Method for Time-to-Failure of Plastic Pipe Under Constant Internal Pressure

[D1600](#) Terminology for Abbreviated Terms Relating to Plastics

[D2122](#) Test Method for Determining Dimensions of Thermoplastic Pipe and Fittings

[D2749](#) Symbols for Dimensions of Plastic Pipe Fittings

[D3895](#) Test Method for Oxidative-Induction Time of Polyolefins by Differential Scanning Calorimetry

[D4101](#) Specification for Polypropylene Injection and Extrusion Materials

[F412](#) Terminology Relating to Plastic Piping Systems

[F2023](#) Test Method for Evaluating the Oxidative Resistance of Crosslinked Polyethylene (PEX) Tubing and Systems to Hot Chlorinated Water

2.2 International Organization for Standardization (ISO) Standards:

[ISO 3127](#) Thermoplastic Pipes—Determination of Resistance to External Blows—Round the Clock Method³

[ISO 4065](#) Thermoplastics Pipes—Universal Wall Thickness Table³

[ISO 9080](#) Plastics Piping and Ducting Systems—Determination of the Long-Term Hydrostatic Strength of Thermoplastics Materials in Pipe Form by Extrapolation³

[ISO 9393-2](#) Thermoplastics valves for industrial applications - Pressure test methods and requirements - Part 2: Test conditions and basic requirements

[ISO 15874-2:2002](#) Plastics Piping Systems for Hot and Cold Water Installations—Polypropylene (PP)—Part 2: Pipes³

[ISO 15874-3:2002](#) Plastics Piping Systems for Hot and Cold Water Installations—Polypropylene (PP)—Part 3: Fittings³

[ISO/TS 15874-7](#) Plastics Piping Systems for Hot and Cold Water Installations—Polypropylene (PP)—Part 7: Guidance for the Assessment of Conformity³

¹ This specification is under the jurisdiction of ASTM Committee [F17](#) on Plastic Piping Systems and is the direct responsibility of Subcommittee [F17.61](#) on Water. Current edition approved Aug. 1, 2015. Published August 2015. Originally approved in 2004. Last previous edition approved in 2010 as F2389-10. DOI: 10.1520/F2389-15.

² For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

³ Available from International Organization for Standardization (ISO), 1, ch. de la Voie-Creuse, Case postale 56, CH-1211, Geneva 20, Switzerland, <http://www.iso.ch>.

*A Summary of Changes section appears at the end of this standard

2.3 NSF International Standards:

NSF/ANSI 14 Plastics Piping System Components and Related Materials⁴

NSF/ANSI 61 Drinking Water System Components—Health Effects⁴

2.4 European Norm:

prEN 10226-1 Pipe Threads Where Pressure Tight Joints are Made on the Threads—Part 1: Designation, Dimensions and Tolerances⁵

2.5 American Society of Mechanical Engineers (ASME) Standard:

B1.20.1 Pipe Threads, General Purpose, Inch⁶

2.6 Plastic Pipe Institute (PPI) Technical Report:

TR-4 PPI Listing of Hydrostatic Design Basis (HDB), Strength Design Basis (SDB), Pressure Design Basis (PDB) and Minimum Required Strength (MRS) Ratings for Thermoplastic Piping Materials⁷

3. Terminology

3.1 Definitions:

3.1.1 Definitions are in accordance with Terminology F412 and abbreviations are in accordance with Terminology D1600, unless otherwise specified.

3.2 Definitions of Terms Specific to This Standard:

3.2.1 *polypropylene random copolymer (PP-R)*, *n*—a propylene plastic containing not more than 50 % of another olefinic monomer (or monomers), having no functional group other than the olefinic group, copolymerized with the propylene.

3.2.1.1 *Discussion*—This term is also used for finished compound which comprises the PP-R resin and additives such as colorants, UV inhibitors, and stabilizers. Polypropylene random copolymers containing more than one additional monomer are often referred to as “terpolymers.”

3.2.2 *plastic-to-metal transition fittings*, *n*—a fitting designed to provide a means of connection between the PP piping system and metal piping systems such as steel pipe and copper tubing. The fittings include a means of taking into account the differences in thermal expansion of the materials and maintaining a pressure-tight seal over the intended use temperature range.

4. Classification

4.1 *General*—This specification covers PP piping systems made from PP materials (PP-R) in various dimension ratios and pressure ratings.

4.2 *Thermoplastic Pipe Series and Schedule*—This specification covers PP pipe made in schedule 80 IPS sizes and metric sizes in accordance with ISO 4065.

5. Materials and Manufacture

5.1 The pipe and fittings shall be polypropylene material of type PP-R in accordance with Specification D4101. Clean rework material, of the same PP-R resin generated from the manufacturer’s own pipe or fitting production, shall be permitted to be used provided the pipe or fittings produced meet all requirements of this specification.

5.2 For pipe compound, the melt flow rate (MFR) shall not exceed 10.8 grain/10 min (0.7 g/10 min), when tested in accordance with Test Method D1238 using conditions of 4.76 lbm (2.16 kg) at 446°F (230°C).

5.3 The density of the unreinforced, natural color PP material shall not exceed 56.9 lbf/ft³ (912 kg/m³), when tested in accordance with Test Method D1505 or Test Method D792.

5.4 *Minimum Required Strength (MRS)*—The PP material used in the pipe and fittings shall have an MRS value of 1160 psi (8.0 MPa) or 1450 psi (10.0 MPa) based on testing in accordance with ISO 9080 and classification of the lower confidence limit (σ_{LCL}) at 50 years in accordance with ISO 12162.

5.5 *Categorized Required Strength (CRS_{0,t})*—The PP material used in the pipe and fittings shall have a CRS_{0,t} value of 280 psi (1.93 MPa) based on testing in accordance with ISO 9080 and classification of the lower confidence limit (σ_{LCL}) at 180°F (82°C) and 50 years.

5.6 *Minimum Pressure Rating*—The minimum pressure rating of the pipe shall be 160 psi (1.1 MPa) at 73°F (23°C) and 100 psi (0.69 MPa) at 180°F (82°C) for hot-and-cold distribution and 160 psi (1.1 MPa) at 73°F (23°C) for cold water service.

5.7 *Threads*—Fittings shall be permitted to be threaded by use of metal inserts molded into the fitting.

5.7.1 Metal threads shall be constructed of brass or stainless steel inserts molded into the fitting.

5.7.2 Threads shall not be molded or fabricated directly into the polypropylene plastic.

5.8 The piping compound shall be permitted to include colorants, antioxidants, reinforcing materials and additives necessary for the finished product. The modified material and finished product shall meet all requirements of this specification.

NOTE 1—The Plastics Pipe Institute (PPI) publishes listings of minimum required strength (MRS) and categorized required strength (CRS_{0,t}) ratings for thermoplastic piping materials in Technical Report No. 4 (TR-4). ISO/TS 15874-7 provides guidance on evaluating the effect of additives on long-term strength of the pipe and fittings material.

6. Workmanship, Finish, and Appearance

6.1 The pipe and fittings shall be free of visible cracks, holes, foreign inclusions, blisters and other known injurious defects. The pipe and fittings shall be uniform in color, opacity, density and other physical properties.

7. Dimensions and Tolerances

7.1 *Pipe Dimensions*—Pipe dimensions shall meet the requirements in 7.1.1 and 7.1.2.

⁴ Available from the Deutsches Institut für Normung, Burggrafenstrasse 6, 10787 Berlin, Germany.

⁵ Available from NSF International, P.O. Box 130140, 789 N. Dixboro Rd., Ann Arbor, MI 48113-0140, <http://www.nsf.org>.

⁶ European Committee for Standardization, 36, rue de Stassart, B-1050 Brussels.

⁷ Available from Plastics Pipe Institute (PPI), 105 Decker Court, Suite 825, Irving, TX 75062, <http://www.plasticpipe.org>.

7.1.1 Outside Diameters—The outside diameters and tolerances shall be as shown in **Table 1** (IPS Sch. 80), or **Tables 2 and 3** (metric series), when measured in accordance with Test Method **D2122**. For diameters not shown in these tables, the tolerance shall be the same percentage of outside diameter as those for the closest listed diameter.

7.1.2 Wall Thicknesses—The wall thicknesses and tolerances shall be as shown in **Table 1**, or **Tables 2 and 3**, when measured in accordance with Test Method **D2122**. For wall thicknesses (DR's) not shown in these tables, the minimum wall thickness shall be as calculated using the DR and outside diameter, and the tolerance on the wall thickness shall be the same percentage of the calculated minimum wall thickness as for the closest listed minimum wall thickness.

7.1.3 Threaded Pipe—Pipe covered by this specification shall not be threaded.

7.2 Fittings Dimensions—Fittings dimensions shall meet the requirements in **7.2.1** through **7.2.4**.

7.2.1 Threads—Taper threads for joining fittings shall comply with the requirements of ASME B1.20.1 for NPT metal thread inserts or prEN 10226-1 for metric threads. Threads used by the manufacturer to join component parts of a fitting together shall meet the manufacturer's specifications.

7.2.2 Laying Lengths—Laying lengths shall be in accordance with the manufacturer's specifications.

7.2.3 Socket-fused Fittings—Dimensions for socket-fused fittings shall be in accordance with **Tables 4 and 5** (IPS Sch 80) or **Tables 6 and 7** (metric series). Socket depth shall be measured from the face of the socket entrance to the face of the pipe stop at the socket bottom.

7.2.4 Electrofusion Fittings—Dimensions for electrofusion fittings shall be in accordance with manufacturer's specifications.

7.2.5 Valves and Flanges—Dimensions for valves and flanges shall be in accordance with the manufacturer's specifications.

8. Requirements

8.1 Longitudinal Reversion—When tested in accordance with ISO 15874-2, at the conditions given in **Table 8**, the mean relative change in pipe length shall not exceed 2 %.

8.2 Melt Flow Rate (MFR) of Pipe and Fittings—When tested in accordance with D1238, the MFR of specimens taken from the finished pipe or fittings shall be within 30 % of the MFR of the compound used to produce the pipe or fitting. Two specimens shall be tested, and both shall pass.

8.3 Impact Strength—When tested in accordance with ISO 3127, 9 of 10 specimens shall pass at the impact level specified in **Table 9** at a test temperature of $32 \pm 2^\circ\text{F}$ ($0 \pm 1^\circ\text{C}$).

8.4 Thermal Stability and Oxidative Induction Time (OIT)—Pipe and fittings shall meet the requirements of **8.4.1**—thermal stability by hydrostatic testing, and **8.4.2**—oxidative induction time.

8.4.1 When tested in accordance with Test Method **D1598**, pipe and fittings shall not fail at the pressure corresponding to the pipe circumferential stresses and times given in **Table 10**. If an assembly fails at a joint, the fitting material shall be permitted to be retested in pipe form.

8.4.2 The oxidative induction time (OIT) shall be determined on pipe and fittings in accordance with Test Method **D3895**. Two specimens shall be tested and the average OIT of the two shall be at least 80 % of the OIT of the virgin material compound. For those materials which require final blending at the extruder (masterbatch/resin), the 80% OIT requirement shall be based on the OIT of the pipe sample which has also passed the hydrostatic testing of **8.4.1** or a pipe sample of the same formulation containing no rework.

NOTE 2—Initial qualification of changes to materials that have met the requirements of this section may be evaluated based on limited hydrostatic testing and comparison of OIT values.

8.5 Hydrostatic Pressure Tests—When tested in accordance with **9.1**, at the hoop stresses and temperatures given in **Table 11**, assemblies of pipe and fittings shall not fail during the test period specified.

8.6 Thermocycling—Plastic-to-metal transition fittings, intended to be used at temperatures above 113°F (45°C) shall not separate or leak during or after being thermocycled 1000 times between the temperatures of 60°F and 180°F (16°C and 82°C). Transition fittings which meet the thermal cycling requirements of ISO 15874-5 for the intended application class are exempt from this requirement. Fittings shall be assembled with pipe per the manufacturer's instructions, and tested in accordance with **9.2**.

8.7 Oxidative Stability in Potable Chlorinated Water Applications—PP piping intended for use in the transport of potable water shall have a minimum extrapolated time-to-time failure of 50 years when tested and evaluated in accordance with **9.3**.

9. Test Methods

9.1 Hydrostatic Tests—Test pipe and fitting assemblies in accordance with Test Method **D1598**, at the hoop stresses and

TABLE 1 IPS Schedule 80 OD and Wall Thickness

Nominal Pipe Size	Average Outside Diameter, OD, in.	Tolerance on OD, in.		Out-of-roundness (max–min)		Minimum Wall Thickness, in.		Tolerance on Wall Thickness, in.	
1/2	0.840	(21.34)	±0.004	(±0.10)	0.015	(0.38)	0.147	(3.73)	+0.020 (+0.51)
3/4	1.050	(26.67)	±0.004	(±0.10)	0.020	(0.51)	0.154	(3.91)	+0.020 (+0.51)
1	1.315	(33.40)	±0.005	(±0.13)	0.025	(0.64)	0.179	(4.55)	+0.021 (+0.53)
1-1/2	1.900	(48.26)	±0.006	(±0.15)	0.030	(0.76)	0.200	(5.08)	+0.024 (+0.61)
2	2.375	(60.33)	±0.006	(±0.15)	0.035	(0.89)	0.218	(5.54)	+0.026 (+0.66)
3	3.500	(88.90)	±0.008	(±0.20)	0.040	(1.02)	0.300	(7.62)	+0.036 (+0.91)
4	4.500	(114.30)	±0.009	(±0.23)	0.050	(1.27)	0.337	(8.56)	+0.040 (+1.02)
6	6.625	(168.28)	±0.011	(±0.28)	0.050	(1.27)	0.432	(10.97)	+0.052 (+1.32)

TABLE 2 Metric Sizes OD

Nominal Size	Outside Diameter, OD					
	Minimum Average OD, in.		Maximum Average OD, in.		Maximum Out-of-roundness, in.	
16	0.630	(16.0)	0.642	(16.3)	0.016	(0.4)
20	0.787	(20.0)	0.799	(20.3)	0.016	(0.4)
25	0.984	(25.0)	0.996	(25.3)	0.016	(0.4)
32	1.260	(32.0)	1.272	(32.3)	0.020	(0.5)
40	1.575	(40.0)	1.591	(40.4)	0.020	(0.5)
50	1.969	(50.0)	1.988	(50.5)	0.024	(0.6)
63	2.480	(63.0)	2.504	(63.6)	0.024	(0.6)
75	2.953	(75.0)	2.980	(75.7)	0.039	(1.0)
90	3.543	(90.0)	3.579	(90.9)	0.039	(1.0)
110	4.331	(110.0)	4.370	(111.0)	0.039	(1.0)
125	4.921	(125.0)	4.969	(126.2)	0.051	(1.3)
140	5.512	(140.0)	5.563	(141.3)	...	...
160	6.299	(160.0)	6.358	(161.5)	...	...
200	7.874	(200.0)	7.953	(202.0)	...	...
250	9.842	(250.0)	9.941	(252.5)	...	...
280	11.023	(280.0)	11.142	(283.0)	...	...
315	12.401	(315.0)	12.528	(318.2)	...	...
355	13.976	(355.0)	14.118	(358.6)	...	...

temperatures given in **Table 11**. An assembly shall consist of at least 4 pipe specimens and 6 fitting joints. For testing valves, the assembly shall include at least 3 valves in the shut-off position (seat test) and 3 valves in the open or partially open position (shell test). Assemblies used in testing of manifolds shall include a minimum of 6 of each type of manifold connection.

9.1.1 Valves shall be tested in accordance with, and comply with the requirements of each of the following tests of ISO 9393-2.

9.1.1.1 Shell Test,

9.1.1.2 Long-term Behavior Test on Complete Valve, and

9.1.1.3 Seat and Packing Tests.

9.1.2 *Hydrostatic test of panels and other appurtenances*—Polypropylene radiant panels and other appurtenances shall be tested in accordance with Test Method **D1598** at the conditions specified in **Table 12**. A minimum of three representative samples shall be tested.

9.1.3 *Assembly Procedure*—The assemblies shall be made in accordance with the manufacturer’s recommended joining procedures and equipment.

9.2 *Thermocycling Test Method for Transition Fittings*:

9.2.1 *Apparatus*—A nitrogen or air source capable of maintaining a nominal internal pressure of 100 ± 10 psi (690 ± 69 kPa) on the specimens is required. The immersion system shall consist of two water reservoirs controlled at $60 \pm 3.6^\circ\text{F}$ ($16 \pm 2^\circ\text{C}$) and $180 \pm 3.6^\circ\text{F}$ ($82 \pm 2^\circ\text{C}$). The specimens shall be cycled from one reservoir to the other or the hot and cold water shall be alternately cycled over the test specimens automatically and returned to the proper reservoir.

9.2.2 *Sampling and Specimen Preparation*—Select at random six specimens of the type and size of plastic-to-metal transition fittings to be tested. Assemble the fittings with suitable lengths of pipe or tubing and attach to a common manifold. Assemble strictly in accordance with the instructions of the fitting manufacturer. Close the specimen assembly with any suitable end closures that allow “free-end” mounting and will not leak under the thermocycling conditions, and connect the specimen assembly to the pressure source.

9.2.3 *Procedure*—Pressure the specimen assembly with nitrogen to 100 ± 10 psi (690 ± 69 kPa). Immerse in $60 \pm 3.6^\circ\text{F}$ ($16 \pm 2^\circ\text{C}$) water to determine if there are any initial leaks. All leaks shall be eliminated before the thermocycling test is started. Thermally cycle the specimen assembly between $60 \pm 3.6^\circ\text{F}$ ($16 \pm 2^\circ\text{C}$) and $180 \pm 3.6^\circ\text{F}$ ($82 \pm 2^\circ\text{C}$) by means of immersion in water using the test cycle given in **Table 13**. For sizes greater than 1-1/2 in. (40 mm), shorter dwell times shall be permitted if it has been demonstrated that the shorter time is sufficient to achieve the test temperature at the internal surface of the fitting. Upon completion of the 1000 cycles, immerse the specimen assembly in $60 \pm 3.6^\circ\text{F}$ ($16 \pm 2^\circ\text{C}$) water to determine if there are any leaks.

9.2.4 *Interpretation of Results*—Any evidence of leakage at any one of the transition fittings or separation of any transition fitting from the pipe or tubing constitutes a failure of this test.

9.3 *Oxidative Stability in Potable Chlorinated Water Applications*—The test shall be conducted, and the extrapolated time-to-failure shall be determined in accordance with Test Method **F2023**. The test fluid shall be reverse-osmosis (RO) or deionized (DI) water prepared in accordance with 9.1.1 of Test Method **F2023**.

9.3.1 *Significance*—The test need only be performed on representative pipe samples for the original validation of pipe made from a particular compound.

10. Retest and Rejection

10.1 If the results of any test(s) do not meet the requirements of this specification, the test(s) shall be permitted to be conducted again in accordance with an agreement between the purchaser and the seller. There shall be no agreement to lower the minimum requirement of the specification by such means as omitting tests that are a part of the specification, substituting or modifying a test method, or by changing the specification limits. In retesting, the product requirements of this specification shall be met, and the test methods designated in the specification shall be followed. If, upon retest, failure occurs, the quantity of product represented by the test(s) does not meet the requirements of this specification.

TABLE 4 IPS Sch 80 Socket-weld Fittings

Nominal Size	Socket Entrance, A					Socket Bottom, B				
	Average, in.	Tolerance on Average, in.		Maximum Out-of-roundness, in.		Average, in.	Tolerance on Average, in.		Maximum Out-of-roundness, in.	
1/2	0.840 (21.34)	±0.010	(±0.25)	0.012	(0.30)	0.794 (20.17)	±0.005	(±0.13)	0.012	(0.30)
3/4	1.050 (26.67)	±0.010	(±0.25)	0.012	(0.30)	1.000 (25.40)	±0.007	(±0.18)	0.012	(0.30)
1	1.311 (33.30)	±0.010	(±0.25)	0.016	(0.41)	1.258 (31.95)	±0.007	(±0.18)	0.012	(0.30)
1-1/2	1.898 (48.21)	±0.012	(±0.30)	0.016	(0.41)	1.830 (46.48)	±0.007	(±0.18)	0.015	(0.38)
2	2.383 (60.53)	±0.012	(±0.30)	0.016	(0.41)	2.308 (58.62)	±0.007	(±0.18)	0.015	(0.38)
3	3.513 (89.23)	±0.012	(±0.30)	0.040	(1.02)	3.427 (87.05)	±0.010	(±0.25)	0.020	(0.51)
4	4.522 (114.86)	±0.015	(±0.38)	0.040	(1.02)	4.417 (112.19)	±0.010	(±0.25)	0.020	(0.51)
6	6.656 (169.06)	±0.032	(±0.81)	0.050	(1.27)	6.512 (165.40)	±0.012	(±0.30)	0.040	(1.02)

TABLE 5 IPS Sch 80 Socket-weld Fittings

Nominal Size	Socket depth, C				Wall Thickness			
	Min, in.		Max, in.		Socket, E, Min, in.		Body, F, Min, in.	
1/2	0.835	(21.21)	0.865	(21.97)	0.147	(3.73)	0.185	(4.70)
3/4	0.960	(24.38)	0.990	(25.15)	0.154	(3.91)	0.195	(4.95)
1	1.085	(27.56)	1.115	(28.32)	0.179	(4.55)	0.225	(5.72)
1-1/2	1.335	(33.91)	1.365	(34.67)	0.200	(5.08)	0.250	(6.35)
2	1.460	(37.08)	1.490	(37.85)	0.218	(5.54)	0.275	(6.99)
3	1.830	(46.48)	1.860	(47.24)	0.300	(7.62)	0.375	(9.53)
4	2.205	(56.01)	2.235	(56.77)	0.337	(8.56)	0.420	(10.67)
6	2.955	(75.06)	2.985	(75.82)	0.432	(11.0)	0.540	(13.72)

TABLE 6 Metric Series Socket-weld Fittings

Nominal Size	Socket Entrance, A					Socket Bottom, B				
	Minimum Average Diameter, in.		Maximum Average Diameter, in.		Maximum Out-of-roundness, in.	Minimum Average Diameter, in.		Maximum Average Diameter, in.		Maximum Out-of-roundness, in.
16	0.598	(15.20)	0.610	(15.50)	0.016 (0.40)	0.594	(15.10)	0.606	(15.40)	0.016 (0.40)
20	0.756	(19.20)	0.768	(19.50)	0.016 (0.40)	0.748	(19.00)	0.760	(19.30)	0.016 (0.40)
25	0.953	(24.20)	0.965	(24.50)	0.016 (0.40)	0.941	(23.90)	0.957	(24.30)	0.016 (0.40)
32	1.224	(31.10)	1.240	(31.50)	0.020 (0.50)	1.217	(30.90)	1.232	(31.30)	0.020 (0.50)
40	1.535	(39.00)	1.551	(39.40)	0.020 (0.50)	1.528	(38.80)	1.543	(39.20)	0.020 (0.50)
50	1.925	(48.90)	1.945	(49.40)	0.024 (0.60)	1.917	(48.70)	1.937	(49.20)	0.024 (0.60)
63	2.437	(61.90)	2.461	(62.50)	0.024 (0.60)	2.425	(61.60)	2.445	(62.10)	0.024 (0.60)
75	2.925	(74.30)	2.949	(74.90)	0.039 (1.00)	2.878	(73.10)	2.902	(73.70)	0.039 (1.00)
90	3.516	(89.30)	3.539	(89.90)	0.039 (1.00)	3.461	(87.90)	3.484	(88.50)	0.039 (1.00)
110	4.307	(109.40)	4.331	(110.00)	0.039 (1.00)	4.240	(107.70)	4.264	(108.30)	0.039 (1.00)
125	4.898	(124.40)	4.921	(125.00)	0.039 (1.00)	4.827	(122.60)	4.850	(123.20)	0.039 (1.00)

TABLE 7 Metric Series Socket-weld Fittings

Nominal Size	Socket Depth, C				Wall Thickness			
	Min, in.		Max, in.		Socket, E, Min, in.		Body, F, Min, in.	
16	0.524	(13.30)	0.622	(15.80)	0.121	(3.06)	0.161	(4.08)
20	0.571	(14.50)	0.669	(17.00)	0.145	(3.69)	0.194	(4.92)
25	0.630	(16.00)	0.728	(18.50)	0.167	(4.25)	0.223	(5.67)
32	0.713	(18.10)	0.811	(20.60)	0.212	(5.38)	0.282	(7.17)
40	0.807	(20.50)	0.906	(23.00)	0.256	(6.50)	0.341	(8.67)
50	0.925	(23.50)	1.024	(26.00)	0.335	(8.50)	0.446	(11.33)
63	1.079	(27.40)	1.177	(29.90)	0.413	(10.50)	0.551	(14.00)
75	1.181	(30.00)	1.319	(33.50)	0.492	(12.50)	0.656	(16.67)
90	1.299	(33.00)	1.496	(38.00)	0.591	(15.00)	0.787	(20.00)
110	1.457	(37.00)	1.732	(44.00)	0.723	(18.38)	0.965	(24.50)
125	1.575	(40.00)	1.850	(47.00)	0.822	(20.88)	1.096	(27.83)

11. Certification

11.1 When specified in the purchase order or contract, a manufacturer's certification shall be furnished to the purchaser that the material was manufactured, sampled, tested and inspected in accordance with this specification, and has been found to meet the requirements. When specified in the purchase order or contract, a report of the test results shall be

furnished. Each certification so furnished shall be signed by an authorized agent of the manufacturer.

12. Product Marking

12.1 Marking on the pipe shall include the following, spaced at intervals of not more than 5 ft (1.5 m):

12.1.1 Manufacturer's name or trademark;

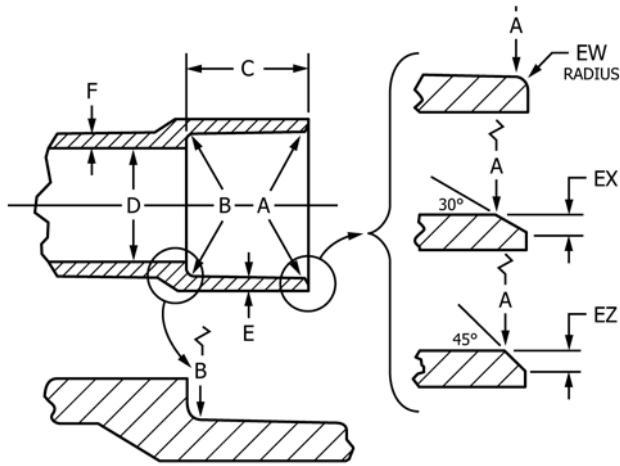


FIG. 1 Socket Dimension Symbols per D2749

TABLE 8 Conditions for Heat Reversion Test

Parameter	Type	Value
Oven Temperature	PP-R	275 ± 4°F (135 ± 2°C)
Exposure Time Based on Wall Thickness, <i>t</i>	<i>t</i> < 0.315 in. (8 mm)	60 min
	0.315 (8 mm) < <i>t</i> < 0.630 in. (16 mm)	120 min
	<i>t</i> > 0.630 in. (16 mm)	240 min

TABLE 9 Impact Conditions

Nominal Diameter	Impact Mass, lb (kg), +0.01/–0.00 (+0.005/–0.000)	Impact Height, ft (m) ² +0.03/–0.00 (+0.01/–0.00)
½, ¾, 1, 16, 20, 25	0.55 (0.250)	3.3 (1.0)
1-½, 2, 3, 32, 40, 50, 63, 75	1.10 (0.500)	3.3 (1.0)
4, 6, 90, 110, 125	2.20 (1.000)	6.6 (2.0)
140	4.41 (2.00)	6.6 (2.0)
160	4.41 (2.00)	8.2 (2.5)

TABLE 10 Thermal Stability by Hydrostatic Test

Hoop Stress, psi, (MPa)	Temperature, °F (°C)	Time, h
275 (1.9)	230 (110)	8 760

TABLE 11 Hydrostatic Test Conditions

Hoop Stress, psi, (MPa)	Temperature, °F (°C)	Time, h
2320 (16.0)	68 (20)	1
510 (3.5)	203 (95)	1000

12.1.2 Nominal pipe size (for example, ½, 32);

12.1.3 Metric series pipe shall be marked with the dimension ratio or both the outside diameter and wall thickness and shall include the term “metric;”

12.1.4 IPS series pipe shall include the marking “SCH 80” or “Schedule 80;”

12.1.5 Type of material (PP-R) and classification number (80 or 100);

TABLE 12 Hydrostatic Test Conditions for Panels and Appurtenances

Test Pressure ^A	Test Temperature °F (°C)	Time, h
3.2 × PMA	68 (20)	1
1.5 × PMA	Max rated temperature	1000

^APMA is the maximum allowable operating pressure of the appurtenance or panel at the test temperature. The Test Pressure is a multiple of PMA, as shown in the table.

TABLE 13 Dwell Times for Transition Fittings Thermocyclic Test

Stage in Cycle	Fitting Nominal Size, IPS (metric)		
	½ to 1-½ (16 to 40)	2 to 3 (50 to 75)	4 to 6 (90 to 125)
Water immersion at 180°F (82°C), min	2 min	15 min	30 min
Air immersion at ambient, max	2 min	2 min	2 min
Water immersion at 16°C (60°F), min	2 min	15 min	30 min
Air immersion at ambient, max	2 min	2 min	2 min

12.1.6 Pressure rating(s) and temperature for which the rating(s) is valid (for example, 355 psi at 73°F, 100 psi at 180°F);

12.1.7 This specification designation, F2389, with which the pipe complies;

12.1.8 Manufacturer’s production code which allows the manufacturer to identify production date and location if producing at different sites; and

12.1.9 Pipe intended for the transport of potable water shall also include the seal or mark of the laboratory making the evaluation for this purpose, spaced at intervals specified by the laboratory.

12.1.10 Pipe intended for the transport of potable water or other water that could include residual free chlorine as a disinfectant shall also include the chlorine resistant destination for which it complies, *CL-TD* for *CL-R*.

12.2 Marking on fittings shall include the following:

12.2.1 Manufacturer’s name or trademark;

12.2.2 Nominal size;

12.2.3 Dimension ratio or schedule of the corresponding pipe, unless the fittings are made as part of a system sold by the manufacturer, and the same fitting design is used for all pipe series produced as part of the system;

12.2.4 Type of material (PP-R);

12.2.5 For threaded fittings, the fitting or the packaging in which the fitting is sold shall include either “Metric” or “NPT” as appropriate. For metric thread fittings, the packaging shall state that the fittings are not interchangeable with, and shall not be used with NPT fittings. For NPT thread fittings, the packaging shall state that the fittings are not interchangeable with, and shall not be used with metric fittings; and

12.2.6 The fitting or the packaging in which the fitting is sold shall include this specification designation, F2389, with which the fitting complies.

12.3 Additional marking for valves and manifolds:



12.3.1 Marking on valves and manifolds shall include all of the required marking for fittings;

12.3.2 Valves designed for flow in one direction shall also include marking designating the flow direction; and

12.3.3 Marking on manifolds shall include the nominal size of the inlet and outlet connections.

13. Quality Assurance

13.1 When the product is marked with this designation, F2389, the manufacturer affirms that the product was

manufactured, inspected, sampled, and tested in accordance with this specification and has been found to meet the requirements of this specification.

14. Keywords

14.1 chlorine; fittings; industrial; municipal; pipe; polypropylene; potable water; process piping; thermoplastic; water

SUPPLEMENTARY REQUIREMENTS

This requirement applies whenever a regulatory authority or user calls for product to be used to convey or be in contact with potable water.

S1. Potable Water Requirements

S1.1 Products intended for the transport of potable water shall be evaluated, tested, and certified for conformance with ANSI/NSF 61, or the health effects portion of ANSI/NSF 14,

by an acceptable certifying organization, when required by the regulatory authority having jurisdiction.

ADDITIONAL SUPPLEMENTARY REQUIREMENTS GOVERNMENT/MILITARY PROCUREMENT

These requirements apply *only* to federal/military procurement, not domestic sales or transfers.

S2. Responsibility for Inspection

S2.1 Unless otherwise specified in the contract or purchase order, the producer is responsible for the performance of all inspection and test requirements specified herein. The producer may use his own or any other suitable facilities for the performance of the inspection and test requirements specified herein, unless the purchaser disapproves. The purchaser shall have the right to perform any of the inspections and tests set forth in this specification where such inspections are deemed necessary to ensure that material conforms to prescribed requirements.

NOTE S1—In federal contracts, the contractor is responsible for inspection.

S3. Packaging and Marking for U.S. Government Procurement

S3.1 *Packaging*—Unless otherwise specified in the contract, the materials shall be packaged in accordance with the supplier's standard practice in a manner ensuring arrival at destina-

tion in satisfactory condition and which will be acceptable to the carrier at lowest rates. Containers and packing shall comply with Uniform Freight Classification rules on National Motor Freight Classification rules.

S3.2 *Marking*—Marking for shipment shall be in accordance with Fed. Std. No. 123 for civil agencies and MIL-STD-129 for military agencies.

NOTE S2—The inclusion of U.S. government procurement requirements should not be construed as an indication that the U.S. government uses or endorses the products described in this specification.

APPENDIX

(Nonmandatory Information)

X1. MINIMUM PRESSURE RATINGS FOR WATER

X1.1 The pressure ratings shown in Tables X1.1 and X1.2 are minimum values. At temperatures of 73°F and 140°F the minimums are based on the ISO 9080 extrapolation criteria, using the Categorized Required Strength ($CRS_{0,t}$) values for these temperatures. At 180°F, the minimums are arbitrarily set to 100 psi to conform with U.S. plumbing codes. This minimum is based on meeting the requirements for Class 5 service conditions (high temperature radiators) as given in ISO 15874-1, with a pressure rating of 100 psi.

X1.1.1 *Pressure rating calculation* - The minimum pressure ratings given in Table X1.1 are calculated as shown in X1.1.2 – X1.1.4.

X1.1.2 The pressure rating is calculated using the lower confidence limit at 50 years and 73°F (sLCL), or alternatively, the MRS value at 68°F (1450 psi minimum for rating at 68°F) and an overall design coefficient, C, of 1.5. For example, the minimum reference curves for PP specify a sLCL 1340 psi at 73°F. Then the pressure rating using DR 6 pipe is calculated as:

$$S = \frac{\sigma_{LCL}}{(1.2 \times 1.25)} = \frac{1430}{(1.5)} = 893 \text{ psi} \quad (X1.1)$$

$$P = \frac{2S}{DR - 1} = \frac{2(893)}{(6 - 1)} = 357 \text{ psi} \approx 355 \text{ psi} \quad (X1.2)$$

X1.1.3 The pressure rating at 140°F is calculated in the same manner as 73°F, but using the σ_{LCL} value at 140°F, 50 years. For the PP-R minimum reference curve, this value is 703 psi. For DR 11 pipe:

$$S = \frac{\sigma_{LCL}}{(1.2 \times 1.25)} = \frac{703}{(1.5)} = 468 \text{ psi} \quad (X1.3)$$

$$P = \frac{2S}{DR - 1} = \frac{2(468)}{(11 - 1)} = 94 \text{ psi} \approx 90 \text{ psi} \quad (X1.4)$$

TABLE X1.2 IPS Schedule 80 Pressure Ratings for Water

Nominal Pipe Size	Temperature	
	73°F (23°C)	140°F (60°C)
1/2	375	200
3/4	305	160
1	280	145
1-1/2	210	110
2	180	95
3	165	85
4	140	75
6	125	65

TABLE X1.3 Example of Miner's Rule Conditions

Temperature °C	Time	
	hr	year
20	...	14
60	...	25
80	...	10
90	...	1
100	100	0.011408
Damage/year,%		2.000
Calculated years		50.0

$$P = \frac{2S}{DR - 1} \frac{2(393/1.5)}{(6 - 1)} = 131 \text{ psi} \approx 100 \text{ psi}$$

For DR 6, the resulting value is 105 psi, arbitrarily lowered to 100 psi. For DR 7.4, however, the minimum reference curve does not result in a rating above 100 psi. Therefore, to achieve this rating the minimum curve for the actual material being used must be sufficiently above the minimum reference curve to meet the 100 psi requirement. The calculations above are only an example based on the minimum reference curve of ISO 15874.

TABLE X1.1 Metric Series Pressure Ratings for Water, psi (MPa)

Temperature, °F (°C)	Dimension Ratio (DR)			
	11	7.4	6	5
73 (23)	180 (1.24)	290 (2.00)	355 (2.45)	440 (3.03)
140 (60)	90 (0.62)	145 (1.00)	185 (1.28)	230 (1.59)
180 (82)	NA ^A	100 (0.69)	100 (0.69)	100 (0.69)

^A DR11 products are not typically used or rated at 180°F.

X1.1.4 The pressure rating at 180°F is calculated based on an application class 5 from ISO 15874-2, but if the calculated pressure exceeds 100 psi, it has been arbitrarily lowered to 100 psi to conform with U.S. plumbing codes. Miner's Rule is used to determine the rating for this application class as follows: For each condition (temperature/stress), an expected fail time can be calculated from the material reference curve. The assumed exposure time to this condition can then be divided by the total predicted fail time for that condition. This ratio represents the amount of damage done to the pipe by this exposure condition/time. As an example, using the times/conditions in Table X1.3 the maximum stress is calculated as 393 psi.



SUMMARY OF CHANGES

Committee F17 has identified the location of selected changes to this standard since the last issue (F2389–10) that may impact the use of this standard.

(1) Revised 9.1.1.

(2) Added Table 12.

ASTM International takes no position respecting the validity of any patent rights asserted in connection with any item mentioned in this standard. Users of this standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their own responsibility.

This standard is subject to revision at any time by the responsible technical committee and must be reviewed every five years and if not revised, either reapproved or withdrawn. Your comments are invited either for revision of this standard or for additional standards and should be addressed to ASTM International Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee, which you may attend. If you feel that your comments have not received a fair hearing you should make your views known to the ASTM Committee on Standards, at the address shown below.

This standard is copyrighted by ASTM International, 100 Barr Harbor Drive, PO Box C700, West Conshohocken, PA 19428-2959, United States. Individual reprints (single or multiple copies) of this standard may be obtained by contacting ASTM at the above address or at 610-832-9585 (phone), 610-832-9555 (fax), or service@astm.org (e-mail); or through the ASTM website (www.astm.org). Permission rights to photocopy the standard may also be secured from the Copyright Clearance Center, 222 Rosewood Drive, Danvers, MA 01923, Tel: (978) 646-2600; <http://www.copyright.com/>