

FABRICATING TOLERANCES

Prepared by
Pipe Fabrication Institute Engineering Committee



All PFI Standards are advisory only. There is no agreement to adhere to any PFI Standard and their use by anyone is entirely voluntary.

Copyright by
PIPE FABRICATION INSTITUTE
*Dedicated to Technical Advancements and Standardization in
the Pipe Fabrication Industry
Since 1913*

USA
PMB 323
611 Pennsylvania Avenue SE
Washington, DC 20003

CANADA
655, 32nd ave, suite 201
Lachine, Quebec
H8T 3G6

WEB SITE
<http://www.pfi-institute.org>

FABRICATING TOLERANCES

METRIC CONVERSIONS

The conversion of quantities between systems of units involves a determination of the number of significant digits to be retained. All conversions depend upon the intended precision of the original quantity and are rounded to the appropriate accuracy.

Pipe sizes together with applicable wall thickness are not shown with metric equivalents.

The SI (metric) values were included with the customary U.S. values in this Standard are the rounded equivalents of the U.S. values and are for reference only.

Metric units were derived utilizing the following conversion factor:

Conversion	Factor
inches to millimeter	25.4

1. Scope

- 1.1 This standard covers general pipe shop fabricating tolerances for prefabricated piping assemblies.

excess of those specified in paragraphs 2.2 and 2.3 may occur.

2. Linear Tolerances

- 2.1 The tolerances on linear dimensions (intermediate or overall) apply to the face to face, face to end, and end to end measurements of fabricated straight pipe and headers; center to end or center to face of nozzles or other attachments; or center to face of bends; as illustrated on Fig. 1. These tolerances are not accumulative.
- 2.2 Linear tolerances on "A" are $\pm 1/8"$ (3.0 mm) for sizes 10" and under, $\pm 3/16"$ (5.0 mm) for sizes 12" through 24" and $\pm 1/4"$ (6.0 mm) for sizes over 24" through 36".
- 2.3 Linear tolerances on "A" for sizes over 36" are subject to tolerances of $\pm 1/4"$ (6.0 mm), increasing by plus or minus $1/16"$ (2.0 mm) for each 12" in diameter over 36".
- 2.4 Due to the cumulative effects of tolerances on fittings or flanges, when joined without intervening pipe segments, deviations in

3. Angularity and Rotation Tolerances

- 3.1 Angularity tolerance across the face of flanges, weld end preparation and on rotation of flanges are as stated on Fig. 1.

4. Closer Tolerances

- 4.1 When closer tolerances than those given in paragraphs 2.2, 2.3 and 2.4 are absolutely necessary, they shall be subject to agreement between the Purchaser and Fabricator.

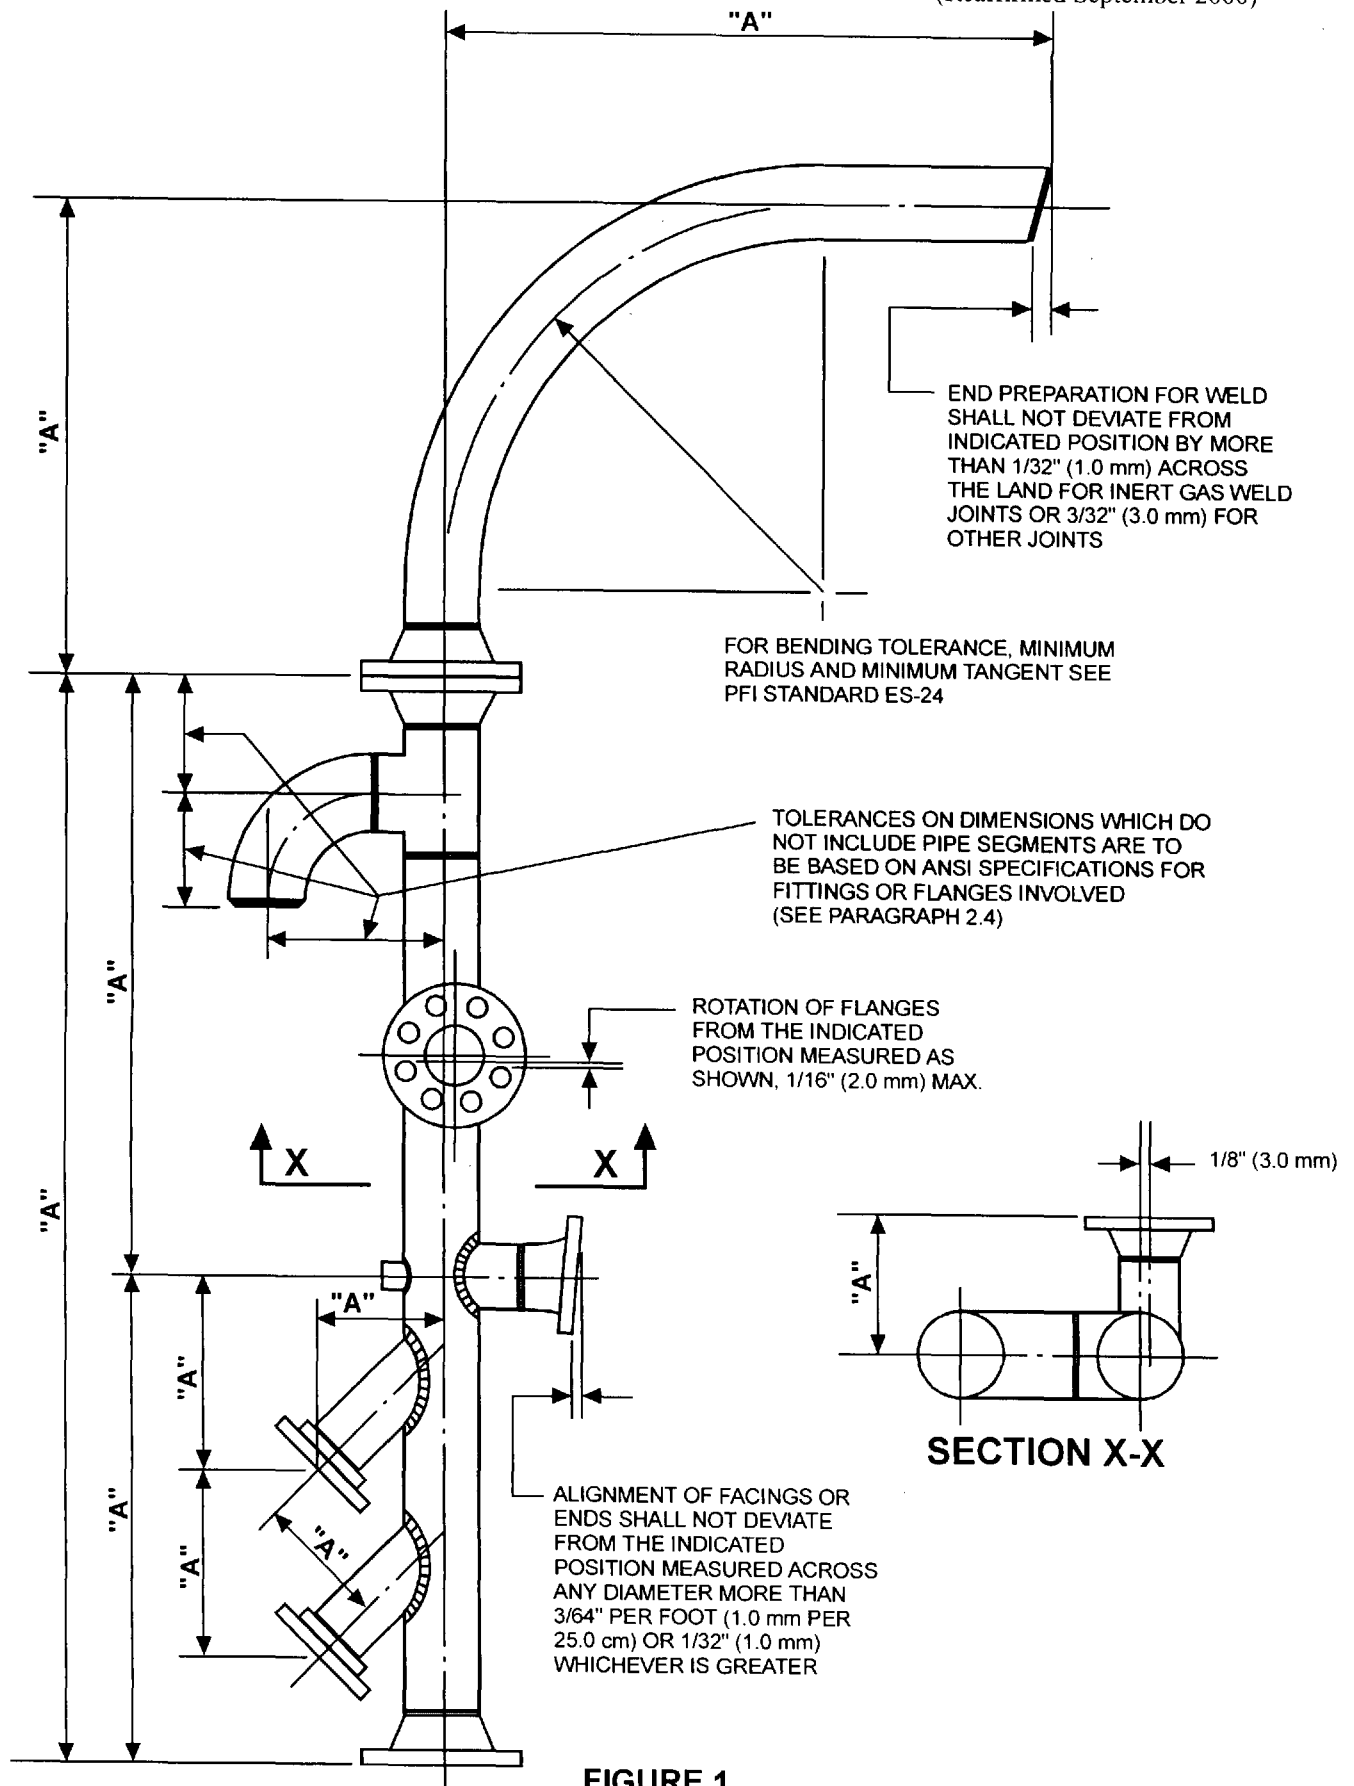


FIGURE 1
APPLICATION OF PIPE FABRICATION TOLERANCES

CHARTER MEMBERS

ACCORD PIPE FABRICATORS, INC.	Jamaica,	New York
AIR CONDITIONING COMPANY, INC.	Glendale,	California
FLO-RITE, INC.	Riviera Beach,	Florida
GEM INDUSTRIAL, INC.	Walbridge,	Ohio
HPI CONSTRUCTION CO., INC.	Huntington,	West Virginia
HUXTABLE & ASSOCIATES, INC.	Lawrence,	Kansas
IDEAL WELDERS, LTD.	Delta,	British Columbia (Canada)
INDUSTRIAL POWER SYSTEMS, INC.	Toledo,	Ohio
IVOR J. LEE, INC.	Masury,	Ohio
JOHN E. GREEN COMPANY	Highland Park,	Michigan
J. F. AHERN CO.	Fond du Lac,	Wisconsin
J. H. KELLY LLC	Longview,	Washington
J. S. MC KINNEY, INC.	Freeport,	Texas
KINETIC SYSTEMS, INC.	Santa Clara,	California
M & M WELDING AND FABRICATORS, INC.	Gaithersburg,	Maryland
MC ABEE CONSTRUCTION, INC.	Tuscaloosa,	Alabama
MC CARL'S, INC.	Beaver Falls,	Pennsylvania
MECHANICAL INCORPORATED	Freeport,	Illinois
MID STATES PIPE FABRICATING, INC.	El Dorado,	Arkansas
MURPHY COMPANY	St. Louis,	Missouri
NARDEI FABRICATORS, LTD.	Calgary,	Alberta (Canada)
NEWMECH COMPANIES, INC.	St. Paul,	Minnesota
PHILLIPS, GETSCHOW COMPANY	Oconto Falls,	Wisconsin
PIPING SYSTEMS, INC.	New London,	Wisconsin
S. A. COMUNALE COMPANY, INC.	Barberton,	Ohio
S&D / OSTERFELD MECHANICAL CONTRACTORS	Dayton,	Ohio
SCOTT CO. OF CALIFORNIA	San Leandro,	California
SPECIALTY PIPING CORPORATION	Davisville,	West Virginia
TEAM INDUSTRIES, INC.	Kaukauna,	Wisconsin
W. J. O'NEIL COMPANY	Livonia,	Michigan

A current index of the latest revised ES Standards, Technical Bulletins and Safety Training Guideline is available from the Pipe Fabrication Institute.

PFI Safety Training Guideline, Standards and Technical Bulletins are published to serve proven needs of the pipe fabricating industry at the design level and in actual shop operations. Hence, such needs are continually considered and reviewed by the Engineering Committee of the Pipe Fabrication Institute to provide recommended procedures, which have been demonstrated by collective experiences to fulfill requirements in a manner for Code compliance. However, as the PFI Standards are for minimum requirements the designer or fabricator always has the option of specifying supplementary conditions in the form of requirements beyond the scope of the PFI publications.