


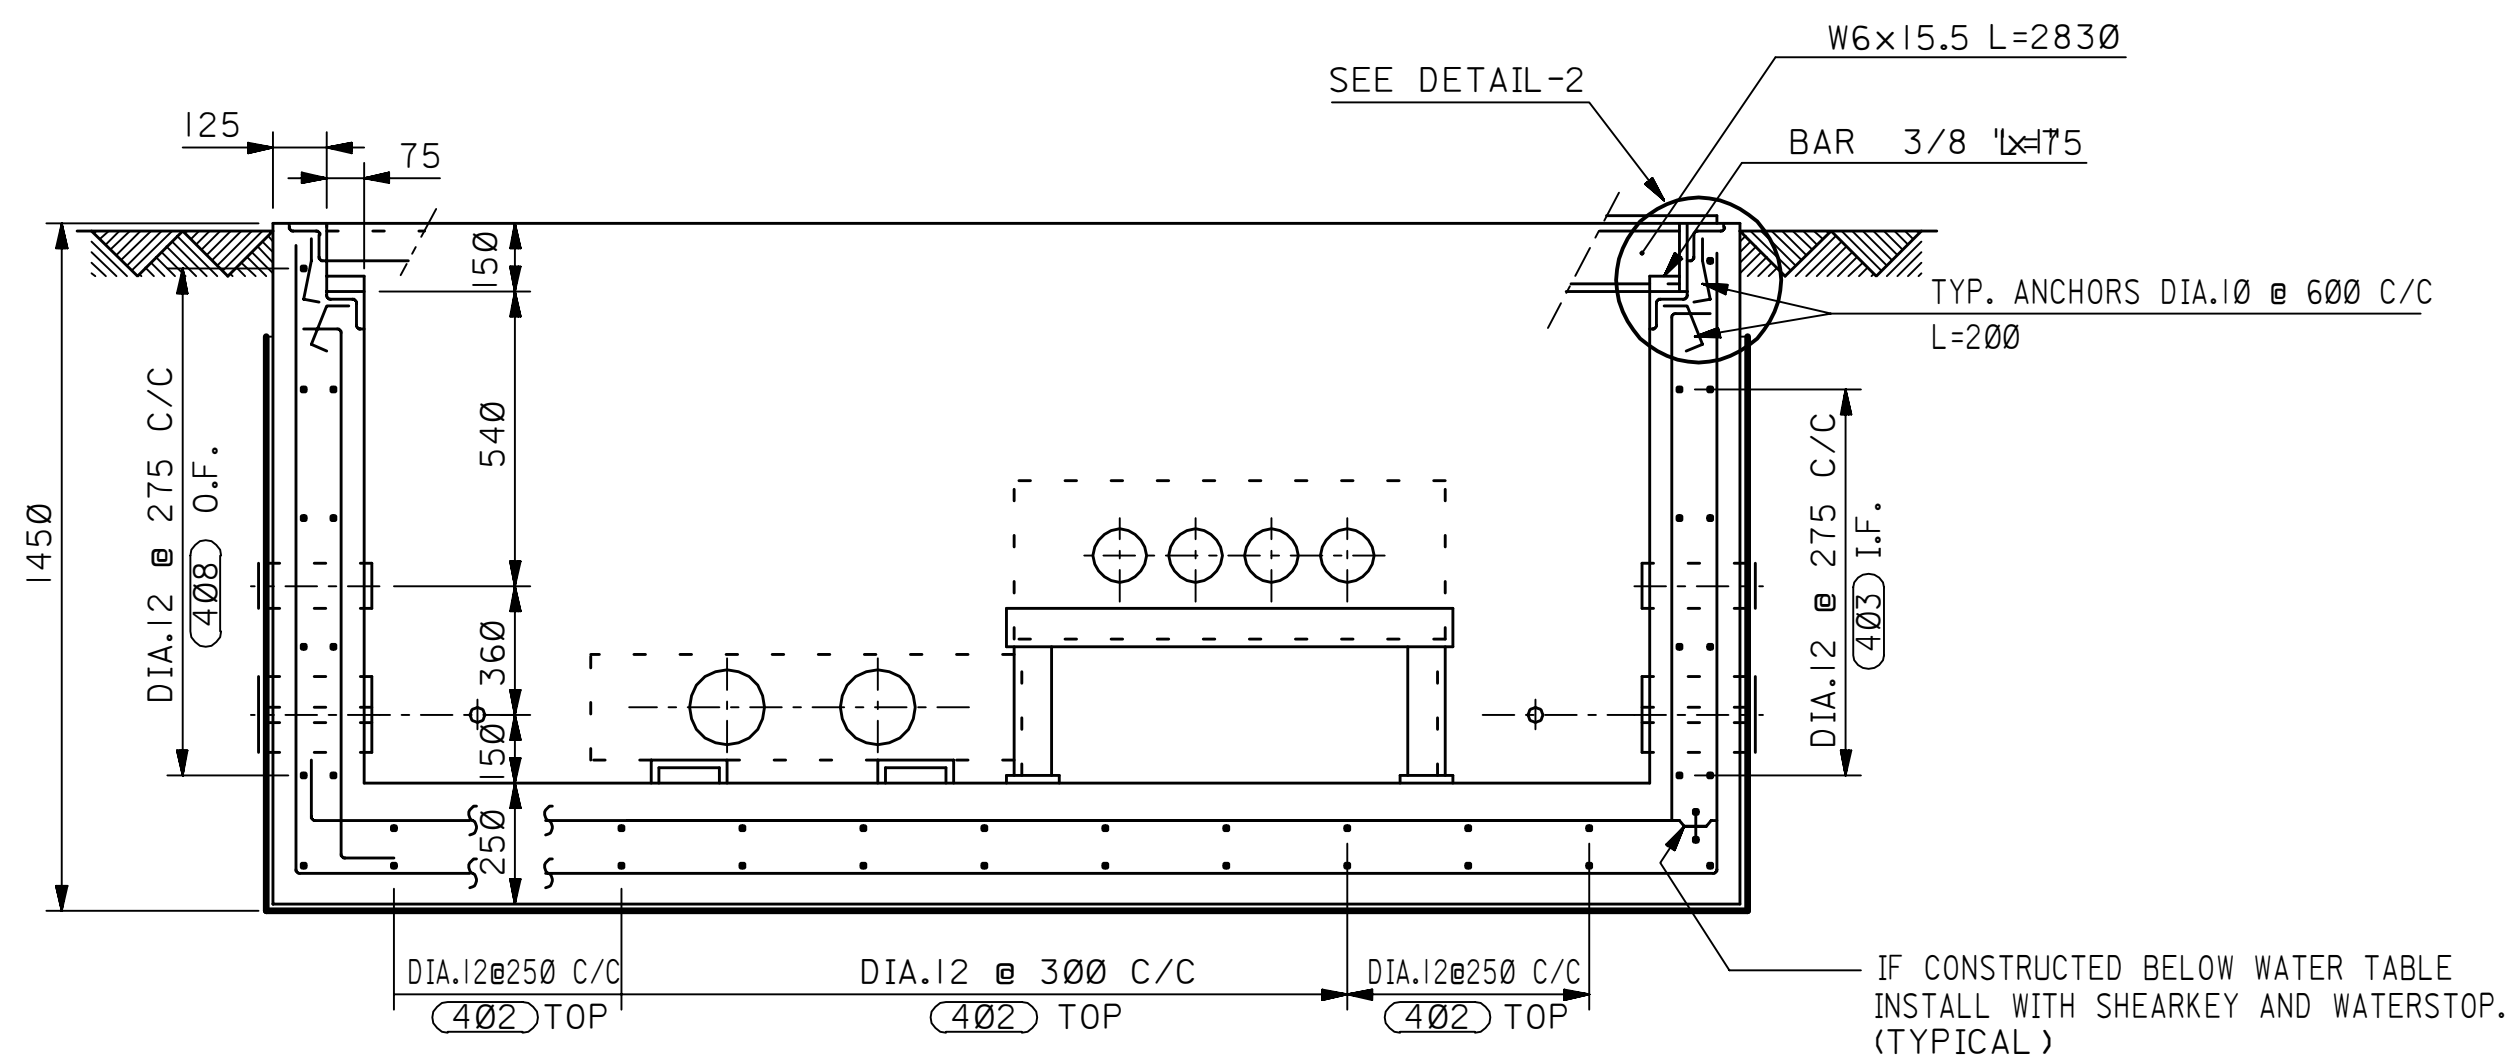
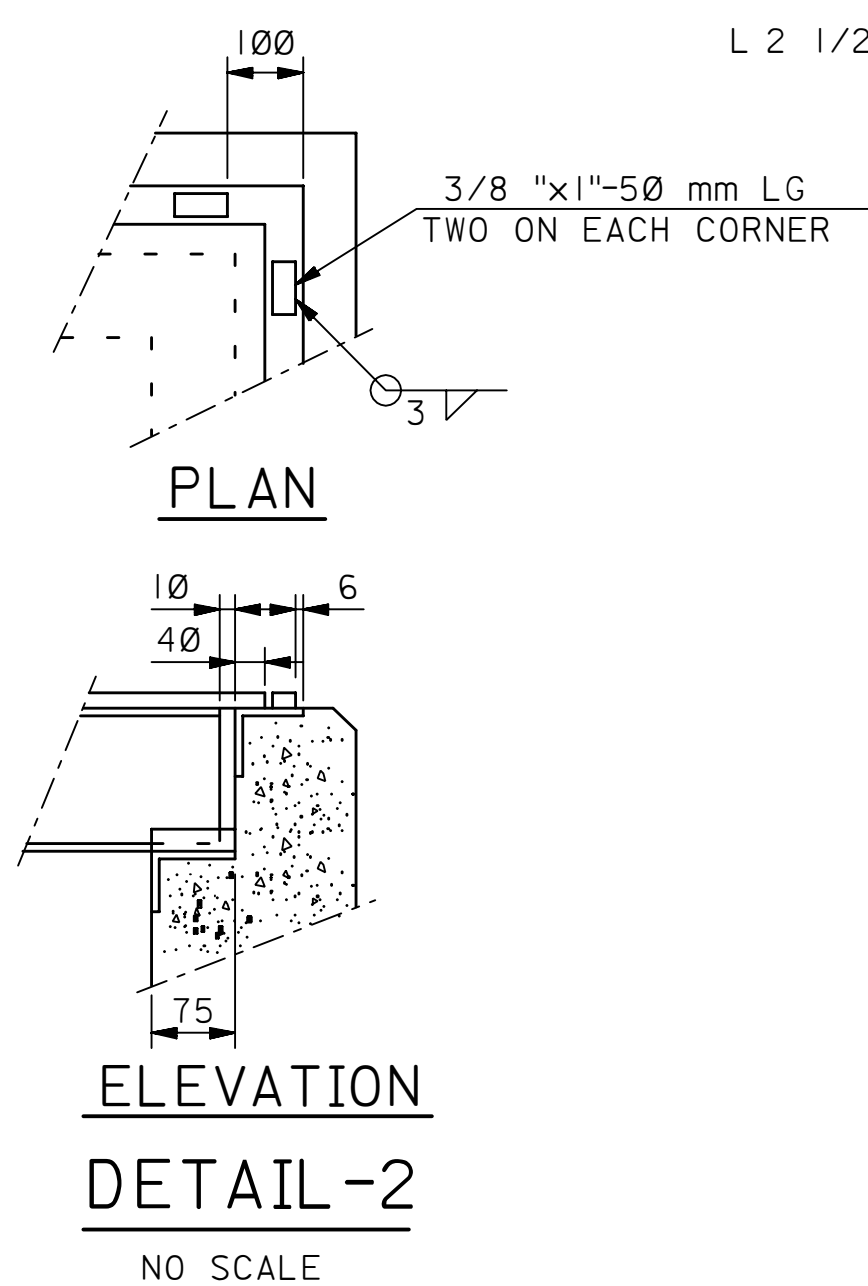
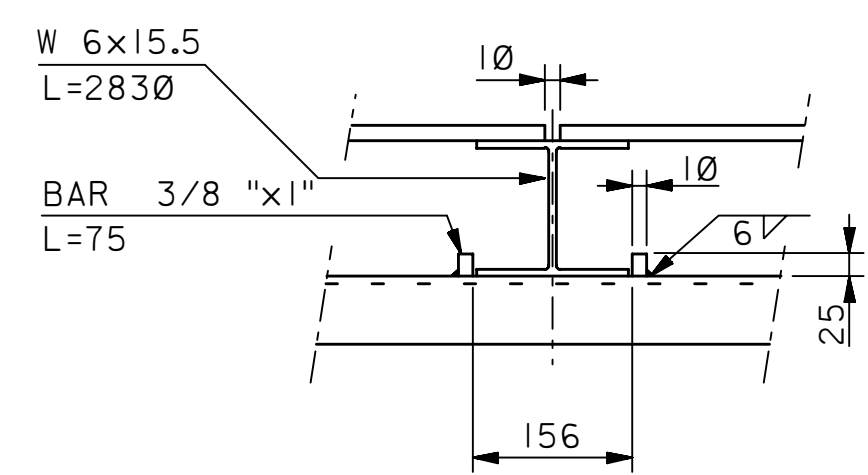
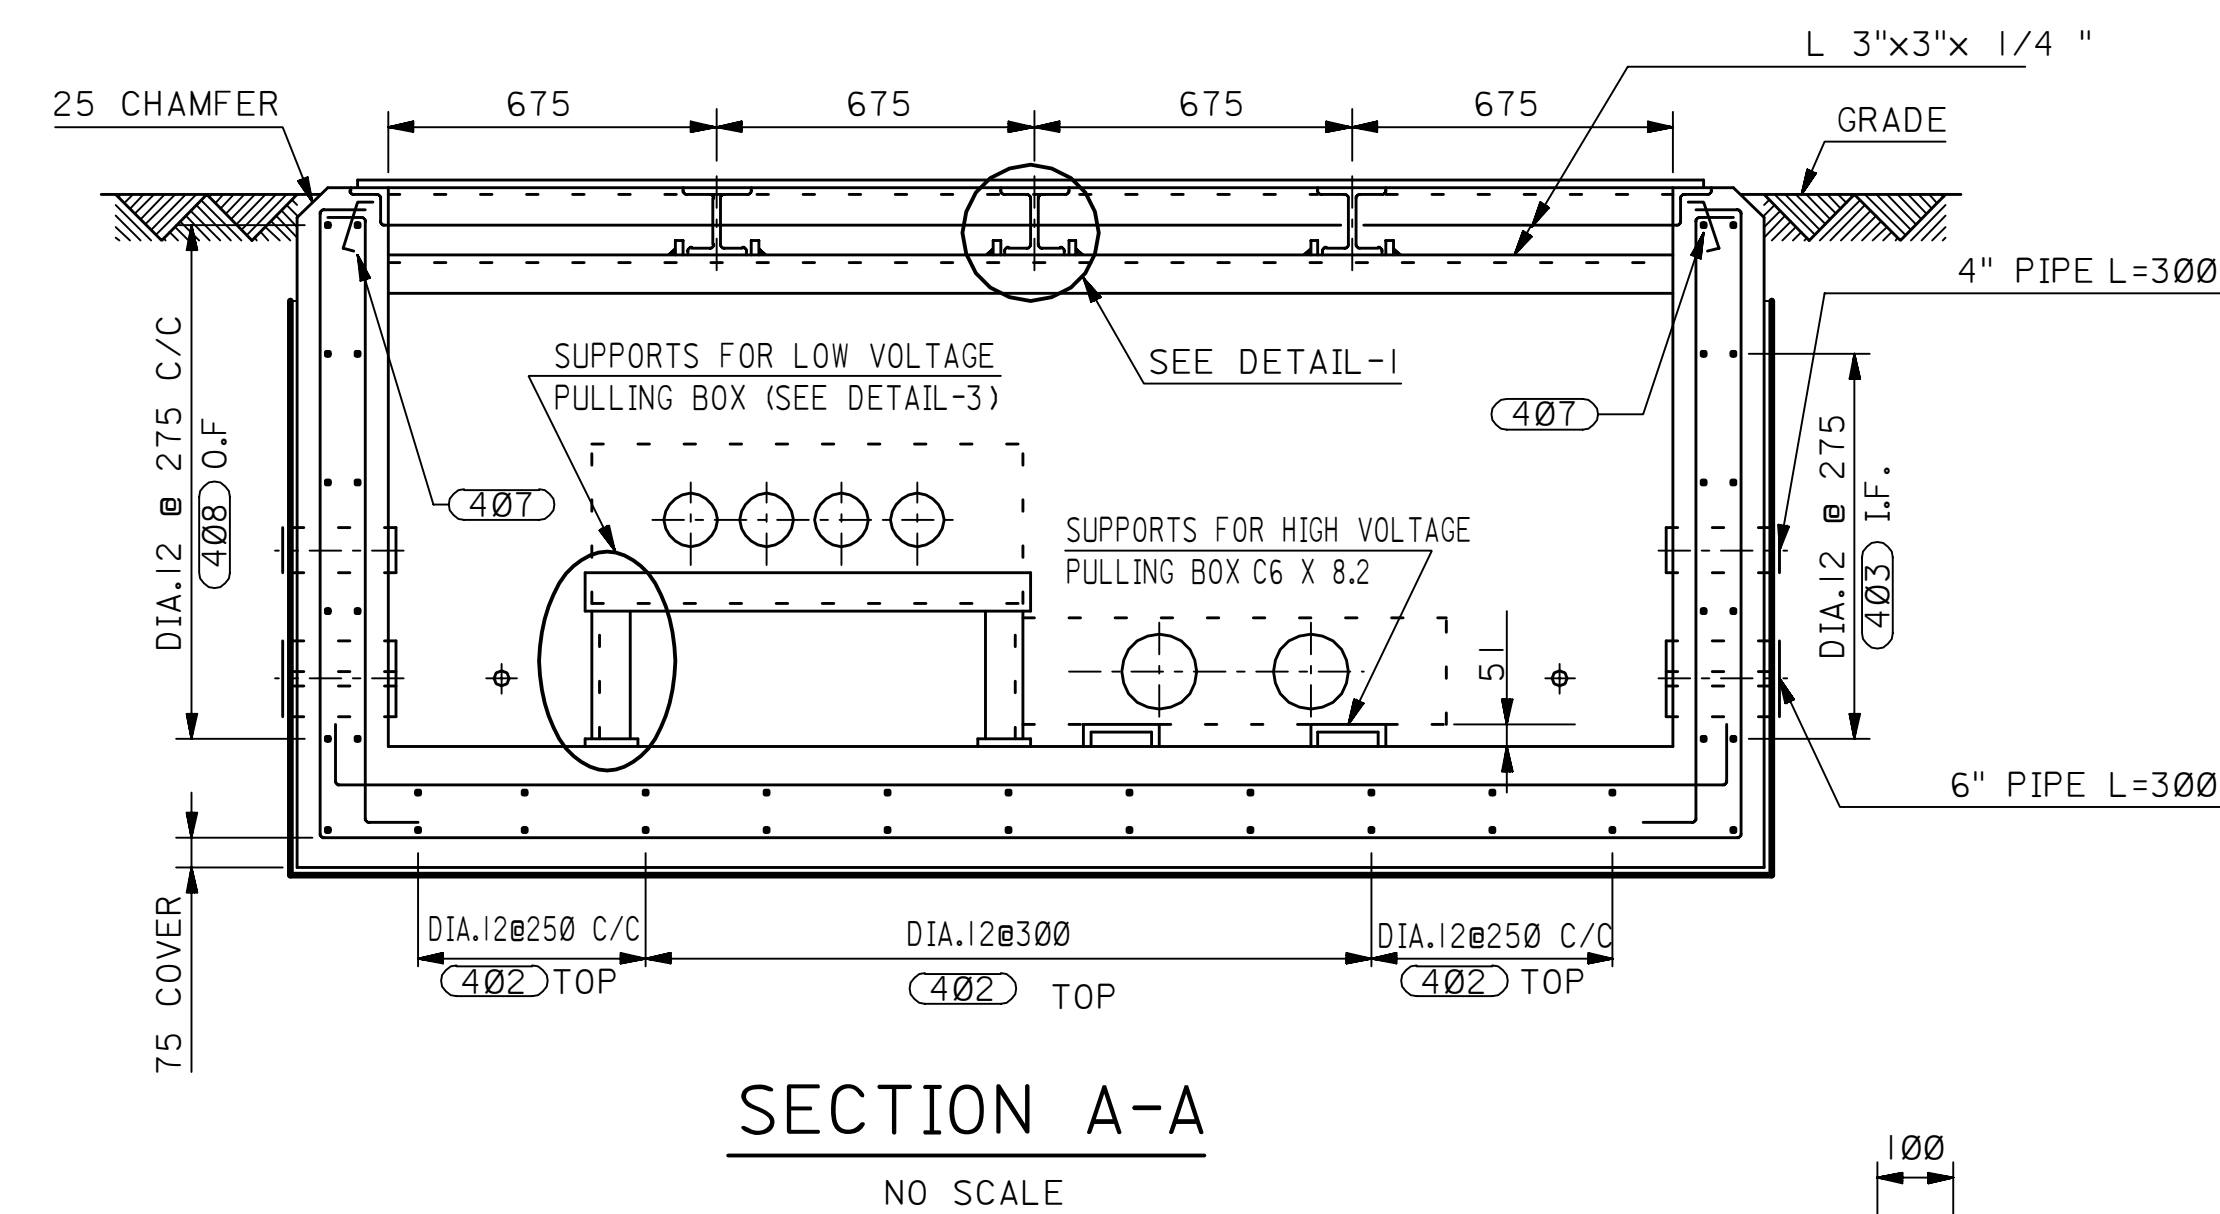


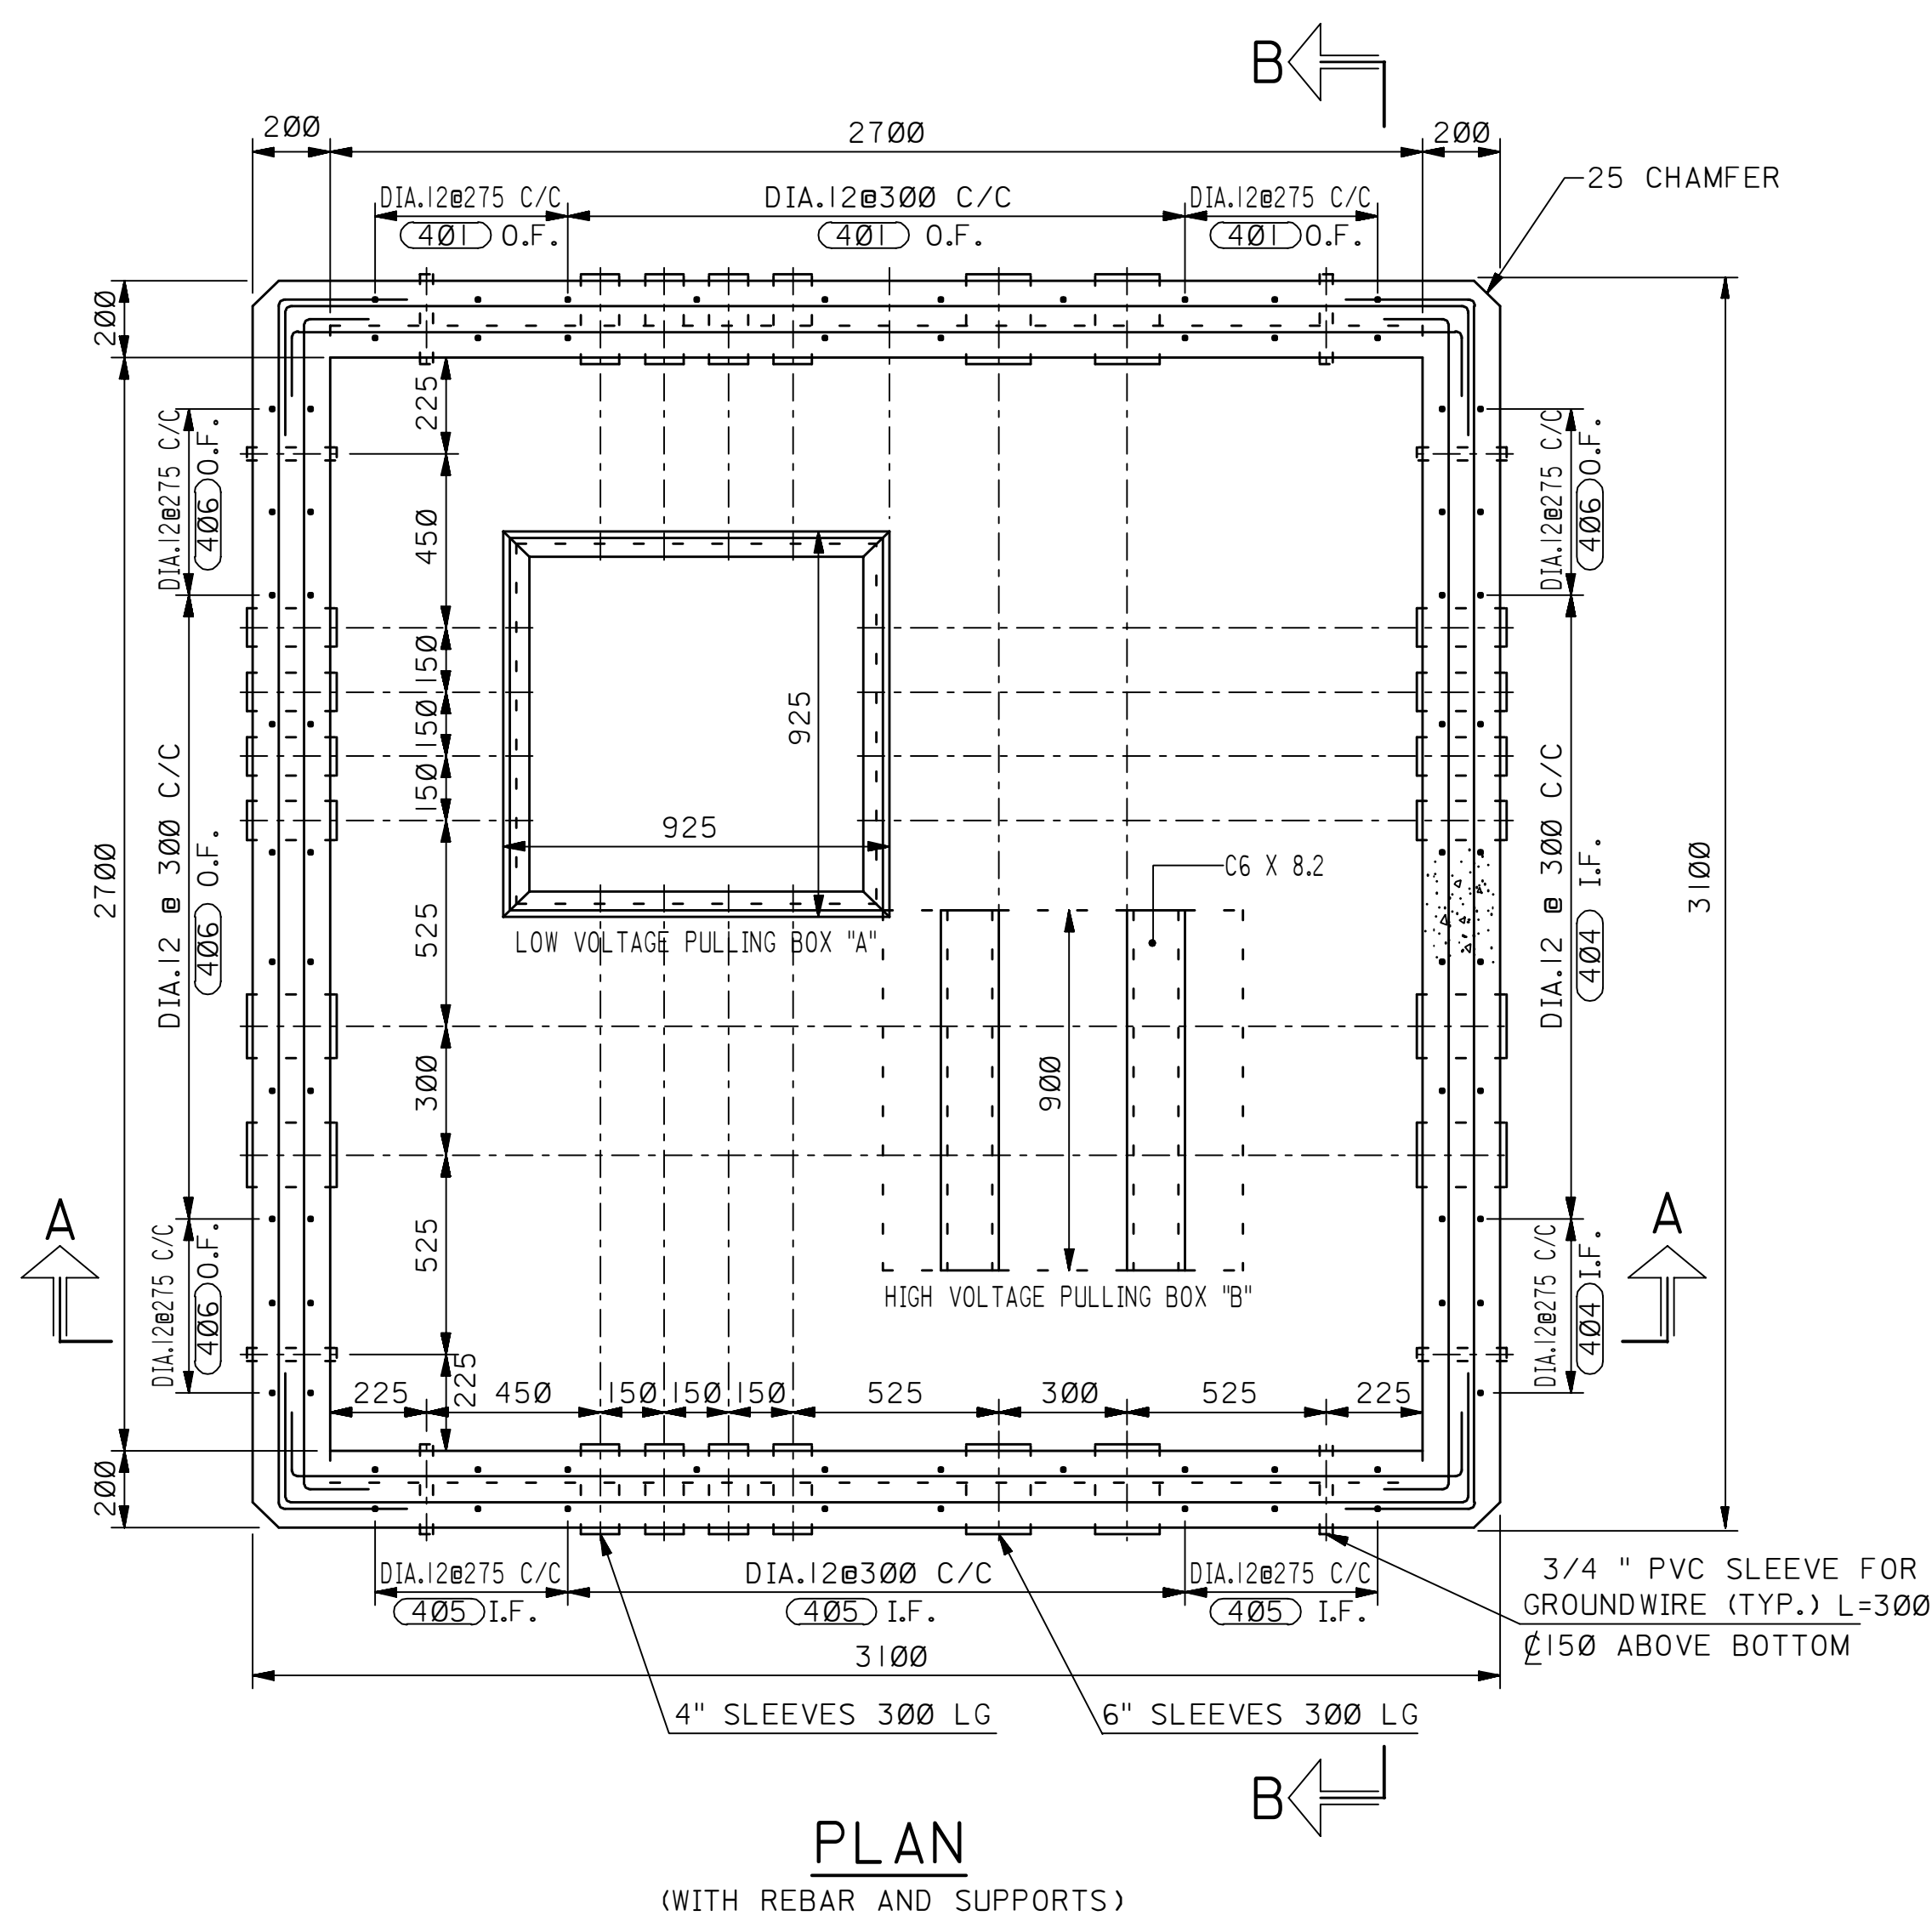

SECTION B-B
NO SCALE

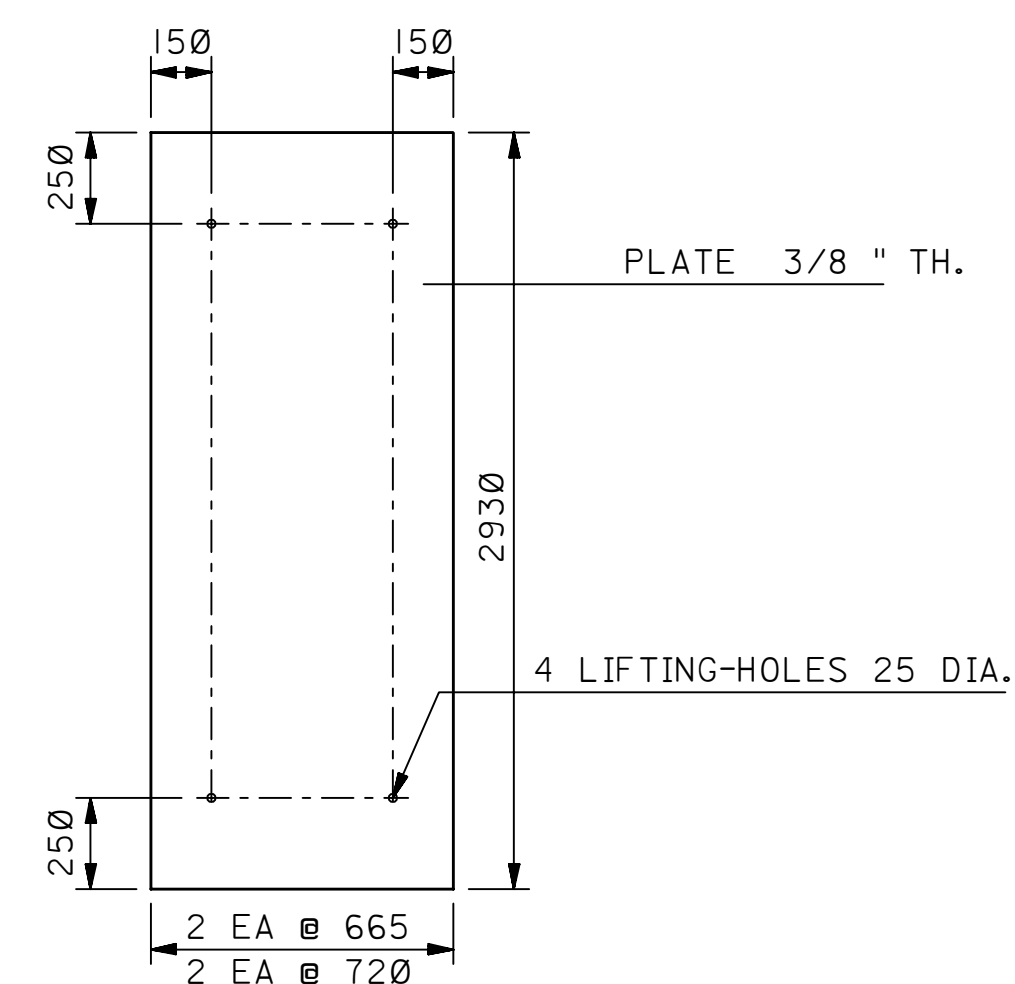


COVER PLATE
(2xREQ'D) NO SCALE

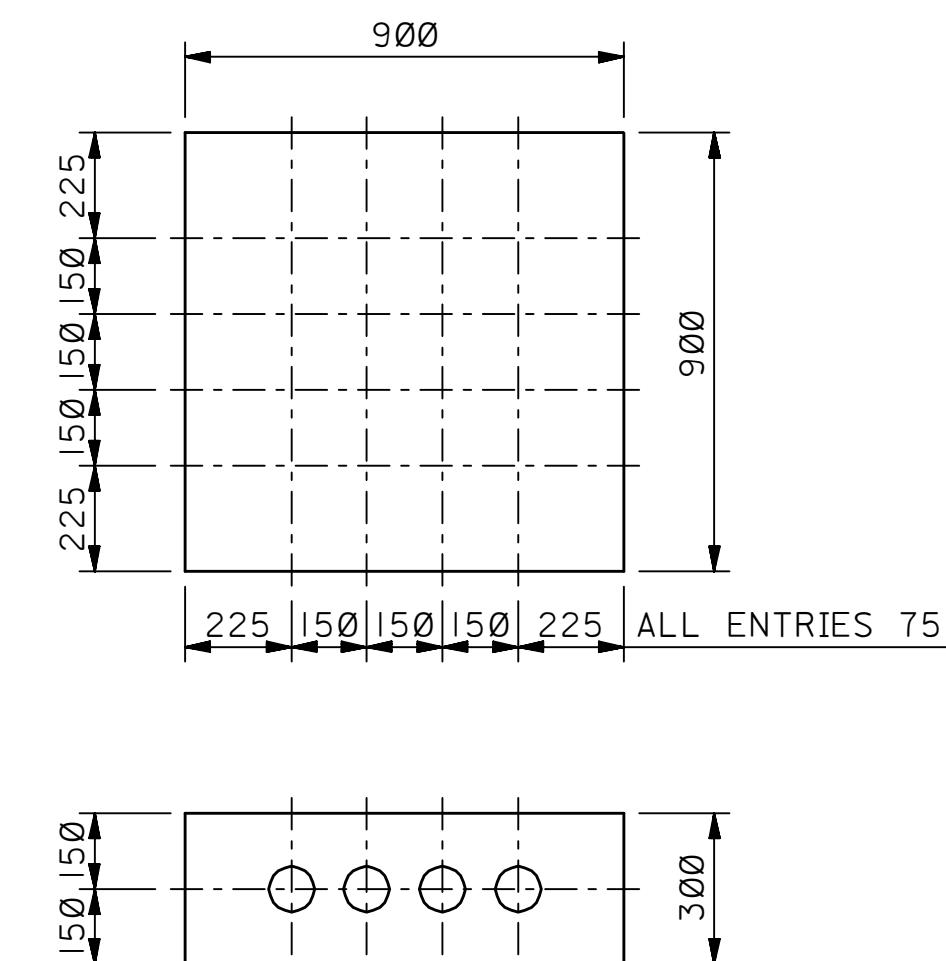


L.V. PULLING BOX "A"

(WITH TYP. SIDE VIEW)
NO SCALE

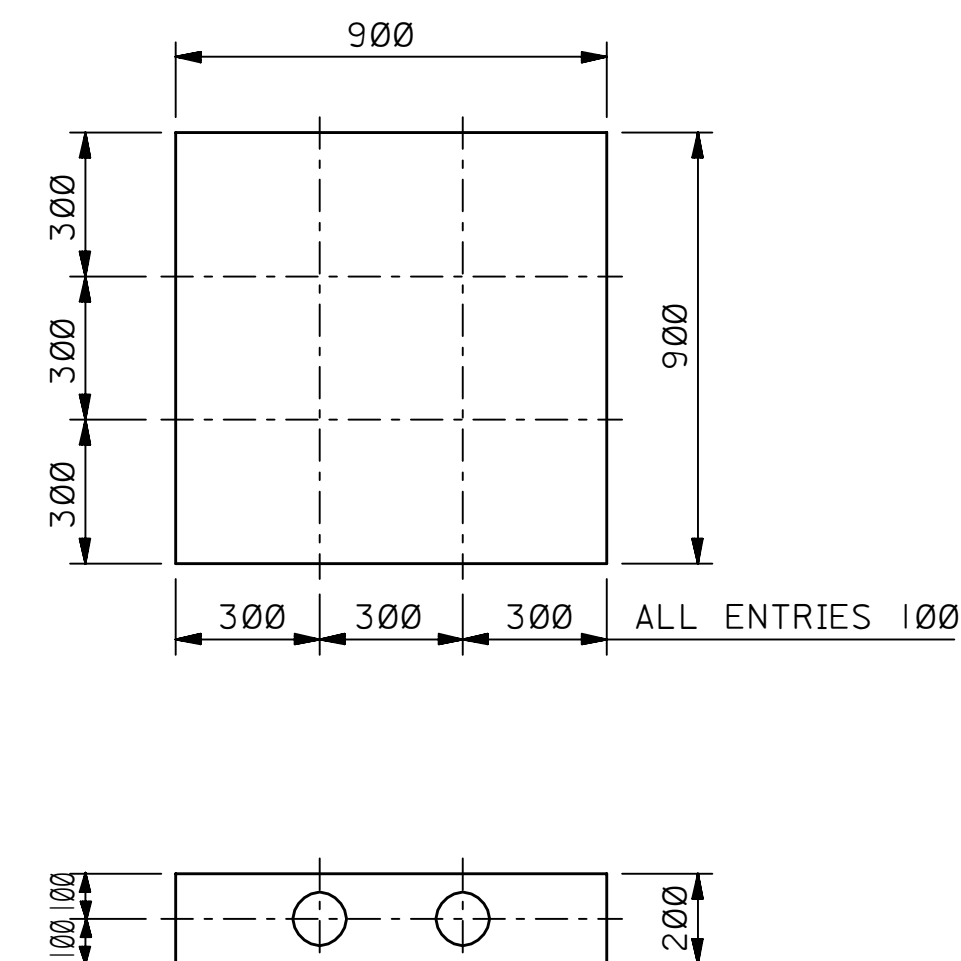

H.V. PULLING BOX "B"

(WITH TYP. SIDE VIEW)
NO SCALE

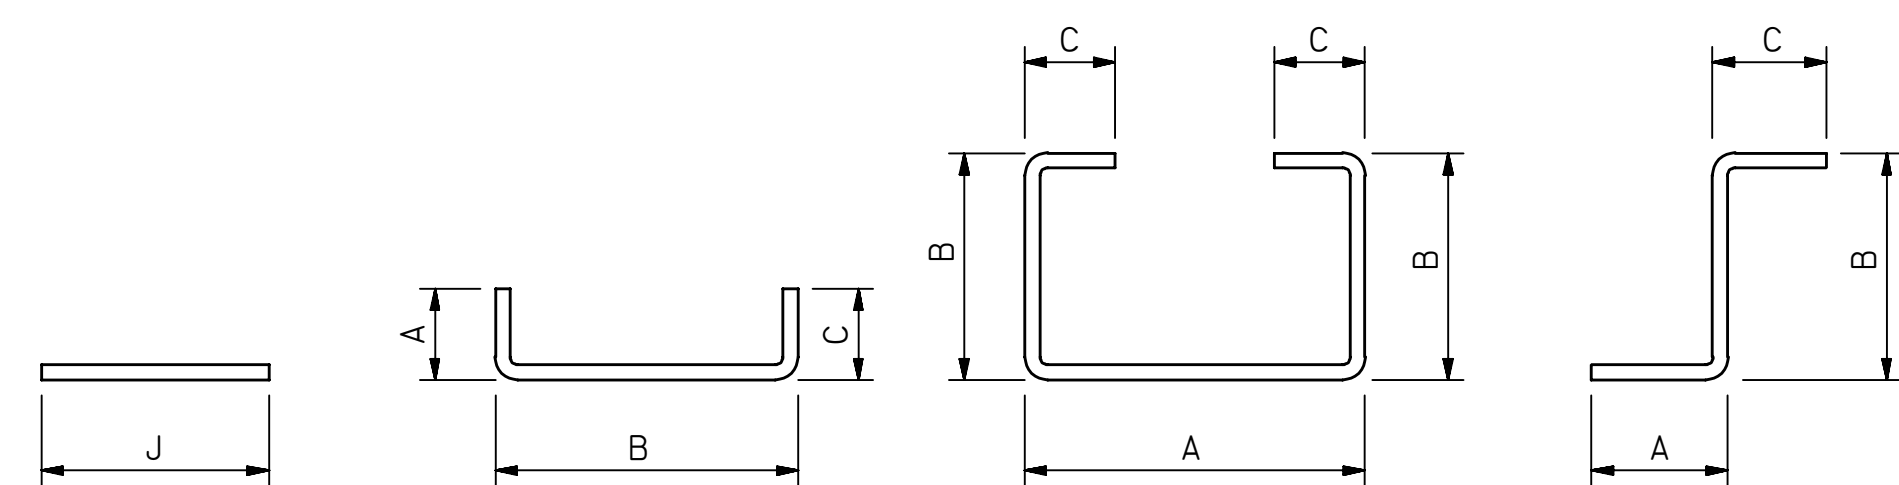

TYPE-1 TYPE-2 TYPE-3 TYPE-4

[illegible]

BASE PLATE
DETAIL-3
NO SCALE

- ## NOTES
1. CONCRETE SHALL BE MIXED AND PLACED IN ACCORDANCE WITH AES-Q-1.
 2. CONCRETE MIX STRENGTH SHALL BE 20.7 MPa AFTER 28 DAYS.
 3. REBAR QUALITY ASTM A-615 GRADE 40 OR EQUIVALENT APPROVED.
 4. CONCRETE COVER SHALL BE:
75mm AT BOTTOM OF SLAB, INSIDE AND OUTSIDE;
50mm FOR SIDE WALLS
 5. REINFORCEMENT SHALL BE BENT TO SUIT HOLES AND SLEEVES.
 6. PULL BOXES NOT TO BE LOCATED IN ROADS OR AREAS ACCESSIBLE FOR ROAD TRAFFIC.
 7. WALLS BELOW WATERTABLE SHALL BE WATERPROOFED WITH EITHER OF THE FOLLOWING PRODUCTS:
(A) APPLY TWO COATS OF COLD-APPLIED BITUMASTIC PER AES-H-1, APCS-10. (AMS 09-611-720)
(B) APPLY TWO COATS OF EXTRATRITE FOUNDATION COATING (AMS 09-610-850) AFTER EXTRATRITE CONCRETE PRIMER (AMS 09-708-080) PER MANUFACTURER'S INSTRUCTIONS.
 8. EXTERIOR SURFACES OF ALL METALS CAST INTO, ATTACHED TO, OR PART OF THE CONCRETE STRUCTURE SHALL BE PAINTED PRIOR TO CASTING, ATTACHMENT, OR PLACEMENT WITH COAL-TAR EPOXY PAINT PER AES-H-1, APCS-3.
 9. ALL SPARE ENTRIES SHALL BE PLUGGED OFF. USE PLUG TYPE PLG-10 MAKE CROUSE HINDS.
 10. BOTTOM SLAB SHALL BE UNDERLAIN BY 0.15mm POLYETHYLENE SHEETING, WHICH SHALL BE LARGE ENOUGH TO BE LAPPED OVER THE FOUNDATION AND SEALED AGAINST THE STRUCTURE WALLS.
 11. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS NOTED OTHERWISE.
- I.F.=INSIDE FACE
O.F.=OUTSIDE FACE
C/C=CENTER TO CENTER

TYPICAL INSTALLATION DRAWING

03	10-12-85	MJH AD	REDRAWN, REVISED AND ADDED NOTE TYPICAL INSTALLATION DRAWING					
REV. NO.	DATE	BY	DESCRIPTION		CHKD	CERT.	APP'D.	
FOR ARABIAN AMERICAN OIL COMPANY								
DRAWN BY		K.P.B.		CHECKED BY	SCALE: NONE			
DATE STARTED				DATE COMPLETED	3/2/76			
OP'R/C. DEPT.				ENG. DEPT.	4/2/76			
APP'D. FOR CONST.				CERTIFIED DATE	4/2/76			
THIS DRAWING IS NOT TO BE USED FOR CONSTRUCTION OR FOR ORDERING MATERIAL UNLESS CERTIFIED AND DATED								
UNDERGROUND PULL BOX NON HAZARDOUS AREAS								
STD. DWG.						METRIC		
PLANT NO.	INDEX	DRAWING NUMBER			SMT. NO.	REV. NO.		
990	Q	AA-036366			001	03		