
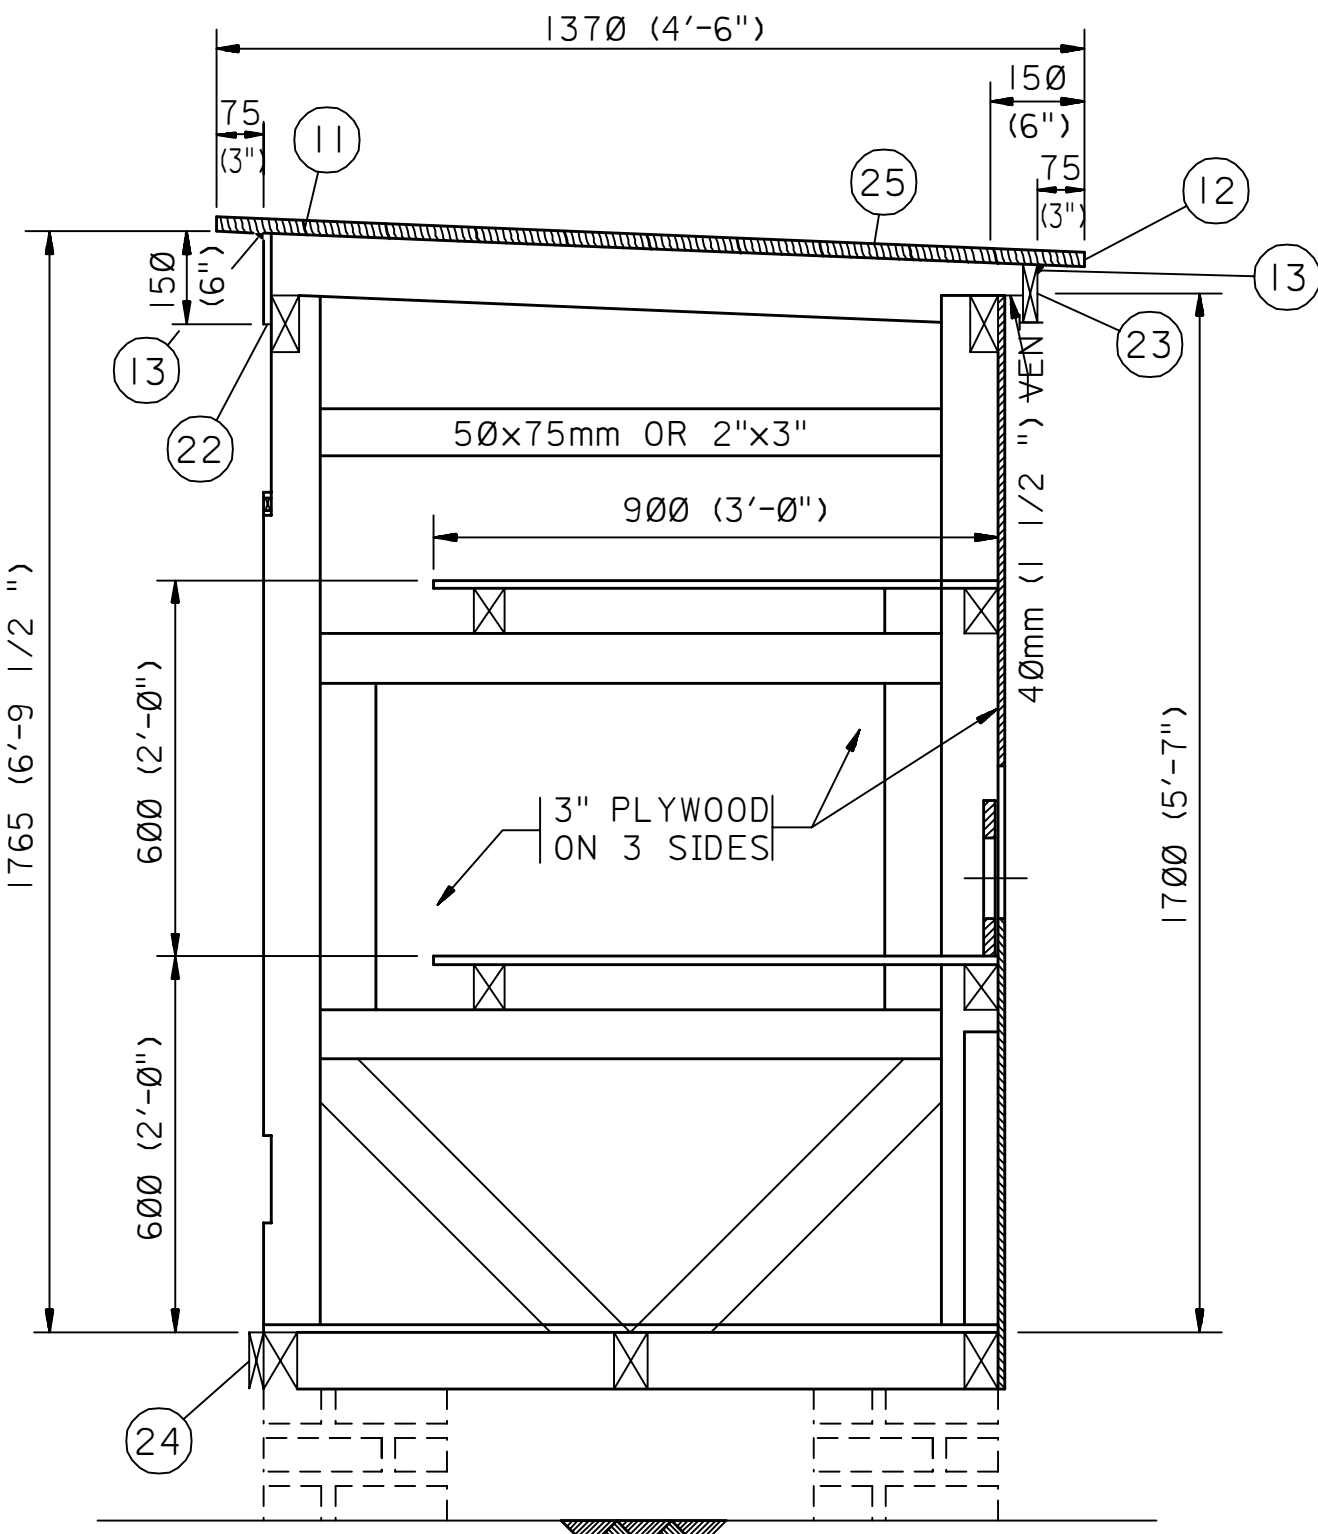
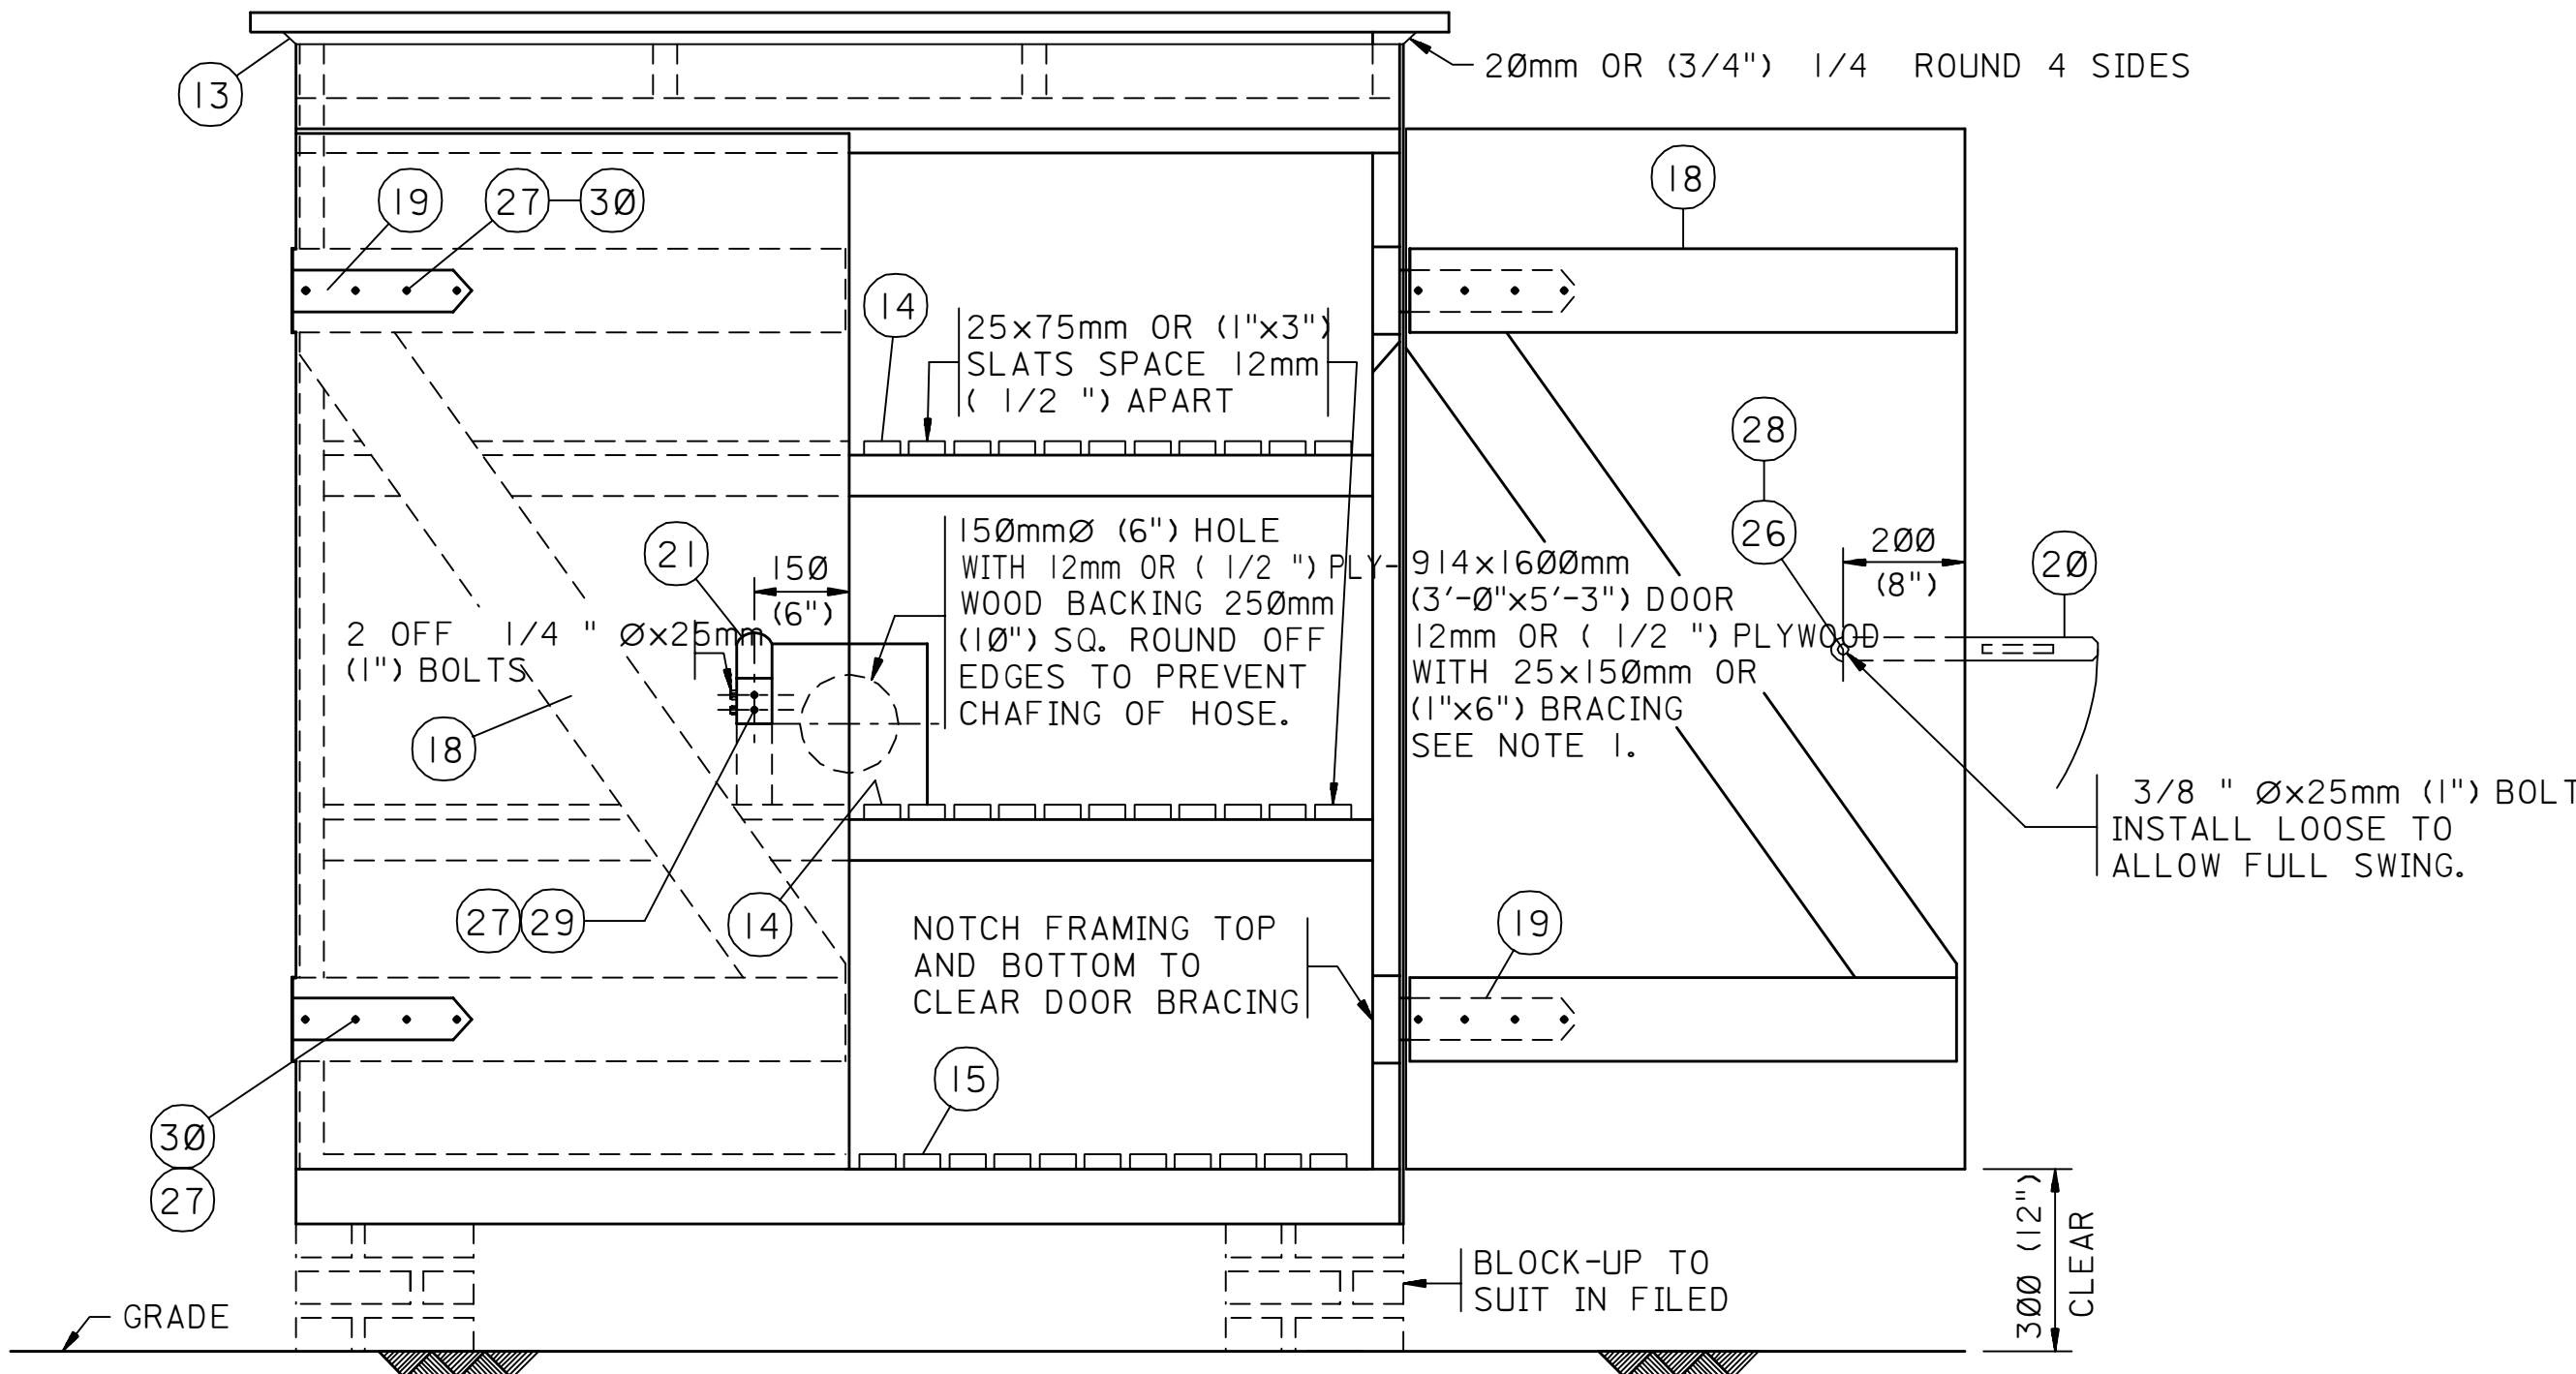
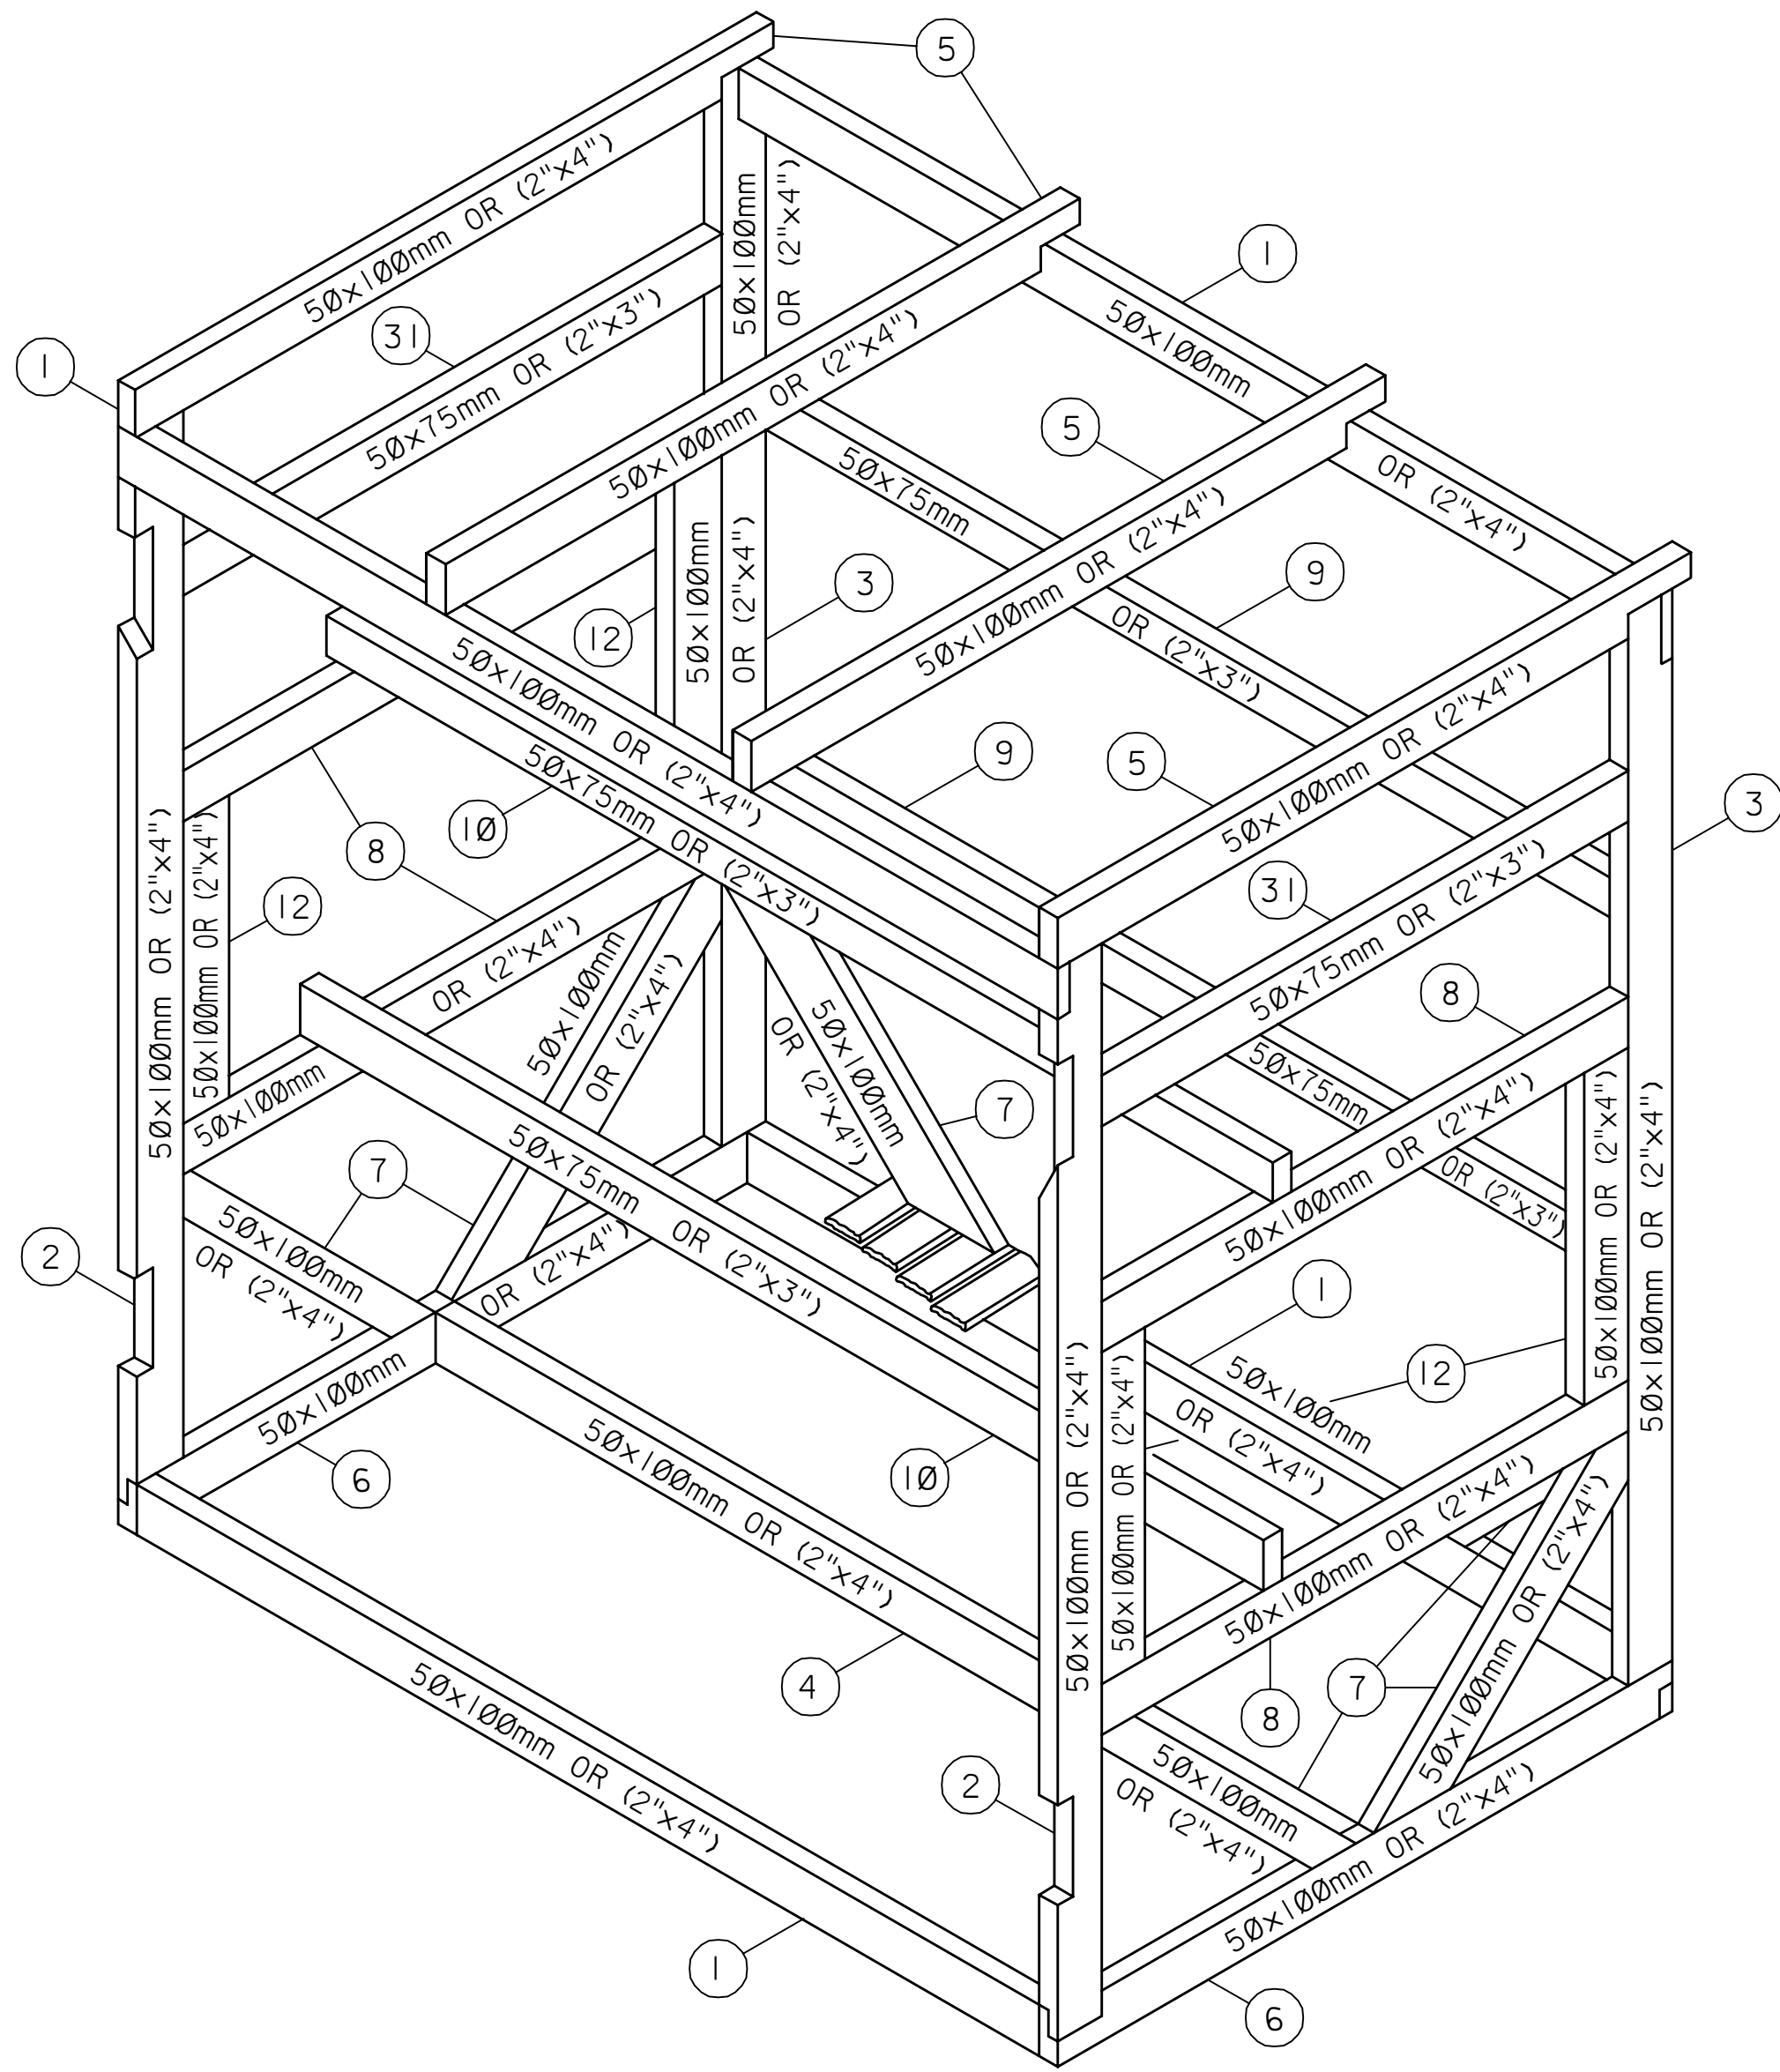


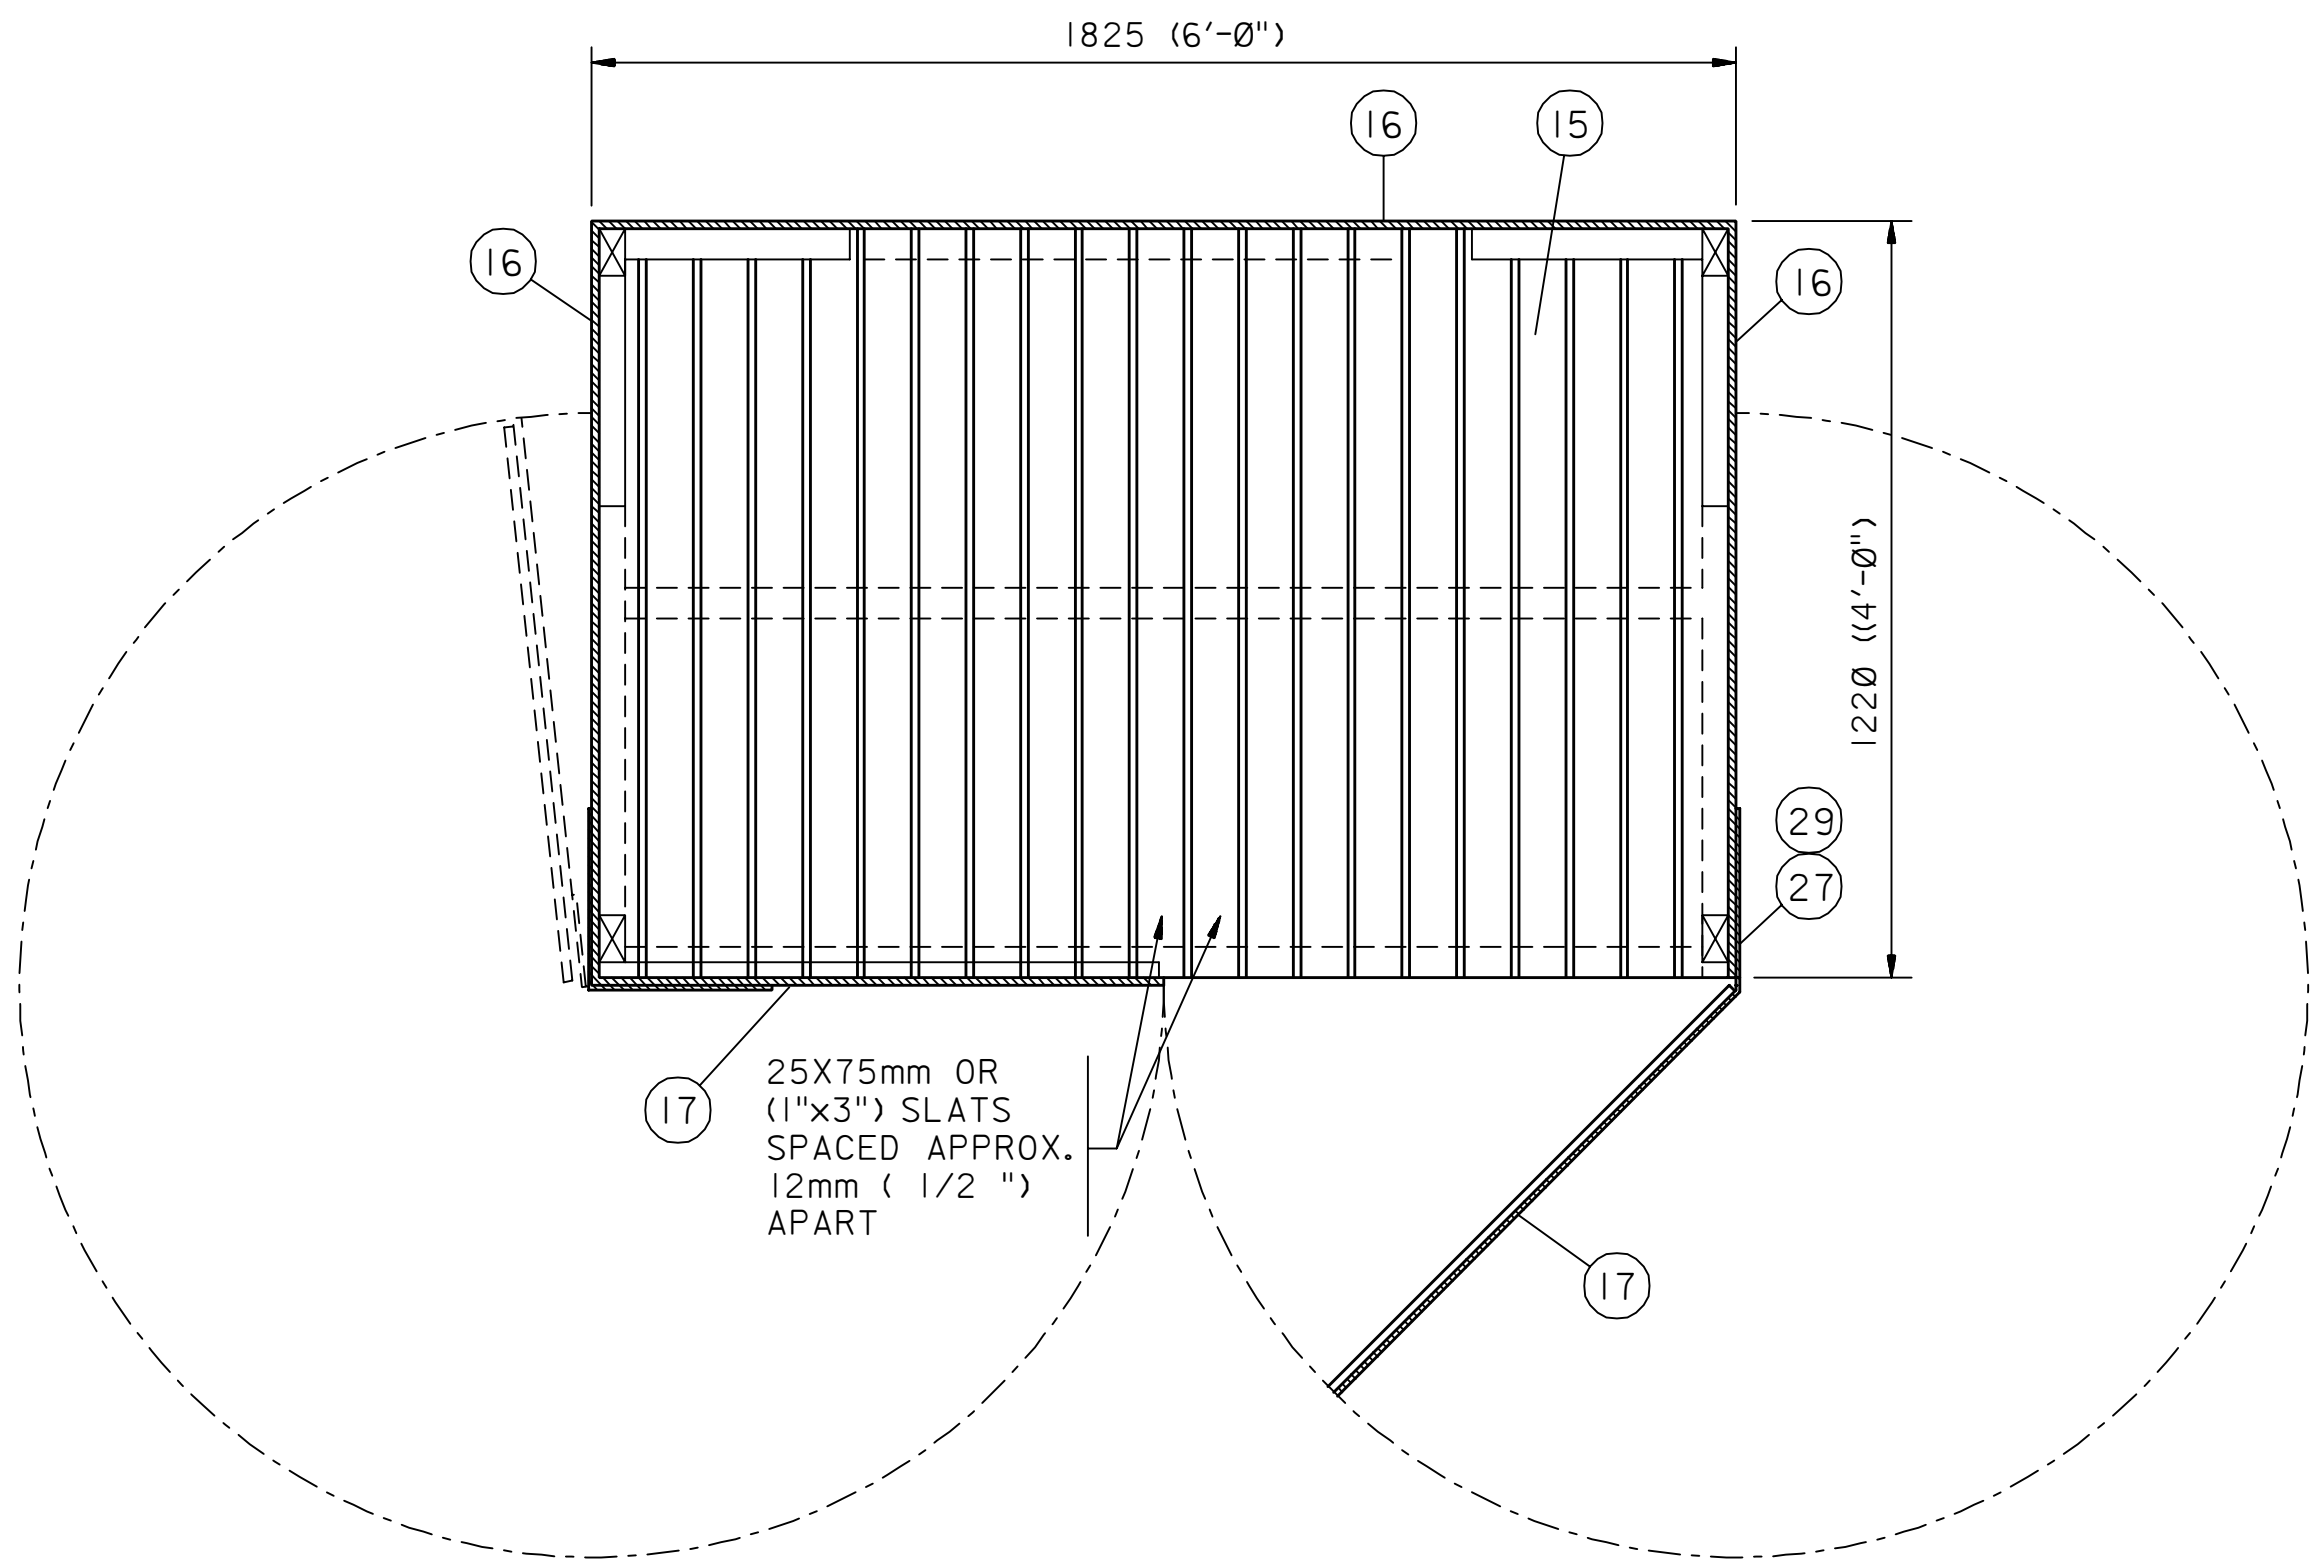

- NOTES:
1. MOUNT ACCESSORIES ON INSIDE OF DOORS TO SUIT.
 2. PAINT HOUSE BRIGHT RED WITH LARGE LETTERS IN WHITE STATING HYDRANT NO. & "FIRE HOSE HOUSE" IN ENGLISH AND ARABIC.
 3. PROVIDE SEAL ACROSS DOOR TO PREVENT EQUIPMENT FROM BEING USED FOR SERVICES OTHER THAN FIRE FIGHTING.
 4. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS NOTED OTHERWISE.

LIST OF MATERIALS			
NO.	CAT NO.	QUAN.	DESCRIPTION OF MATERIALS
1		4 PCS.	50x100mm D.F. S4S LUMBER 1825mm LG. OR (2"x4" D.F. LUMBER 6'-0" LG.)
2		2 PCS.	50x100mm D.F. S4S LUMBER 1725mm LG. OR (2"x4" D.F. LUMBER 5'-8" LG.)
3		2 PCS.	50x100mm D.F. S4S LUMBER 1700mm LG. OR (2"x4" D.F. LUMBER 5'-7" LG.)
4		1 PC	50x100mm D.F. S4S LUMBER 1770mm LG. OR (2"x4" D.F. LUMBER 5'-9 3/4 " LG.)
5		4 PCS.	50x100mm D.F. S4S LUMBER 1295mm LG. OR (2"x4" D.F. LUMBER 4'-3 " LG.)
6		2 PCS.	50x100mm D.F. S4S LUMBER 1220mm LG. OR (2"x4" D.F. LUMBER 4'-0" LG.)
7		6 PCS.	50x100mm D.F. S4S LUMBER 810mm LG. OR (2"x4" D.F. LUMBER 2'-8" LG.)
8		4 PCS.	50x100mm D.F. S4S LUMBER 1035mm LG. OR (2"x4" D.F. LUMBER 3'-4 3/4 " LG.)
9		2 PCS.	50x75mm D.F. S4S LUMBER 1745mm LG. OR (2"x3" D.F. LUMBER 5'-8 3/4 " LG.)
10		2 PCS.	50x75mm D.F. S4S LUMBER 1825mm LG. OR (2"x3" D.F. LUMBER 6'-0" LG.)
11		17.4m (57FT)	25x150mm D.F. T&G LUMBER OR (1"x6" D.F. T&G LUMBER)
12		4 PCS.	50x100mm D.F. S4S LUMBER 510mm LG. OR (2"x4" D.F. S4S LUMBER 1'-8" LG.)
13		20mm D.F. (20FT)	QUARTER ROUND OR (3/4 " D.F. QUARTER ROUND)
14		46 PCS.	25x75mm D.F. S4S LUMBER 910mm LG. OR (1"x3" D.F. S4S LUMBER 3'-0" LG.)
15		25 PCS.	25x75mm D.F. S4S LUMBER 1220mm LG. OR (1"x3" D.F. S4S LUMBER 4'-0" LG.)
16	09-565-157	4 PCS.	3/8 " D.F. S4S PLYWOOD 4'-0"x6'-0"
17		2 PCS.	12mm D.F. S2S PLYWOOD 1220x1600mm OR (1/2 " D.F. S2S PLYWOOD 4'-0"x5'-3")
18		6.4m (21FT)	25x150mm D.F. LUMBER OR (1"x6" D.F. LUMBER)
19	08-297-336	4 PCS.	12" HVY. STRAP HINGE ZINC COATED
20		1 PC	1/4 "x1"x450mm LG. ST. FLAT BAR OR (1/4 "x1"x18" LG. ST. FLAT BAR)
21		1 PC	1/4 "x2"x150mm LG. ST. FLAT BAR OR (1/4 "x2"x6" LG. ST. FLAT BAR)
22		1 PC	12x150mmx1825mm D.F. S4S LUMBER OR (1/2 "x6"x6'-0" D.F. S4S LUMBER)
23		1 PC	12x75mmx1825mm D.F. S4S LUMBER OR (1/2 "x3"x6'-0" D.F. S4S LUMBER)
24		1 PC	25x100mmx1825mm D.F. S4S LUMBER OR (1"x4"x6'-0" D.F. S4S LUMBER)
25		4.6m ² (50FT ²)	MINERAL SURFACED ROOF PAPER
26		2EA	10mmx25mm O.D. 14GA. FLAT ST. WASHER OR (3/8 "x1" O.D. 14GA. FLAT ST. WASHER
27		42EA	6x20mm O.D. 16GA. FLAT ST. WASHER OR (1/4 "x 3/4 " O.D. 16GA. FLAT ST. WASHER
28		1EA	3/8 "x25mm SQ. HD. MACH. BOLT & HEX NUT OR (3/8 "x1"SQ. HD. MACH. BOLT & HEX NUT
29		22EA	1/4 "x25mm SQ. HD. MACH. BOLT & HEX NUT OR (1/4 "x1"SQ. HD. MACH. BOLT & HEX NUT
30	10-206-135	20EA	1/4 "x3 1/2 " SQ. HD. MACH. BOLT & HEX NUT
31		2 PCS.	50x75mm D.F. S4S LUMBER 1035mm LG. OR (2"x3" D.F. S4S LUMBER 3'-4 3/4 " LG.)

REV. NO.	DATE	BY	JO/EWO	DESCRIPTION	CHKD.	CERT.	APPD.
02	MAY92	FOR		DRAWING DIGITIZED INTO CADD DATABASE WITHOUT CHANGES			

SAUDI ARABIAN OIL COMPANY			
DRAWN BY EJC CHECKED BY SCALE: 1 TO 12			
DATE STARTED 04-17-53 DATE COMPLETED			
OPR'G. DEPT. ENG. DEPT. ORIGINAL SIGNED			
APPD. FOR CONST.			
THIS DRAWING IS NOT TO BE USED FOR CONSTRUCTION OR FOR ORDERING MATERIAL UNTIL CERTIFIED AND DATED		CERTIFIED BY DATE	
LAYOUT & DETAILS			
STANDARD FIRE HOSE HOUSE			
STD. DWG.			
PLANT NO.	DRAWING NUMBER	SHT. NO.	REV. NO.
990	S AA-036506	001	02