




03	100	112936717	S	990
PLANT NO.	INDEX	DRAWING NUMBER	SHT. NO.	REV. NO.

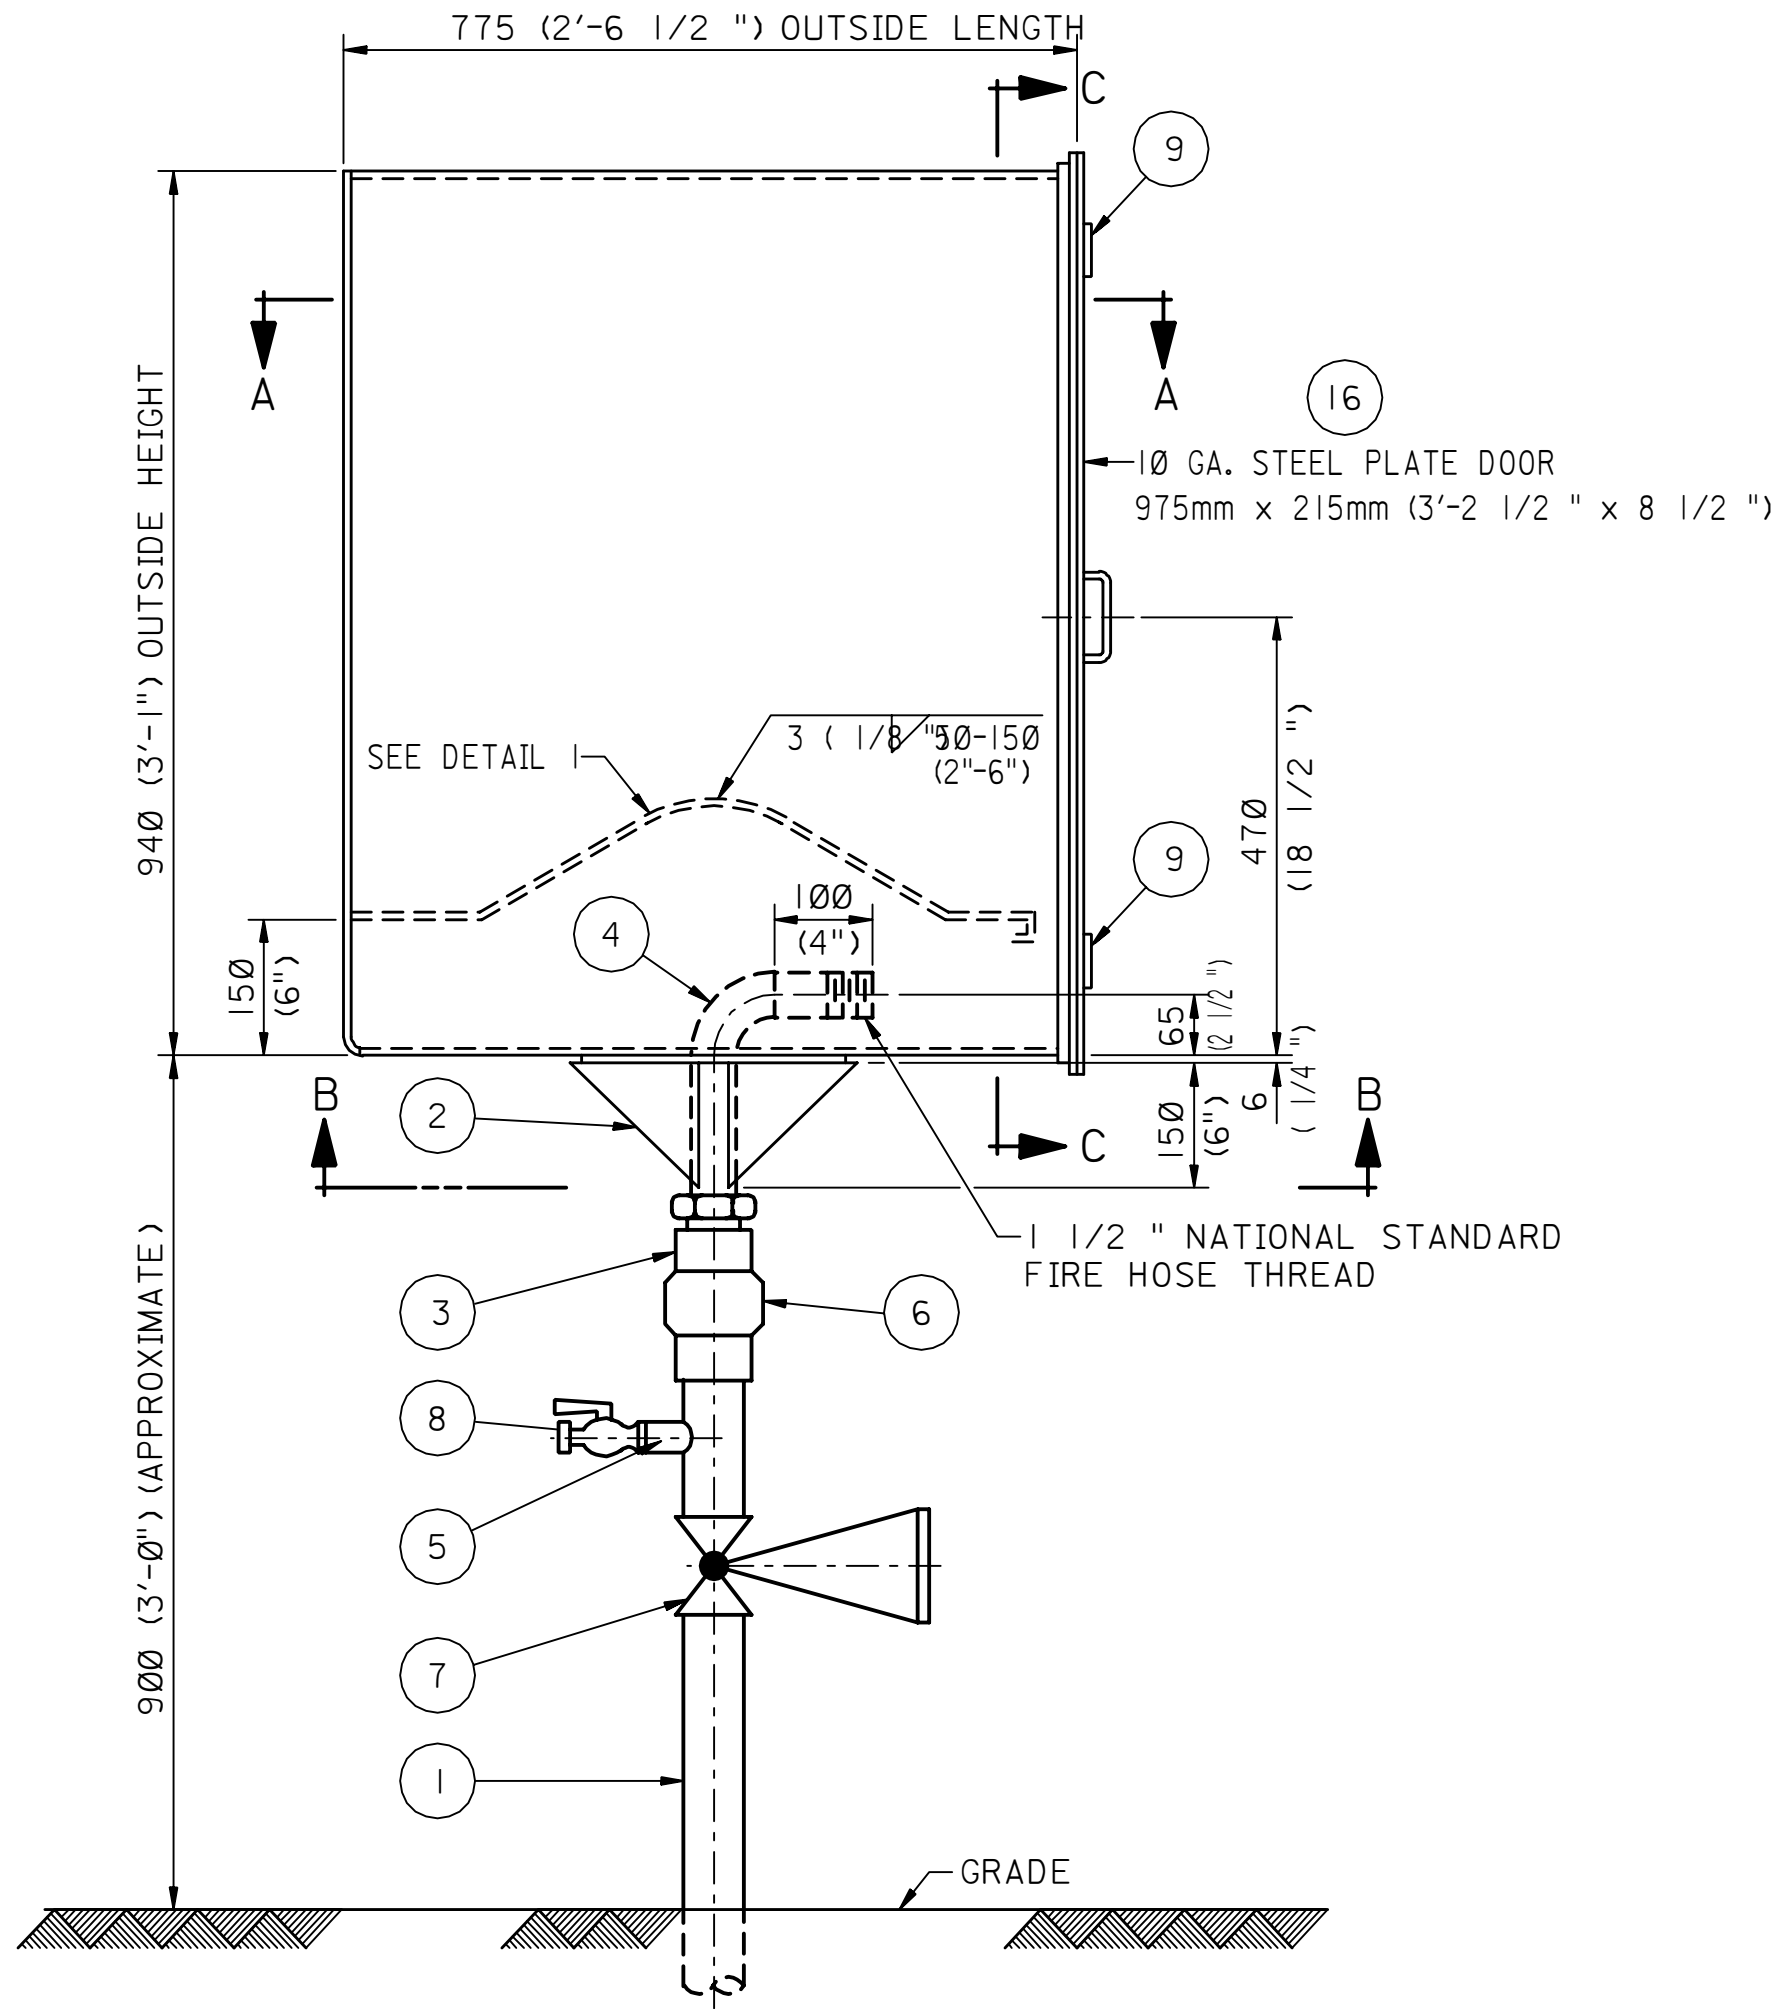


ELEVATION

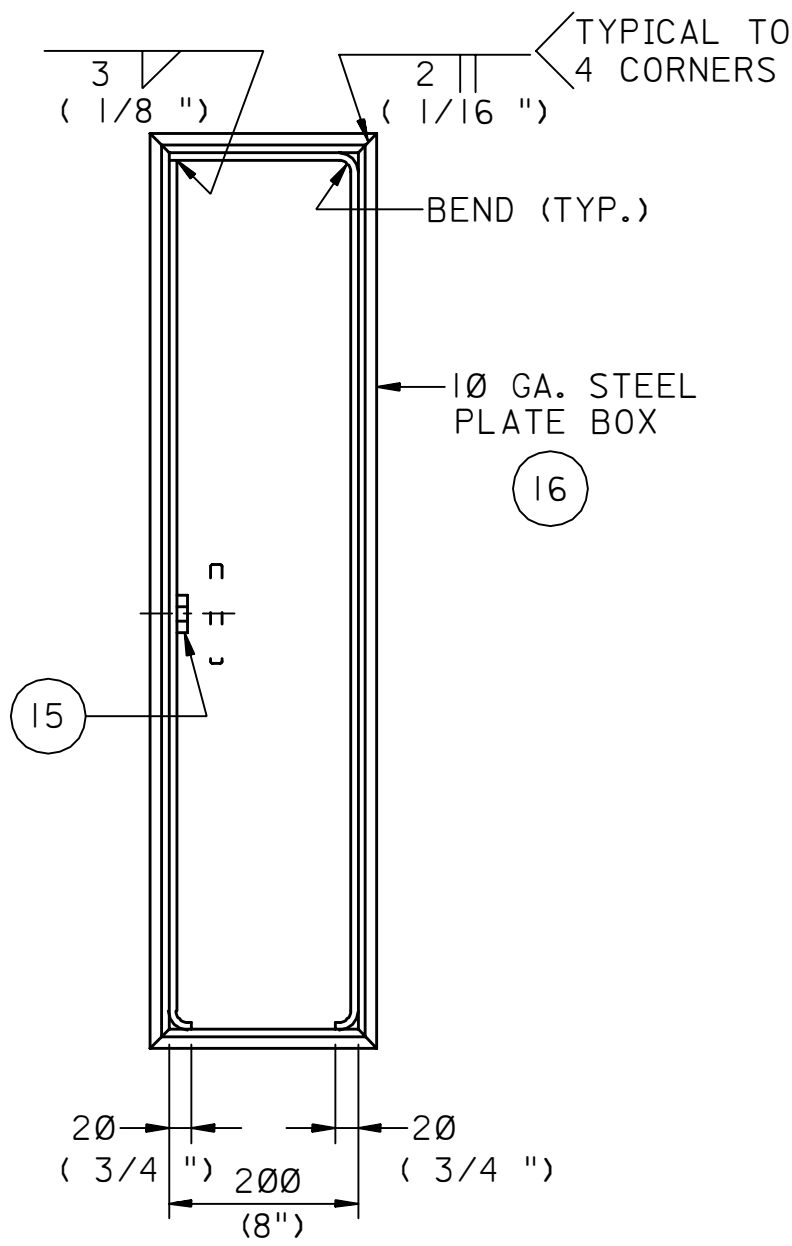


SECTION C-C

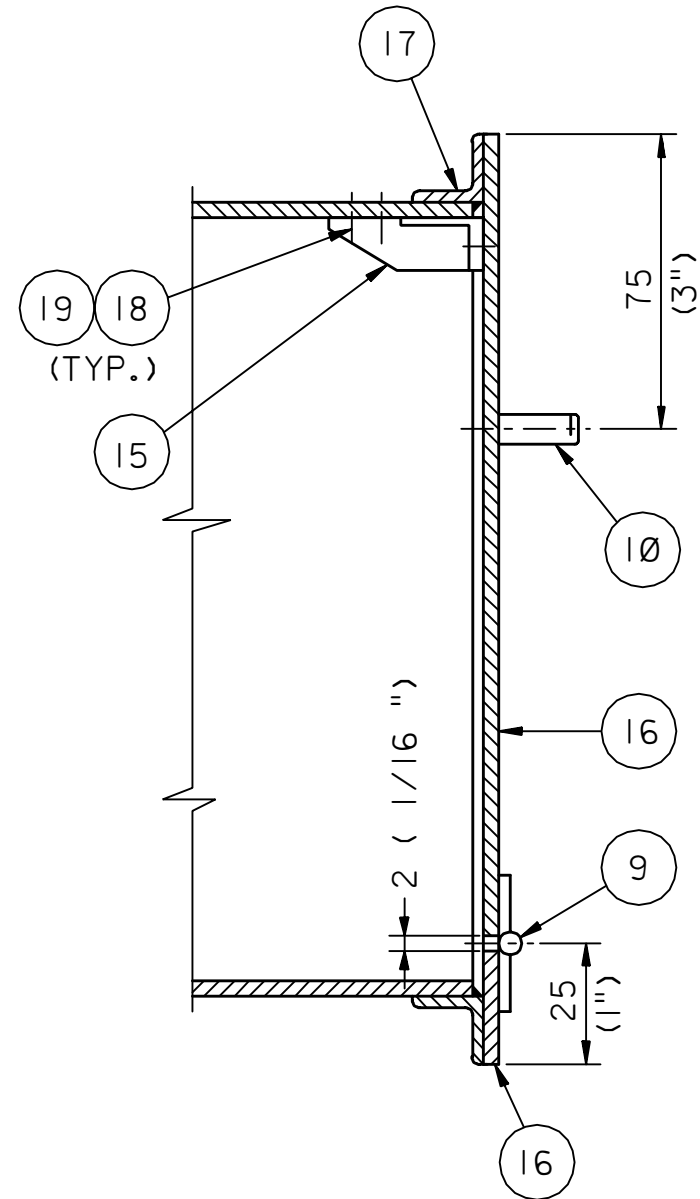


DETAIL-2

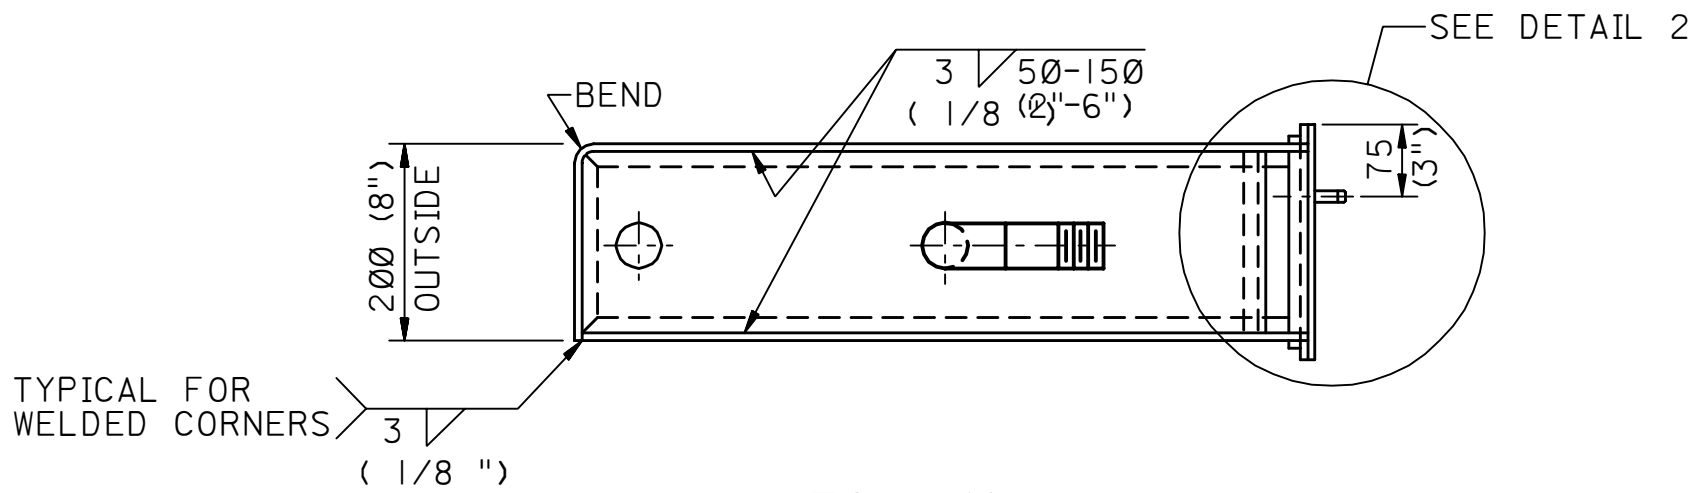


SECTION A-A

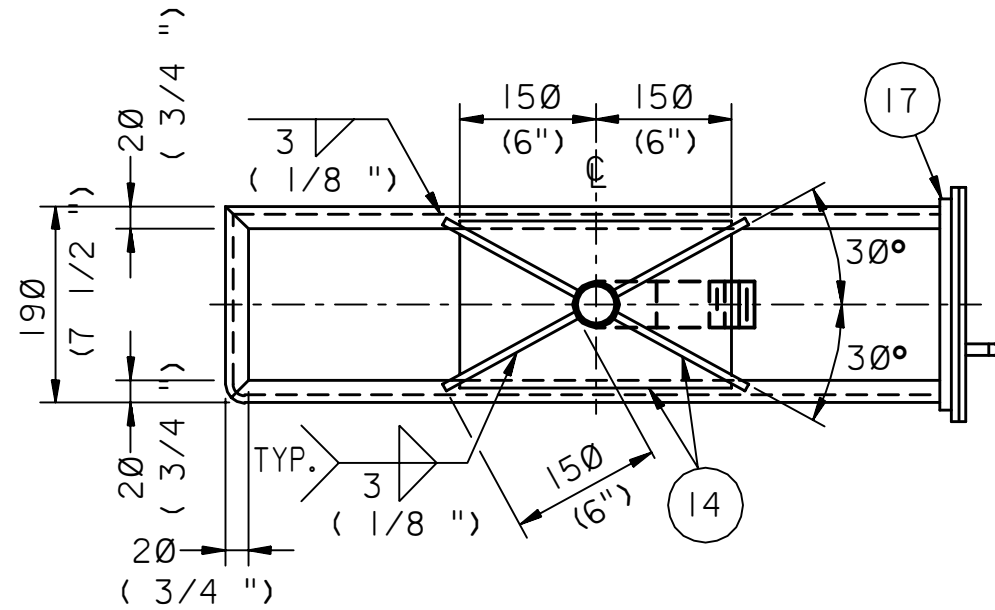

SECTION B-B

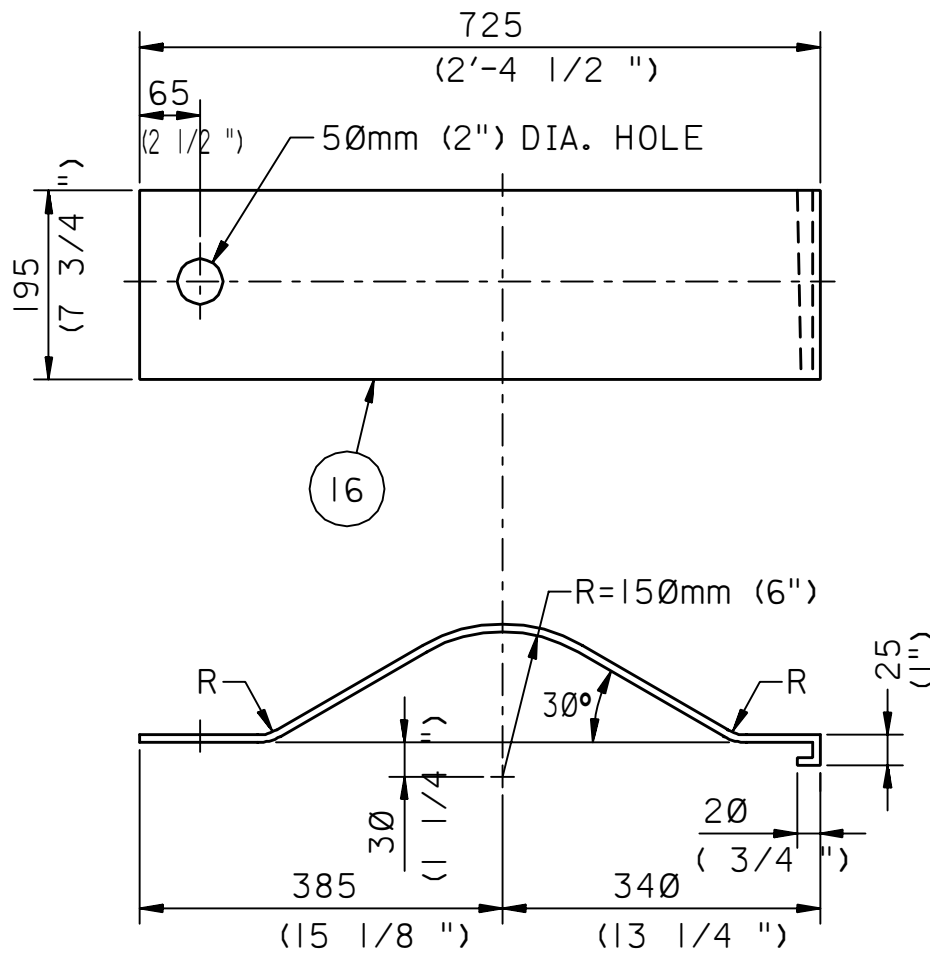

DETAIL-1

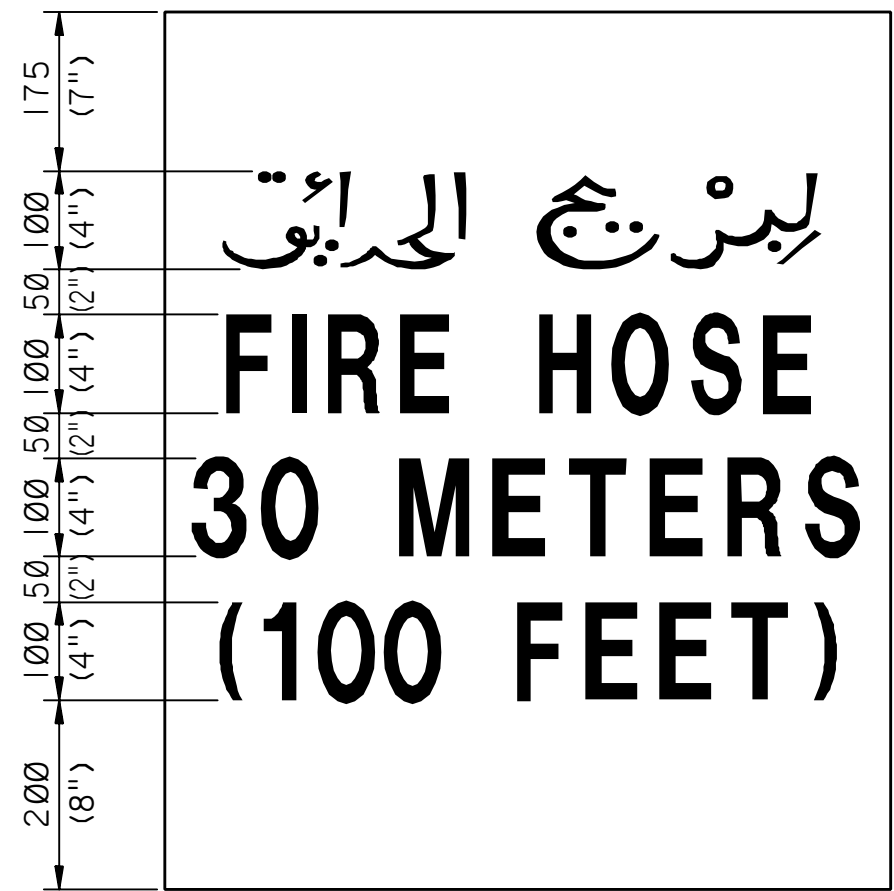

DETAIL-3

NOTES:

- SUPPLY HOSE, NOZZLE, AND HOSE THREAD ADAPTER FOR 1 1/2 " NATIONAL STANDARD FIRE HOSE THREAD, UNLESS SPECIFIED OTHERWISE TO CONFORM TO LOCAL PRACTICE.
- UNLESS OTHERWISE SPECIFIED, SUPPLY 1 1/2 " COMBINATION FOG AND STRAIGHT STREAM NOZZLES.
- OUTSIDE OF BOX TO BE PAINTED WITH ONE LAYER OF PRIMER AND ONE LAYER OF RED ENAMEL.
- STENCIL ON BOTH SIDES OF BOX (MK. 717A) AND ON ONE SIDE OF BOX (MK. 717B) 'FIRE HOSE - 30 METERS (100 FEET)' IN ACCORDANCE WITH DETAIL 3 - USE WHITE ENAMEL.
- ALL DIMENSIONS ARE IN MILLIMETERS UNLESS NOTED OTHERWISE.

CONSTRUCTION NOTES

MK. 717A TO BE MADE AS SHOWN
MK. 717B TO BE MADE AS SHOWN, BUT WITHOUT SWIVEL JOINT (ITEM 6)
FOR WALL MOUNTING FASTEN TO WALL WITH BOLTS OR LAG SCREWS, USING SPACE BLOCKS.
HINGE DOOR ON SIDE NEAREST TO WALL

MATERIAL CODE

ITEM NO.	QUANTITY	UNIT	STOCK NUMBER	DESCRIPTION
	MK. 717A	MK. 717B		
1	5	5	FT	01-167-145 2" STEEL PIPE, SCH. 80
2	1	1	FT	01-165-080 1 1/2 " STEEL PIPE, SCH. 80
3	1	1	EA	02-062-960 2"x1 1/2 " BUSHING, STEEL
4	1	1	EA	02-269-673 1 1/2 " THRD. 90° ELBOW, STEEL
5	1	1	EA	02-455-390 1/4 " WELDING BOSS
6	1		EA	02-877-067 2" SWIVEL JOINT
7	1	1	EA	02-424-188 2" THRD. GL. VA., BRASS, CLASS 150
8	1	1	EA	04-678-088 1/4 " PETCOCK
9	2	2	EA	09-046-724 1 1/2 " WROUGHT STL. HINGE
10	1	1	EA	09-095-328 6 1/2 "x1 3/16 " W. STL. DOOR PU
11	1	1	CN	09-630-773 RED ENAMEL
12	1	1	CN	09-630-785 WHITE ENAMEL
13	1	1	CN	09-708-133 PRIMER, ZINC CHROMATE
14	1	1	SF	12-065-059 PLATE, 1/4 " THICK
15	1	1	EA	DOORCATCH
16	1	1	SH	12-157-726 STEEL SHEET, 10 GA.
17	1	1	FT	12-408-908 L 3/4 " x 3/4 " x 1/2 "
18	4	4	EA	11-404-914 NO. 8 MACHINE SCREW x 1" LONG
19	4	4	EA	10-615-031 NO. 8 NUT

TYPICAL INSTALLATION DRAWING

SAUDI ARABIAN OIL COMPANY

DRAWN BY _____ CHECKED BY _____ SCALE _____
DATE STARTED _____ DATE COMPLETED _____
OPR'G. DEPT. _____ ENG. DEPT. _____
APP'D FOR CONSTR. _____

THIS DRAWING IS NOT TO BE USED FOR CONSTRUCTION OR FOR ORDERING MATERIAL UNTIL CERTIFIED AND DATED
CERTIFIED BY _____ DATE _____

STEEL FIRE HOSE BOX

WITH VERTICAL SWIVEL OR FOR WALL MOUNTING
FOR 30 METERS (100 FT.) OF 1 1/2 " HOSE
STD. DWG. METRIC

PLANT NO.	INDEX	DRAWING NUMBER	SHT. NO.	REV. NO.
990	S	AB-036717	001	03