




10	100	218930-BV	M	066
PLANT NO.	INDEX	DRAWING NUMBER	SHT. NO.	REV. NO.

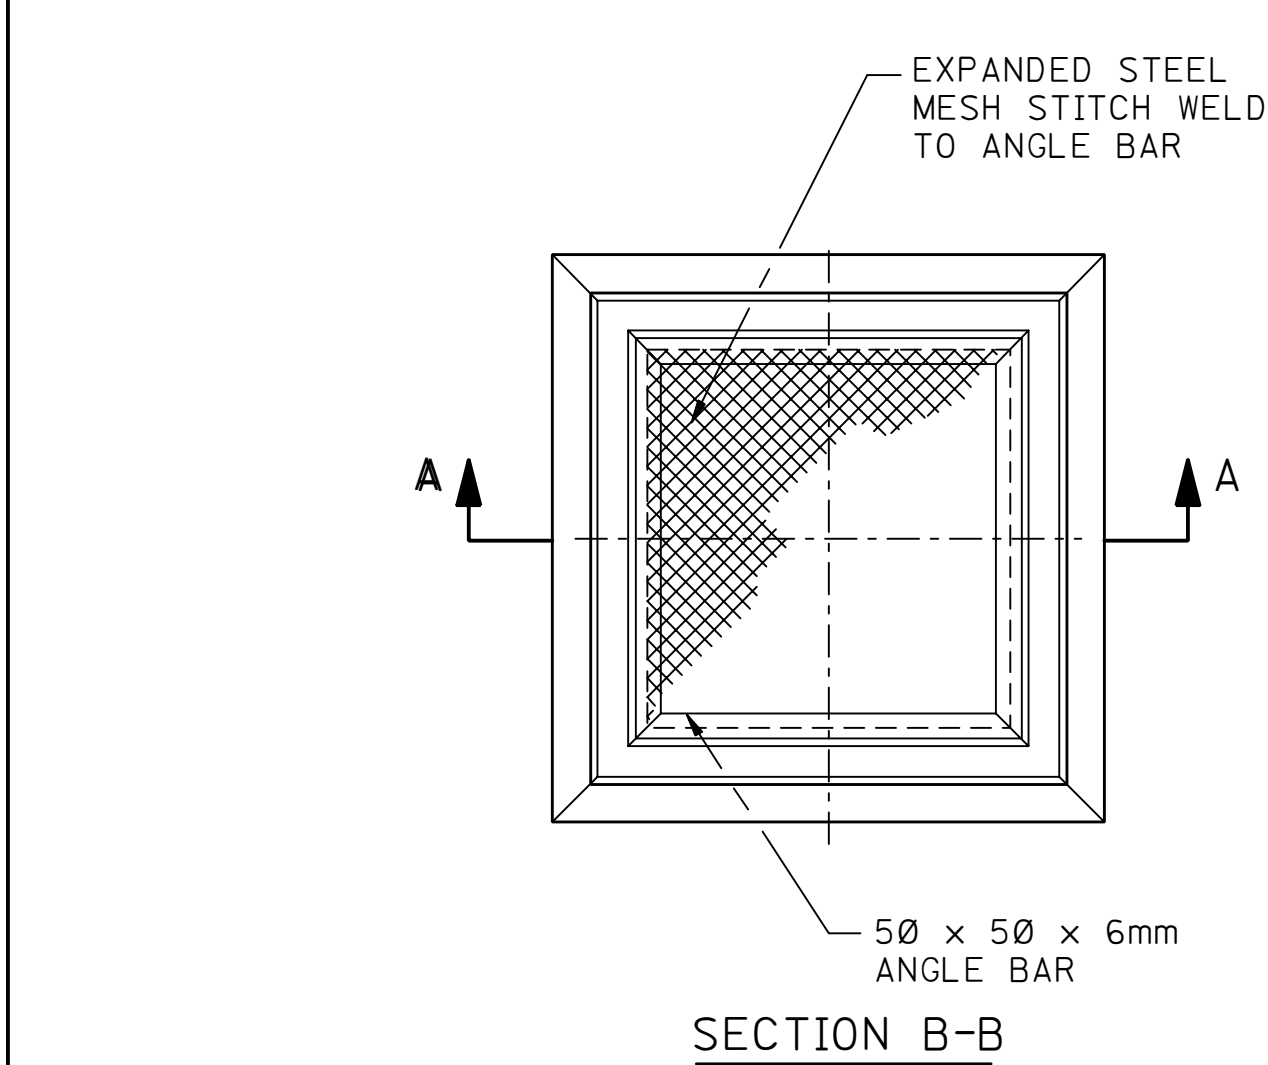


SECTION B-B

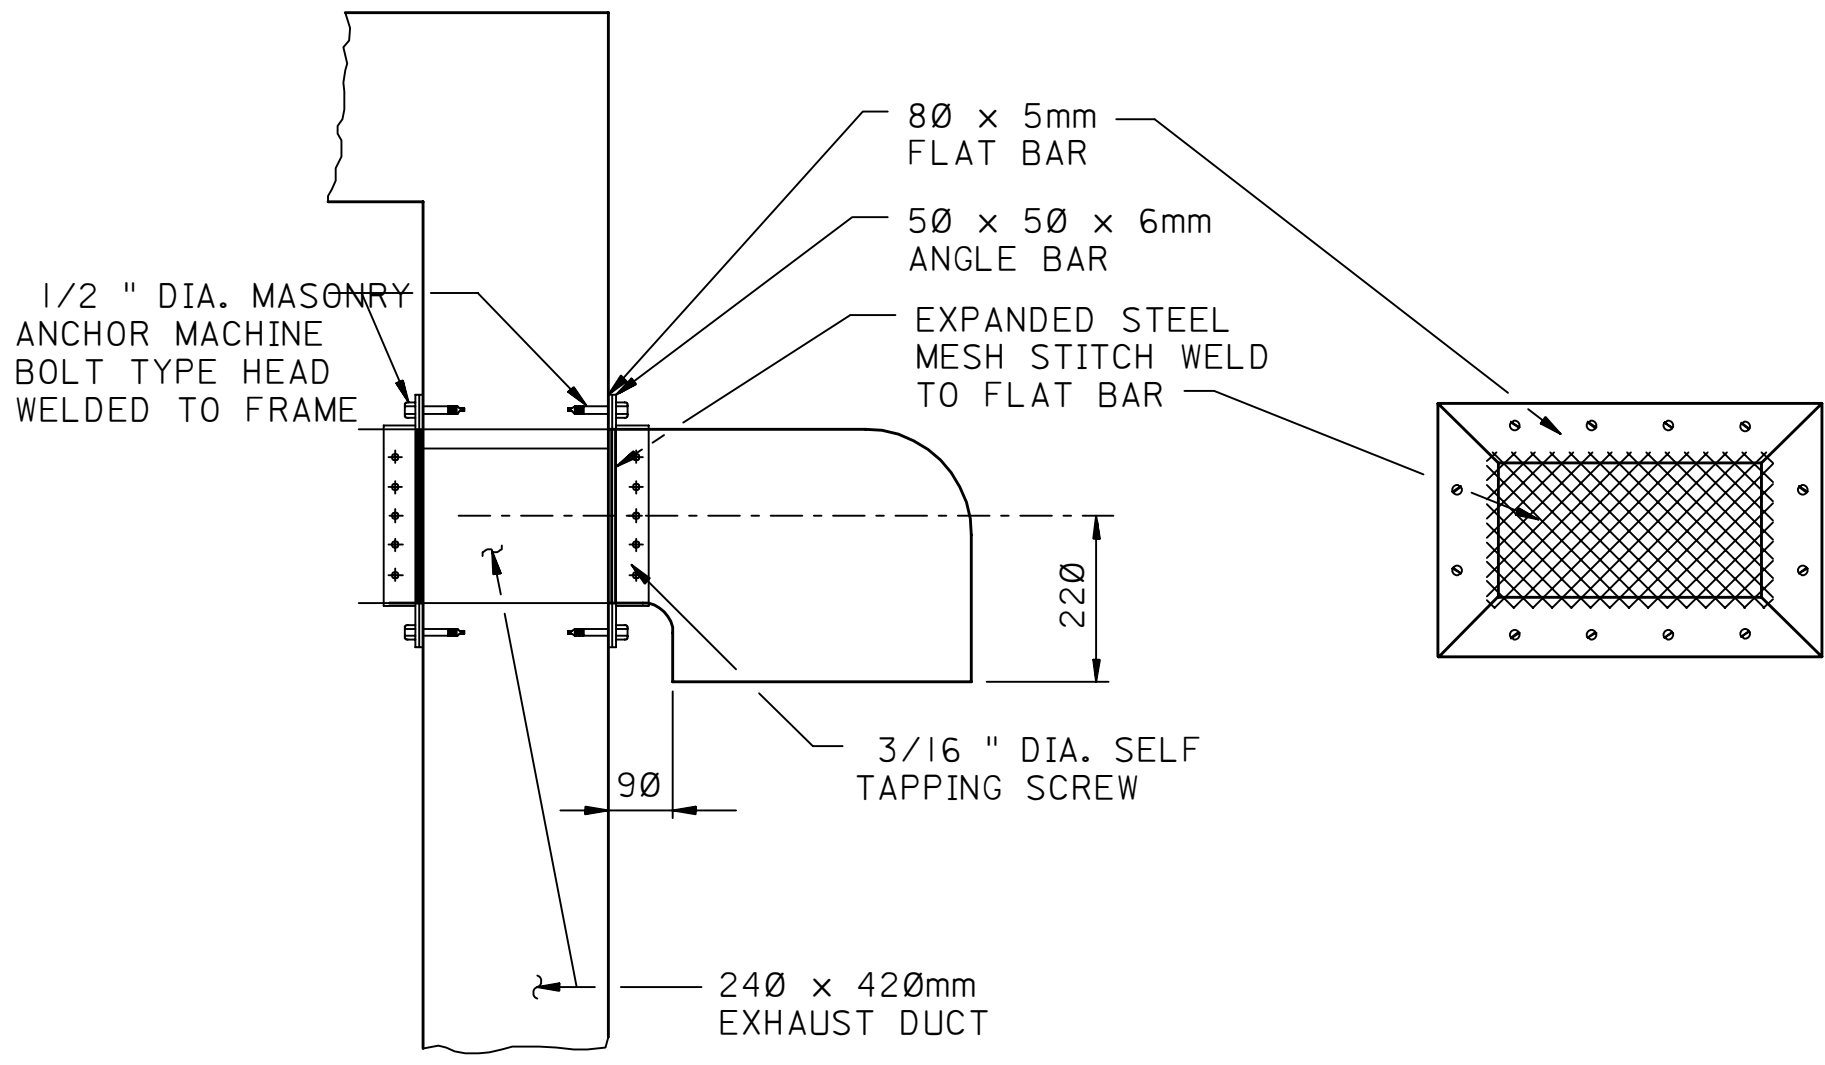

DETAIL 2
EXHAUST DUCT

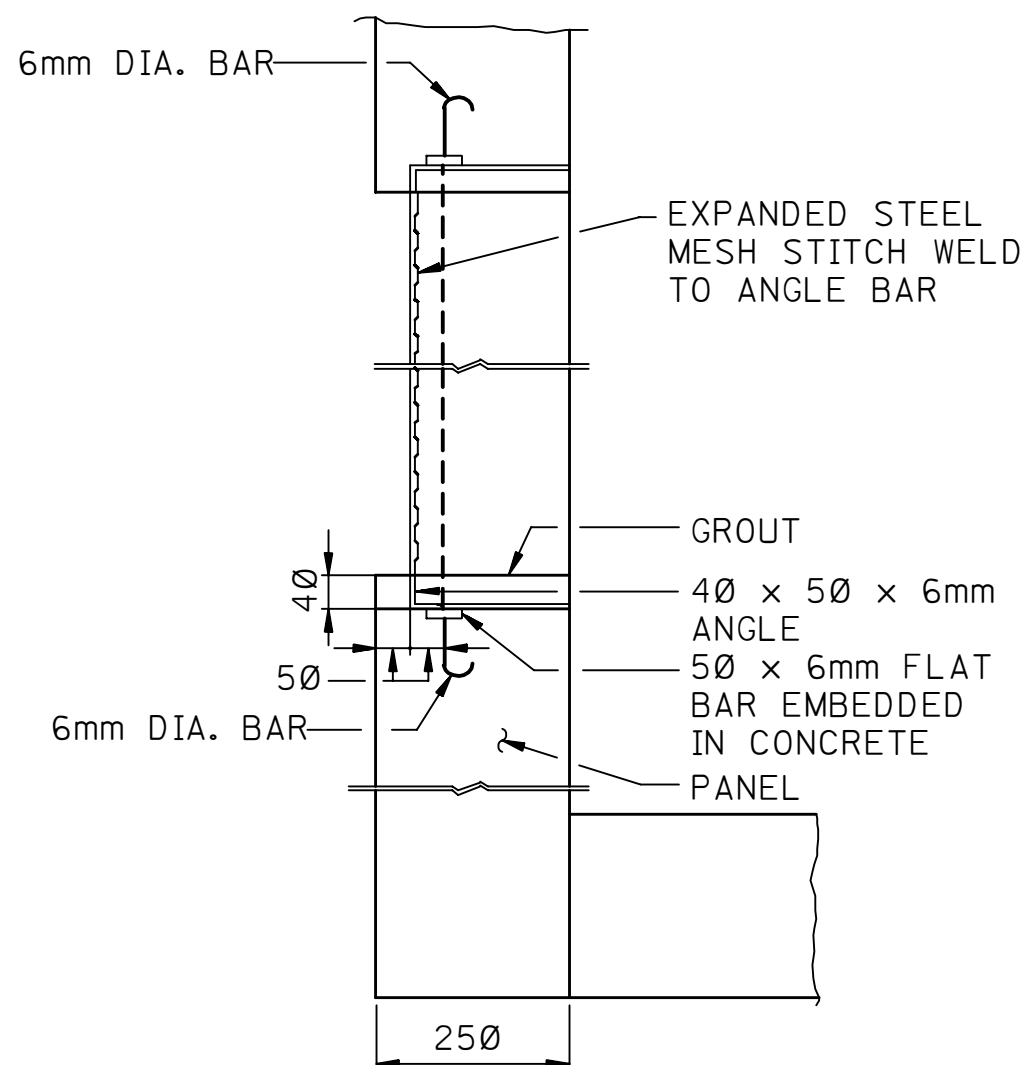


DETAIL 3
GENERAL OPENING

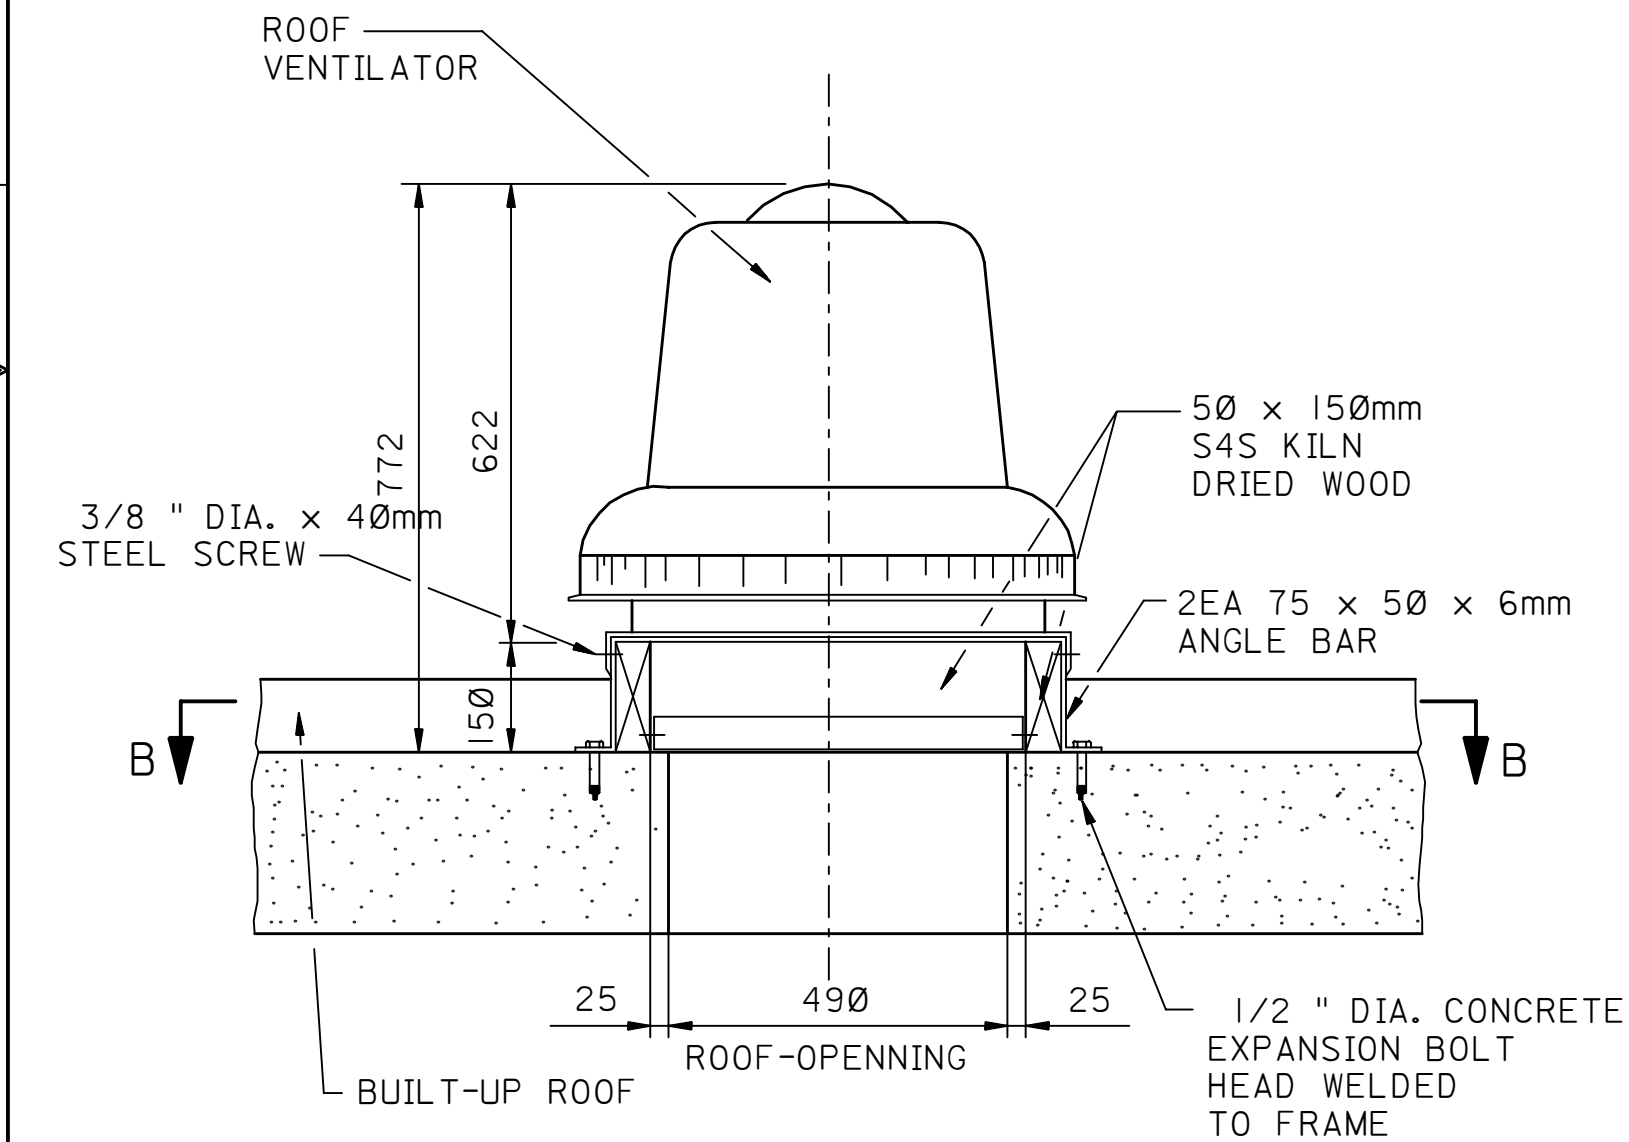

SECTION A-A


DETAIL 1
ROOF FAN

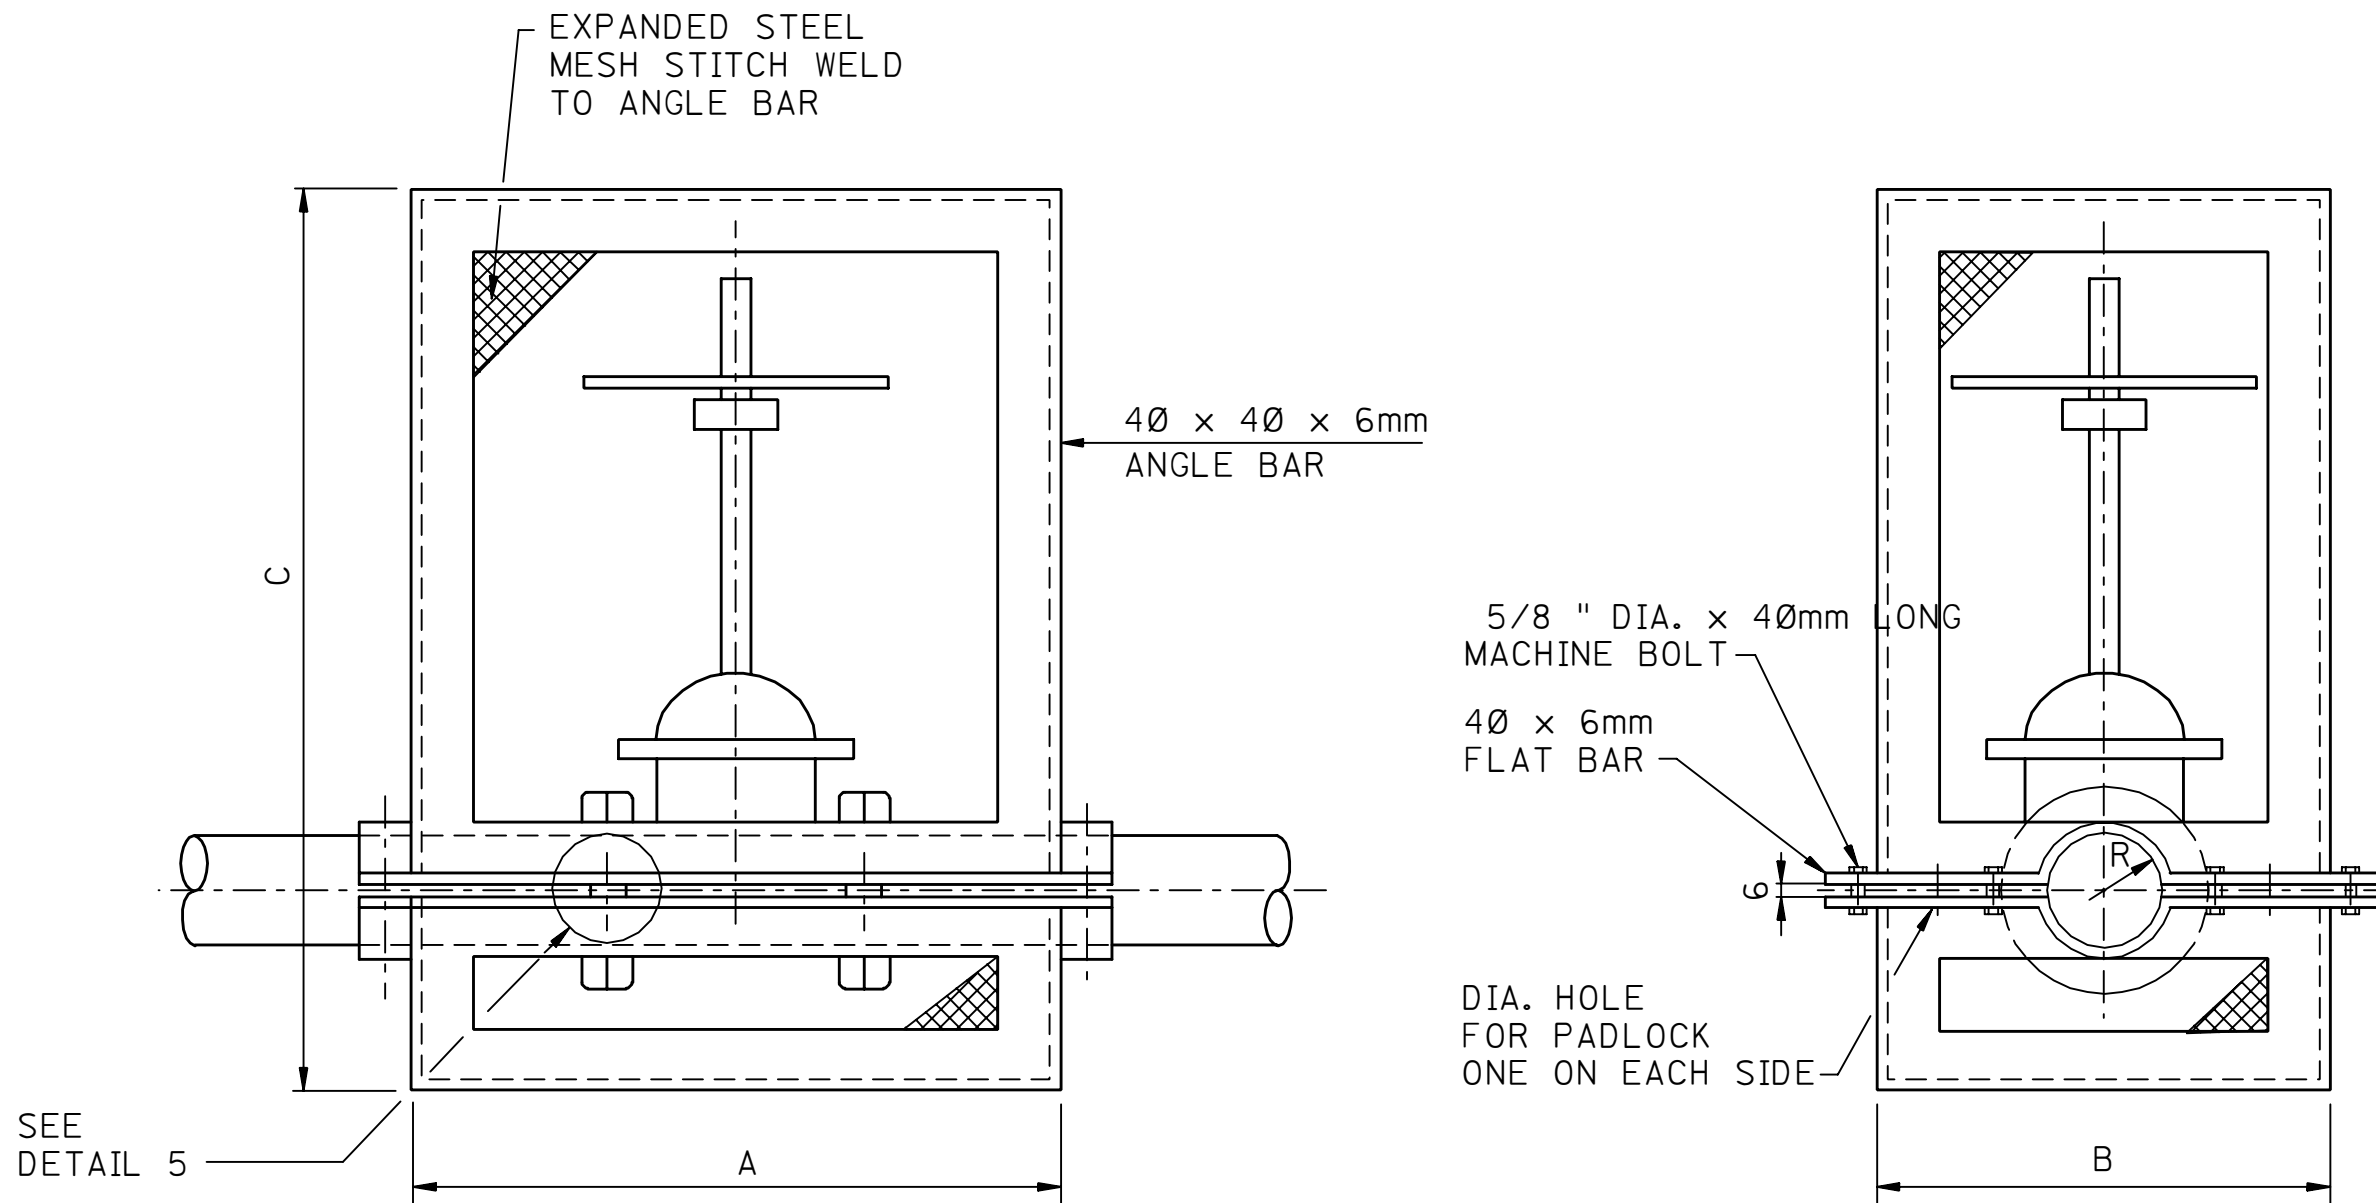

VALVE DIA.	A mm	B mm	C mm	R mm
2"	410	310	600	35
3"	450	330	730	45
4"	490	360	870	57

CAGING FOR LARGER VALVES SHALL BE DONE ON AN INDIVIDUAL PROJECT BASIS

DETAL 4
VALVE CAGING

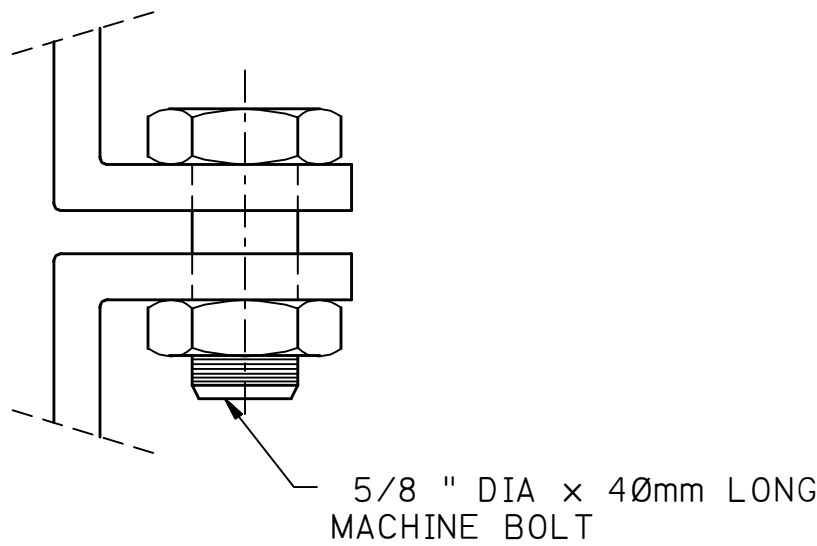

DETAL 5
MACHINE BOLT

- NOTES:
1. DETAILS SHOWN ARE TYPICAL. DIMENSIONS MAY VARY WITH EQUIPMENT TO BE INSTALLED.
 2. TYPICAL OPENINGS SHALL BE PROTECTED BY EXPANDED METAL MESH PER SSD/20; AES-0-120; SSD/9 AND AES-0-109.
 3. DETAIL CONFIGURATION IS DEPENDENT UPON FUNCTIONAL REQUIREMENTS.
 4. IN CASE OF CONFLICT BETWEEN THIS STANDARD DRAWING AND THE ARAMCO STANDARDS (AES-0-SERIES), THE ARAMCO SECURITY STANDARDS SHALL GOVERN.
 5. DIMENSIONS ARE IN MILLIMETERS UNLESS NOTED OTHERWISE.

REFERENCE DRAWING	
BUILDING FOR HOUSING VITAL EQUIPMENT	AA-036758

CONFIDENTIAL	
TYPICAL INSTALLATION DRAWING	

Ø1	JUN92	ESSD EPE	DRAWING SCANNED INTO CADD DATABASE WITHOUT CHANGES		
REV. NO.	DATE	BY	JO/EWO	DESCRIPTION	CHKD. CERT. APPD.

SAUDI ARABIAN OIL COMPANY					
DRAWN BY	G.M. PETER	CHECKED BY	P.T.	SCALE	NONE
DATE STARTED	APRIL '83	DATE COMPLETED			
OPR'G. DEPT.		ENG. DEPT.		ORIGINAL SIGNED	
APP'D FOR CONSTR.					

THIS DRAWING IS NOT TO BE USED FOR CONSTRUCTION OR FOR ORDERING MATERIAL UNTIL CERTIFIED AND DATED	CERTIFIED BY DATE
--	-------------------

DETAILS OF LOUVER MESH SCREEN AND VALVE CAGING (SSD/10; AES-0-110)				
STD. DWG.			METRIC	
PLANT NO.	INDEX	DRAWING NUMBER	SHT. NO.	REV. NO.
990	M	AB-036817	001	01