


10	100	600920-04	S	066
REV. NO.	SHEET NO.	DRAWING NUMBER	INDEX	PLANT NO.

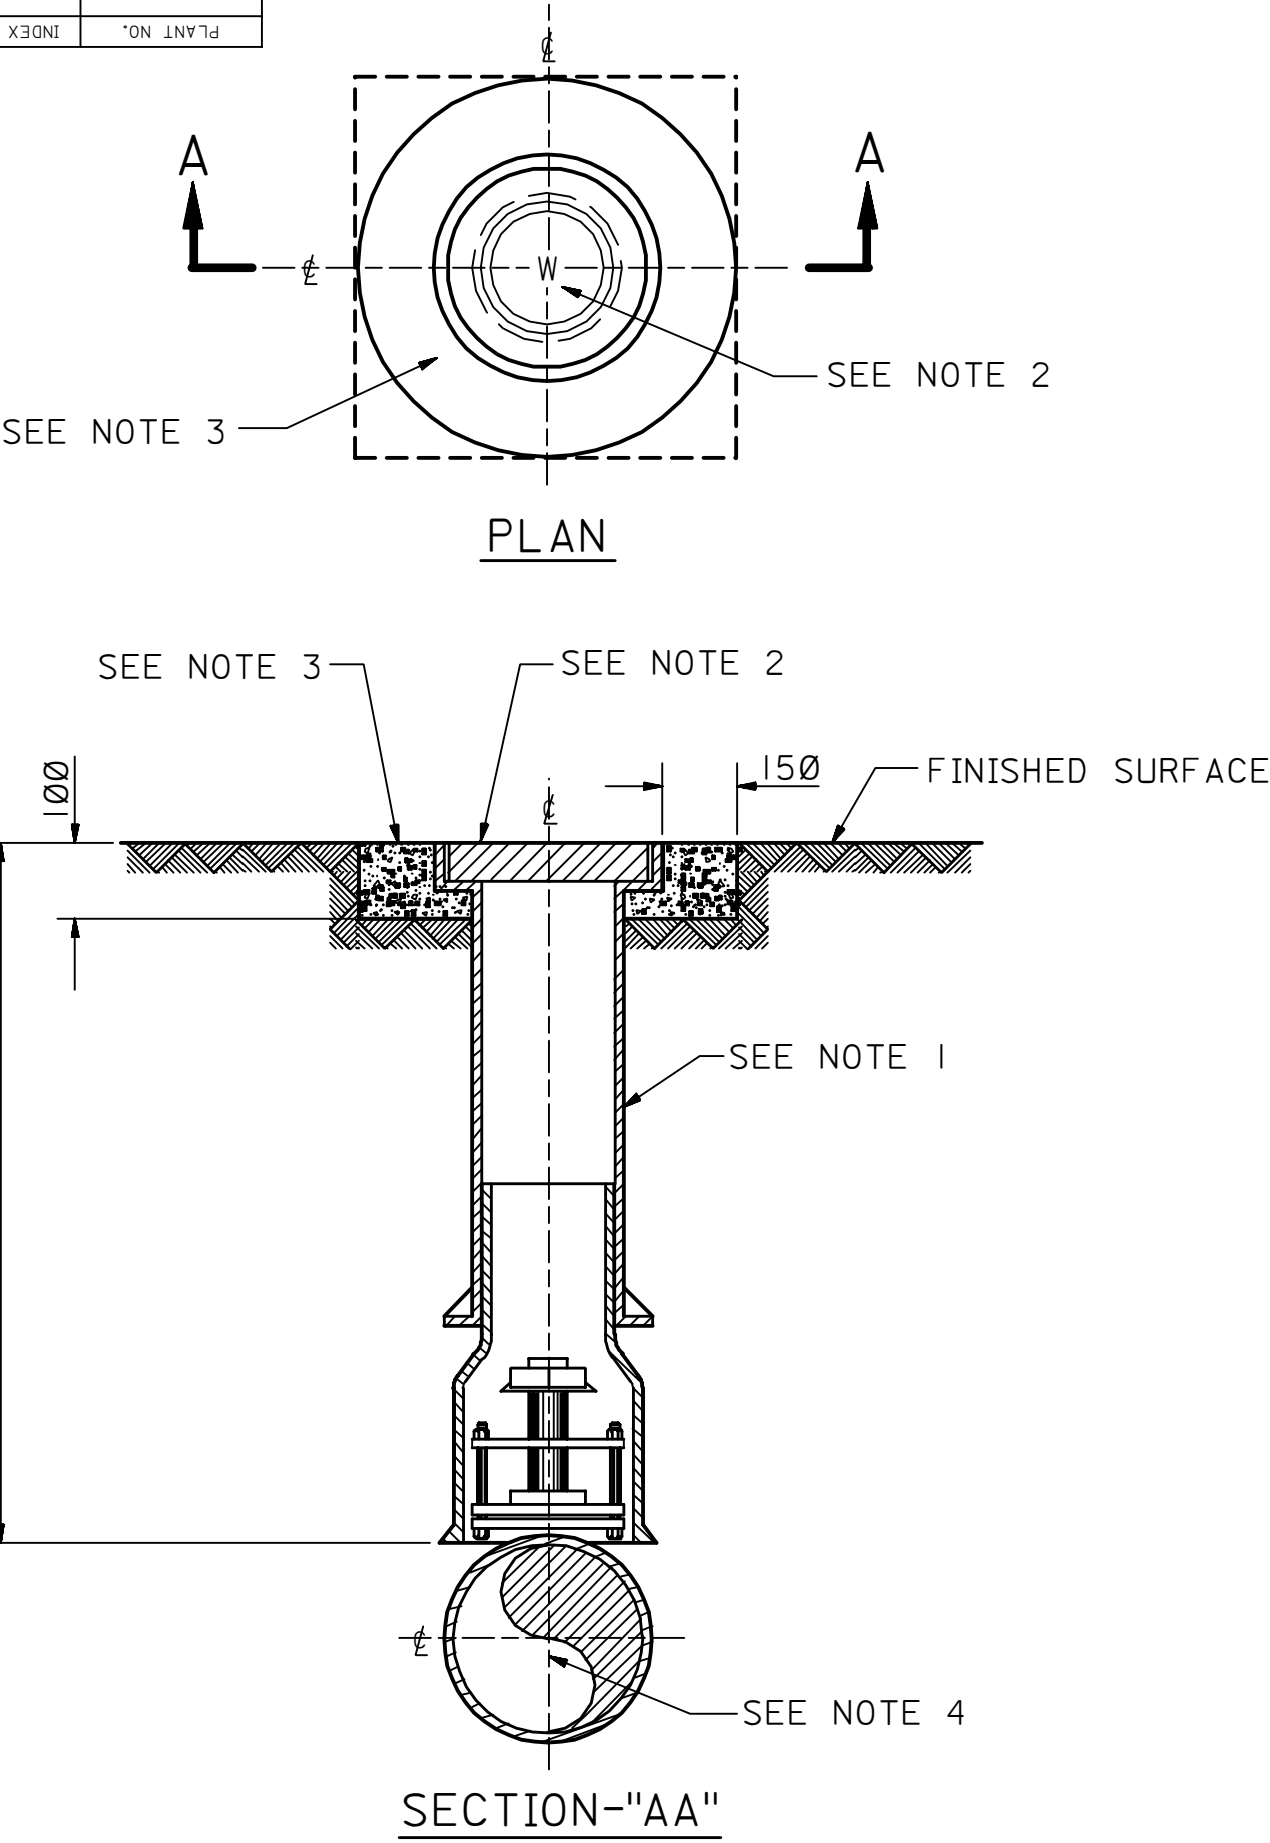

GENERAL NOTES

1. CAST IRON OR PLASTIC SLIDINGTYPE TELESCOPE VALVE BOX.
2. CAST IRON COVER WITH WORD "WATER" OR LETTER "W".
3. PROVIDE CONCRETE COLLAR IF THE VALVE BOX IS NOT IN A PAVED AREA OR IF VALVE BOX IS PLASTIC (REGARDLESS OF LOCATION). ROUND OR SQUARE CONFIGURATION IS OPTIONAL.
4. VALVES SHALL BE NON-RISING STEM TYPE WITH OPERATING NUT.
5. VALVES SERVING ANY FIRE EQUIPMENT OR CONNECTED TO ANY FIREWATER SYSTEM SHALL BE INSTALLED WITH POST INDICATOR AS REQUIRED BY SAES-B-007A.

MANDATORY DRAWING

01	MAY'95	ESSD RLO		REVISED NOTES AND ADDED NOTE-5.			
REV. NO.	DATE	BY	JO/EWO	DESCRIPTION	CHKD.	CERT.	APPD.

SAUDI ARABIAN OIL COMPANY

DRAWN BY RLO CHECKED BY SCALE
DATE STARTED 08-31-86 DATE COMPLETED 08-31-86
OPRG. DEPT. ENG. DEPT.
APPD. FOR CONSTR.

THIS DRAWING IS NOT TO BE USED FOR
CONSTRUCTION OR FOR ORDERING
MATERIAL UNTIL CERTIFIED AND DATED

CERTIFIED
BY DATE

WATER LINE VALVE DIRECT BURIED

STD. DWG. METRIC

PLANT NO.	INDEX	DRAWING NUMBER	SHEET NO.	REV. NO.
990	S	AD-036009	001	01