

CHAPTER 8. COMBUSTION TURBINE INLET COOLING

POWER OUTPUT capacity of all combustion turbines (CTs) varies with ambient air temperature and site elevation. The rated capacities of all CTs are based on standard ambient air at 59°F, 60% rh, 14.7 psia at sea level, and zero inlet and exhaust pressure drops, as selected by the International Organization for Standardization (ISO). For all CTs, increased ambient air temperature or site elevation decreases power output; increased ambient air temperature also reduces fuel efficiency (i.e., increases the heat rate, defined as fuel energy required per unit of electric energy produced). However, the extent of the effect of these changes on output and efficiency varies with CT design. This chapter provides a detailed discussion on combustion turbine inlet cooling (CTIC). Additional information on applying CTIC to combined heat and power systems (cogeneration) is provided in [Chapter 7](#).

There are two types of CTs: aeroderivative and industrial/frame. [Figures 1 and 2](#) show typical effects of ambient air temperature on power output and heat rate, respectively, for these types of turbines. The actual performance of a specific CT at different inlet air temperatures depends on its design. [Figures 1 and 2](#) show that aeroderivative CTs are more sensitive to ambient air temperature than are industrial/frame CTs. [Figure 1](#) (Punwani and Hurlbert 2005) shows that, for a typical aeroderivative CT, an increase in inlet air temperature from 59 to 100°F on a hot summer day decreases power output to about 81% of its rated capacity; a loss of 19% of the rated capacity. [Figure 2](#) (Punwani 2003) shows that, for the same change in ambient air temperature, the heat rate of a typical aeroderivative CT increases (i.e., fuel efficiency decreases) by about 4% of the rated heat rate at ISO conditions. Increasingly, industrial/frame CTs are using aeroderivative technology to improve performance; thus, their performance curves are moving toward those of the classic aeroderivative CT.

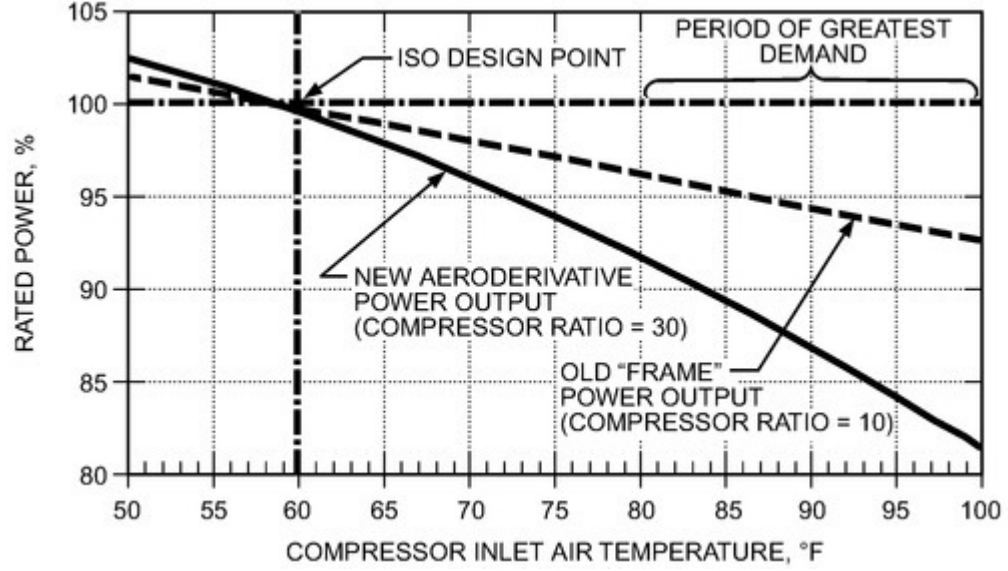


Figure 1. Effect of Ambient Temperature on CT Output (Punwani and Hurlbert 2005)

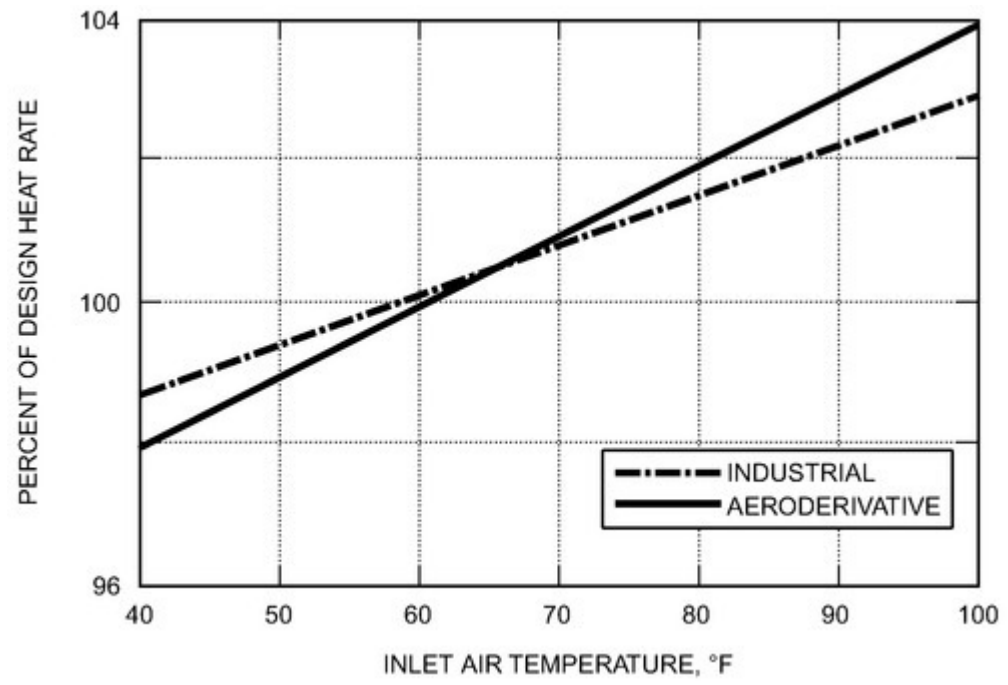


Figure 2. Effect of Ambient Temperature on CT Heat Rate (Punwani 2003)

In cogeneration and combined-cycle systems that use thermal energy in CT exhaust gases for steam generation, heating, cooling, or more power generation, increases in ambient air temperature also reduce the total thermal energy available for these applications, as shown in [Figure 3](#) (Orlando 1996).

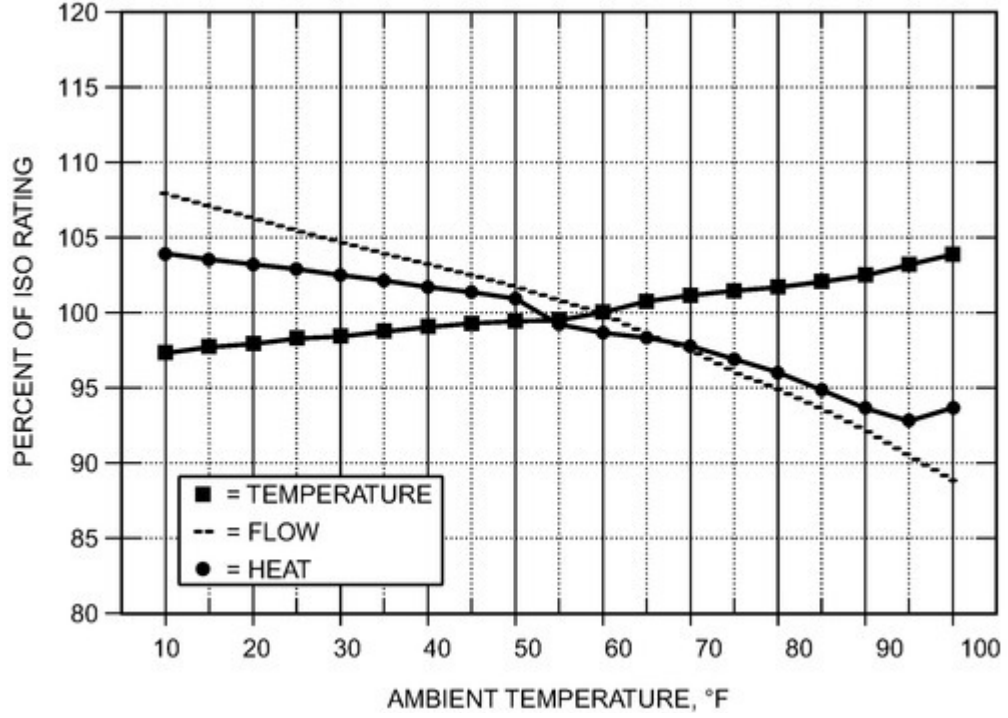


Figure 3. Effects of Ambient Temperature on Thermal Energy, Mass Flow Rate and Temperature of CT Exhaust Gases (Orlando 1996)

CTs in simple- and combined-cycle systems are particularly qualified to meet peak electricity demand because of their ability to start and stop more quickly than steam-turbine-based thermal power generation systems using coal, oil or gas, and nuclear plants. For fossil fuel power generation, combined-cycle systems are the most fuel efficient (lowest heat rate of typically 7000 Btu/kWh) and steam-turbine-based systems are the least efficient (highest heat rate range between 12,000 to 20,000 Btu/kWh, depending on turbine age). A typical heat rate for a simple-cycle system is about 10,000 Btu/kWh. Therefore, to minimize fuel cost for power generation, the preferred order of dispatching power to meet market demand is to operate combined-cycle systems first, simple-cycle systems next, and older and oil-fired steam turbines as the last resort.

Electric power demand is generally high when ambient temperatures are high. An example of an hourly profile of ambient temperature, system load, and CT output is shown in [Figure 4](#) (Punwani and Hurlbert 2005).

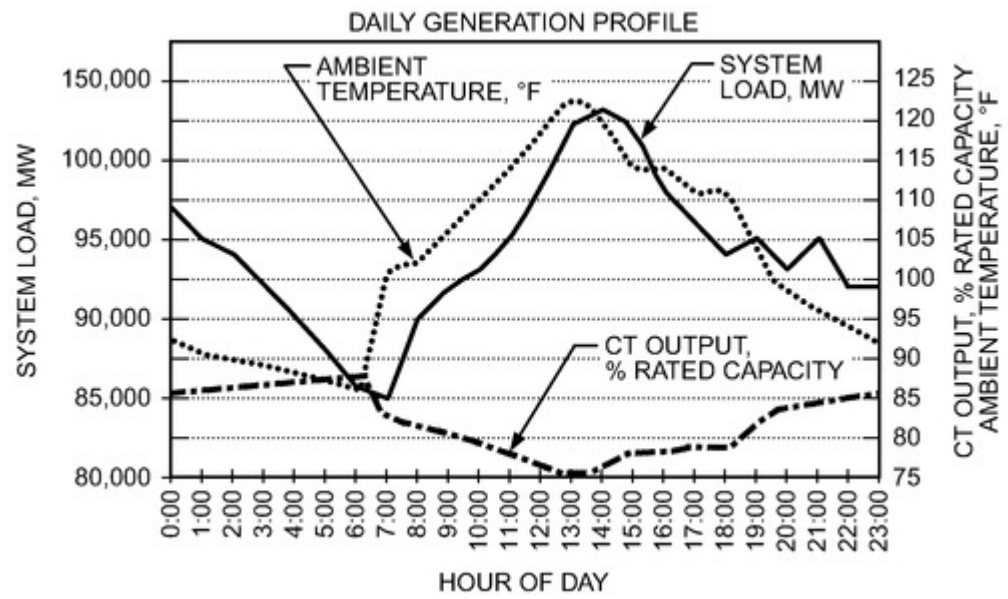


Figure 4. Typical Hourly Power Demand Profile (Punwani and Hurlbert 2005)

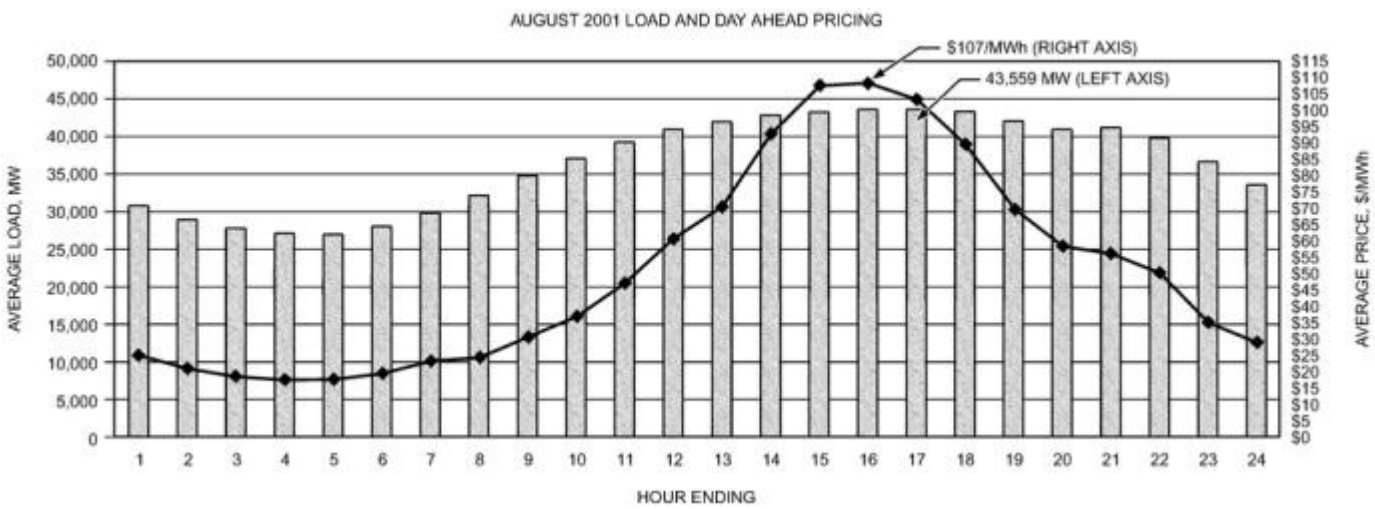


Figure 5. Example of Daily System Load and Electric Energy Pricing Profiles (Hilberg 2006)

When high ambient temperatures drive up power demand, the use of less efficient (high-fuel-cost) generation plants is required and that drives up the market price of electric energy. [Figure 5](#) (Hilberg 2006) shows the hourly load profile in one U.S. region for a single day in the summer. Although the peak electricity demand increases by 80%, the peak power price increases by over 400%. [Figures 4 and 5](#) show that power output capacity decreases just when it is most needed, and when power is also most valuable.

The trends shown in [Figures 4 and 5](#) are not unique to the United States. The Middle East is seeing much higher growth rates in power demand, and that demand is also directly linked to hot-weather power usage. In some countries in the Middle East, over 40% of power usage is linked to air conditioning.

CTIC is used by thousands of CT-based power plants to overcome the ill effects of increased ambient temperature on CT performance. It can provide economic and environmental benefits for plant owners, ratepayers, and the general public.

1. ADVANTAGES

CTIC offers economic as well as environmental benefits.

Economic Benefits

- Maximizes power output when most needed and most valuable
- Reduces capital cost (\$/kW) for incremental capacity
- Increases CT fuel efficiency (lowers heat rate)
- Minimizes use of less-efficient steam-turbine-based systems, thus helping to minimize increase in rates to electricity users

Environmental Benefits

- Allows minimum use of inefficient and polluting power plants by allowing maximum use of efficient and cleaner CT plants
 - Conserves natural fuel resources
 - Reduces emissions of pollutants (SO_x, NO_x, particulates, and hydrocarbons)
 - Reduces emissions of global warming/climate change gas (CO₂)
- Minimizes/eliminates new power plant siting issues

Emissions reductions from CTIC result from its displacement of the higher-heat-rate steam turbine peaker power plants, as shown in an example in [Table 1](#).

CTIC helps reduce the carbon footprint of energy use in two ways: it (1) improves the CT's energy efficiency and (2) increases the generation capacity of higher-efficiency systems and thus eliminates or minimizes use of less-efficient power generation systems.

There are four major types of thermal power generation systems:

- Combined cycle (CC)
- Simple cycle (SC)
- Combined heat and power (CHP) or cogeneration
- Steam turbine

Electric power generation efficiencies of these systems are typically in the ranges of 48 to 55% (i.e., heat rates of 6500 to 7000 Btu/kWh) for combined cycle, 34 to 42% (i.e., heat rates of 8000 to 10,000 Btu/kWh) for simple cycle, and 23 to 28% (i.e., heat rates of 12,000 to 15,000 Btu/kWh) for steam turbine. Even though power generation efficiencies of CHP systems are very similar to those of the CC or SC system that is part of the CHP, the overall energy utilization efficiency of a CHP could be highest for facilities that need to meet electric as well as coincidental thermal loads. The overall energy utilization efficiency is the lowest for steam-turbine systems. Examples of electric generation efficiencies, overall energy utilization efficiencies, and carbon dioxide emissions of all four systems are shown in [Table 1](#). In this example, the CHP system uses the same CT as for the combined- and simple-cycle systems and has the lowest carbon dioxide emissions, followed by the combined-cycle, simple-cycle, and steam-turbine systems. Therefore, to minimize the carbon footprint of energy use, it is desirable to maximize the use of CHP systems and minimize the use of steam-turbine systems. CTIC for CHP systems increases not only the electric power output but also the available thermal energy, because of the higher mass flow rate of exhaust gases (Punwani 2011, 2012).

Table 1. Typical Combined-Cycle, Simple-Cycle, and Steam Turbine Systems

Unit Type	Turbine Inlet Cooling Candidates			Existing Older Plants Steam Turbine
	CHP/Cogeneration	Combined-Cycle CT	Simple-Cycle CT	
Prime mover	Frame CT	Frame CT-STG	Frame CT	Condensing STG ¹
Fuel	Gas	Gas	Gas	No. 6 Oil
Plant age, yr	<5	<5	<5	>30
Heat rate, Btu/kWh	10,750	7000	10,750	13,000
Generation capacity, MW	100	100	100	100
Hours of operation	1	1	1	1
Thermal energy need, 10 ⁶ Btu/h	465	465	465	465
Fuel use, 10 ⁶ Btu/h (HHV) ²				
Power generation	1075	700	1075	1300
Thermal energy ³	0	547	547	547
Total	1075	1247	1622	1847
Energy efficiency, %				
Electric power generation	32	49	32	26
Overall	75	65	50	44
Carbon emissions, ⁴ ton/h	17.0	19.8	25.7	29.3

¹ HHV = higher heating value.

² CHP system provides thermal energy from the CT exhaust gases without using additional fuel. Other systems use 85% energy efficiency boiler for providing thermal energy needs.

³ Assuming natural gas of HHV of 1000 Btu/ft³.

⁴ STG = steam turbine generator.

Because CTIC helps maximize the capacities of all CT-based systems, regardless of mode, they help minimize use of the least-energy-efficient systems using steam turbines during hot weather and thus help reduce the carbon footprint of energy use.

2. DISADVANTAGES

- Permanently higher CT inlet pressure drop that results in a small drop in the CT output capacity even when CTIC is not being used (magnitude of pressure drop varies with CTIC technology)
- Additional maintenance cost for CTIC equipment

3. DEFINITION AND THEORY

A schematic flow diagram of a combustion turbine (CT) system is shown in [Figure 6](#).

Power output of a CT is directly proportional to and limited by the mass flow rate of the compressed air available to it from the air compressor that provides high-pressure air to the combustion chamber of the CT system. An air compressor has a fixed capacity for handling a volumetric flow rate of air for a given rotational speed of the compressor. Even though the volumetric capacity of a compressor remains constant, the mass flow rate of air it delivers to the CT changes with ambient air temperature. The mass flow rate of air decreases as the air density decreases with increasing ambient temperature. CTIC reduces the inlet air temperature, resulting in increases in air density mass flow rate and power output. For more details, consult Stewart (1999).

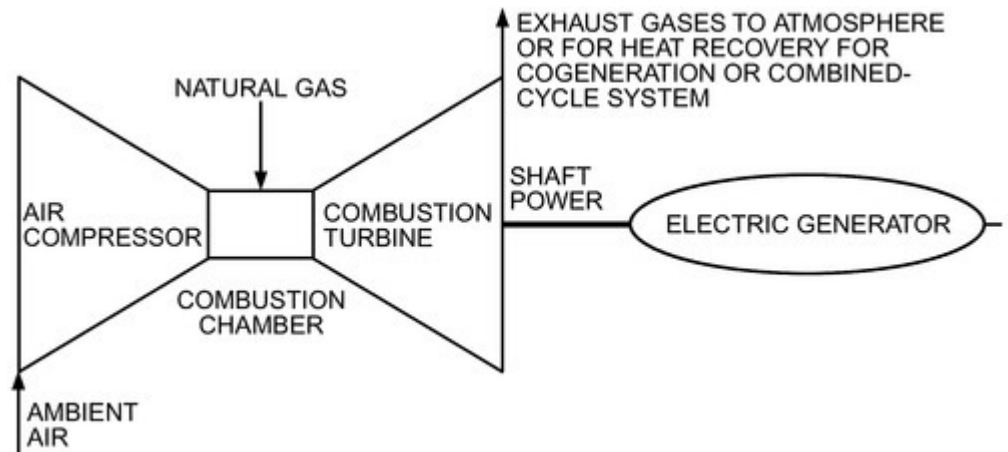


Figure 6. Schematic Flow Diagram of Typical Combustion Turbine System

4. SYSTEM TYPES

Many technologies are commercially available for CTIC (Punwani 2012, 2014), but the overall approaches can be divided into the following major groups:

- Evaporative systems
- Chiller systems
- Liquefied natural gas (LNG) vaporization systems
- Hybrid systems

Each approach has advantages and disadvantages; for more information, see Stewart (1999). The psychrometric paths for CTIC technologies are shown in [Figure 7](#).

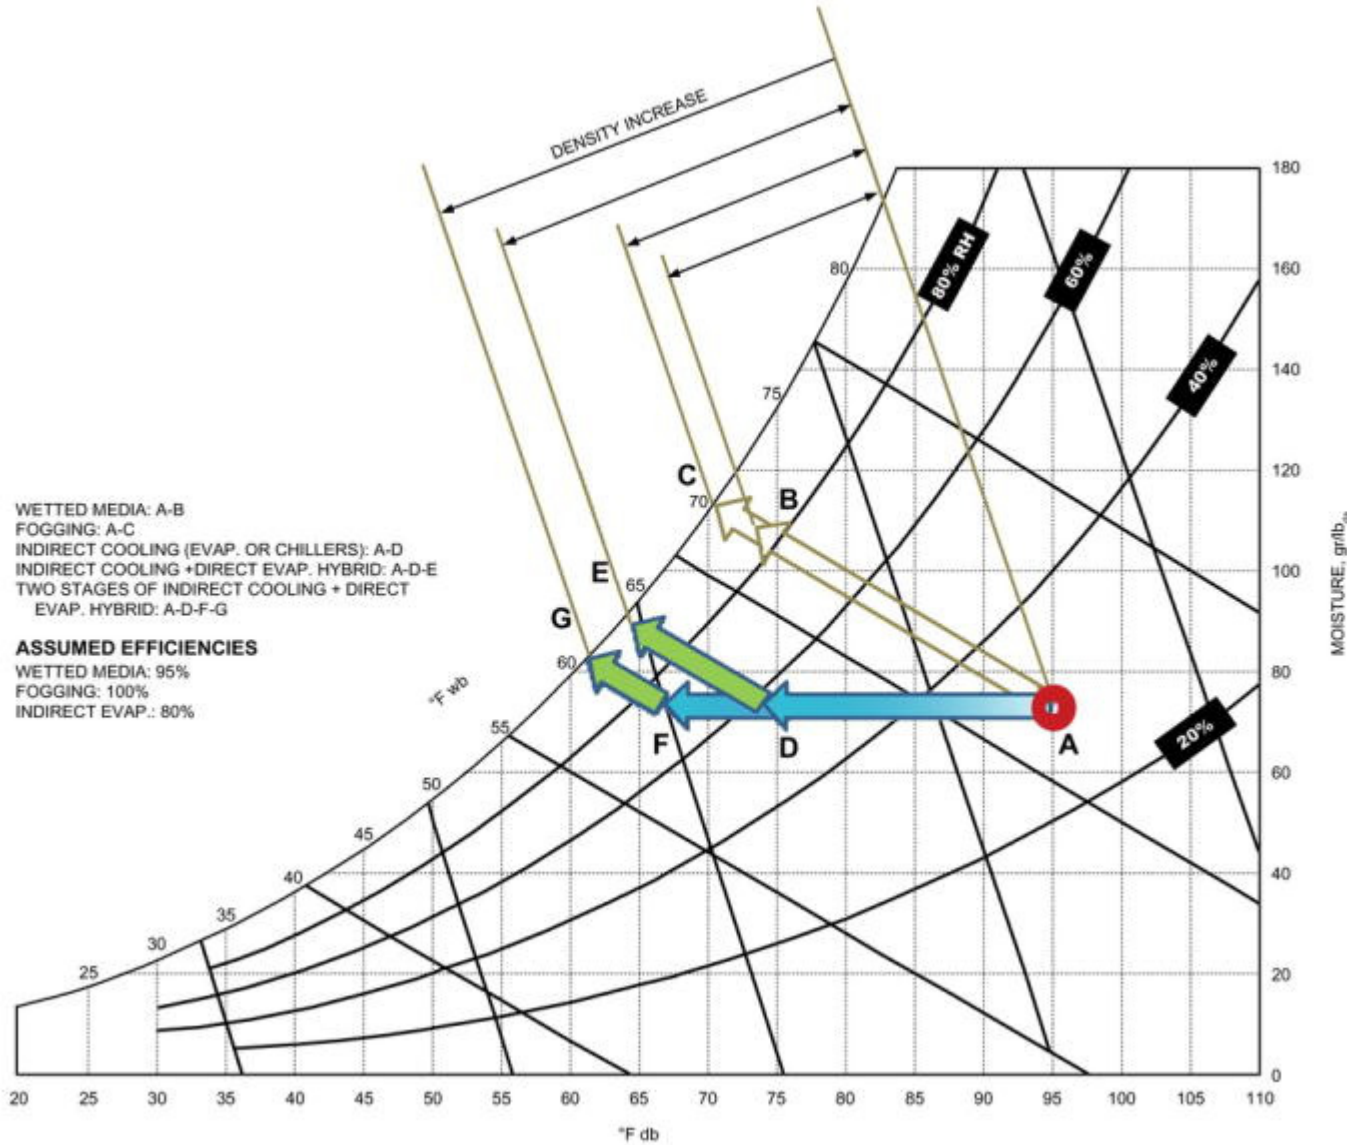


Figure 7. Psychrometric Chart Showing Direct and Indirect Inlet Air Cooling Processes (Schlom and Bastanian 2009)

Evaporative Systems

Evaporative cooling systems rely on cooling produced by evaporation of water added into the inlet air. An ideal evaporative cooling process occurs at a constant wet-bulb temperature and cools the air to a higher relative humidity (i.e., water vapor content increases). When the warm ambient inlet air comes in contact with the added water, it transfers some of its heat to the liquid water and evaporates some of the water. The process of heat transfer from inlet air to water cools the inlet air. Water added in the evaporative systems also acts as an air washer by cleaning the inlet air stream of airborne particulates and soluble gases, which could be a significant benefit to downstream filter elements. Studies show that evaporative cooling also reduces NO_x emissions because of the increase in moisture added to the air. The psychrometry of CTIC using evaporative systems has been described in detail by Stewart (1999).

Evaporative systems can cool the inlet air up to 90% of the difference between the ambient dry-bulb and wet-bulb temperatures. Therefore, the most cooling can be achieved during hot and/or dry weather. Design and hourly temperatures for many locations can be found in [Chapter 14 of the 2013 ASHRAE Handbook—Fundamentals](#) on the accompanying CD and on the *International Weather for Energy Calculations 2.0 (IWECC2) DVD* (ASHRAE 2012). This information is useful in evaluating the cooling potential for locations in many climates.

Evaporative systems have the lowest capital costs among CTIC systems, and are the most common type in use. Their primary disadvantage is that the extent of cooling produced is limited by the wet-bulb temperature (and thus, cooling is weather dependent). In arid climates, these systems consume large quantities of water (e.g., about 5 gal/h to cool 10,000 cfm of air by 20°F), which comprises the major component of the system operating cost.

There are two types of evaporative systems: direct and indirect.

Direct Evaporative Cooling. Direct evaporative system types in commercial use are wetted media and fogging.

Wetted Media. As the first technology adopted for CTIC, these systems have a long history of success in a wide range of operating climates. Inlet air is exposed to a thin film of water on the extended surface of honeycomb-like wetted media (Zeller 2012, 2014). [Figure 8](#) shows a typical wetted media.

Water used for wetting may or may not require treatment, depending on its quality and the medium manufacturer's specifications.

Typical pressure drop across the wetted media is about 0.3 in. of water. The higher the degree of saturation required, the more media required and higher the pressure drop. A wetted-media system requires proper control of the chemistry of recirculating water (e.g., contaminant absorption) and monitoring of media degradation (Graef 2004). The media may need to be replaced every 5 to 10 years, depending on water quality, air quality, and hours of operation.

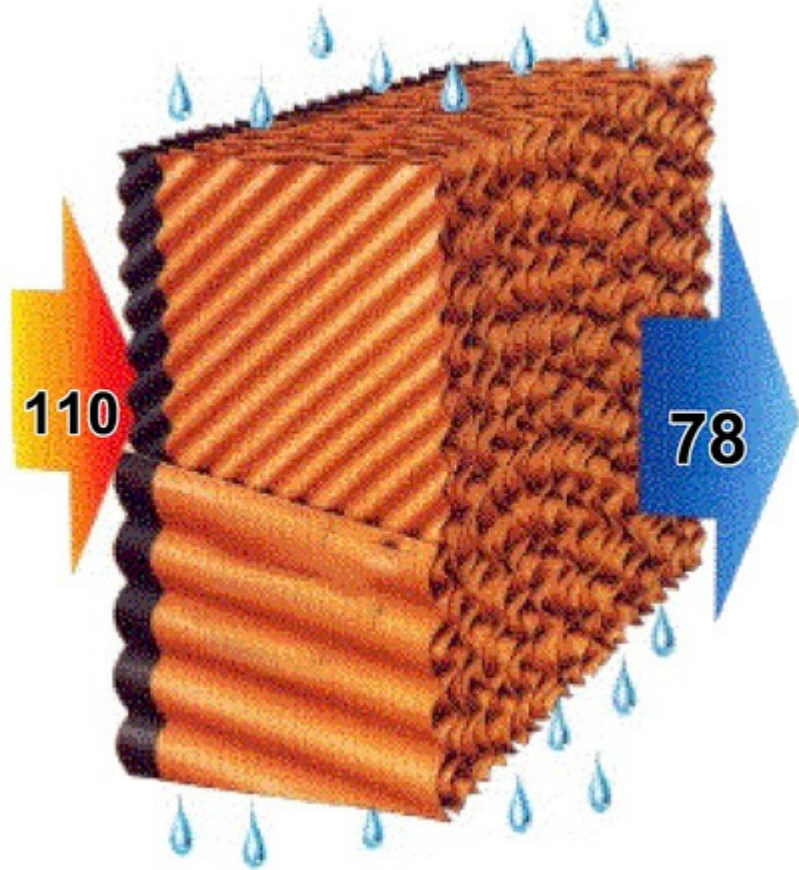


Figure 8. Typical Wetted Media (Zeller 2014)

Fogging. This technology adds moisture to the inlet air by spraying very fine droplets of water (Shepherd 2012, 2014), as shown in [Figure 9](#). High-pressure fogging systems can be designed to produce droplets of variable sizes, depending on the desired evaporation time and ambient conditions. The water droplet size is generally less than 40 μ m, and averages about 20 μ m. Fogging systems typically require higher-quality water than wetted-media systems do. Generally, reverse-osmosis or demineralized water is used to ensure cleanliness throughout the system. Typical pressure drop across the fogging section is about 0.1 in. of water. Fogging nozzles may need to be replaced every 5 to 10 years because of erosion. The high-pressure pumps require servicing at least annually.

A fogging system that sprays more water than could evaporate before the inlet air enters the compressor is known as a **wet compression, overspray, high-fogging, or over-fogging system** (Jolly et al. 2005; Kraft 2004; Schwieger 2004; Shepherd 2013, 2015a, 2015b). Water in excess of that required by fogging does not further reduce inlet air temperature. It is ingested into the compressor section of the CT, and provides a threefold effect for the system:

- It ensures inlet air achieves maximum evaporative cooling.
- The additional water evaporates in the compression stages of the compressor, allowing the compressor to be cooler and require less work for air compression.
- The excess water increases the total mass flow rate of gases entering the CT and helps increase power output beyond that possible with fogging alone.



Figure 9. Water Fog Created for Fogging System (Shepherd 2014)

There is debate in the industry whether wet compression is truly a CTIC technology; accordingly, this chapter addresses only the inlet fogging contribution of wet compression technology.

Indirect Evaporative Cooling. An indirect evaporative cooling (IEC) CTIC system cools inlet air by indirect heat exchange with a stream of air or water that has been cooled by direct evaporative cooling (Bastanian 2013). Its psychrometric path is the same as that of indirect cooling using chillers: it reduces both the dry- and wet-bulb temperatures of the air. The only difference is the primary source of cooling. IEC has some advantages: (1) it imposes less parasitic load than a chiller system, and (2) delivers higher-density air than a direct-cooling system, because no water is added to the inlet air.

Lowering the wet-bulb temperature of the inlet air allows it to be direct-evaporatively cooled to a lower dry-bulb temperature than that possible by only direct evaporative cooling of the ambient air, without first using indirect cooling, as shown in an example in [Figure 7](#).

An IEC system also has some disadvantages:

- It cannot reduce the dry-bulb temperature as low as that possible with chiller systems, especially under high humidity
- Compared to direct evaporative cooling alone, IEC achieves less temperature (dry-bulb) reduction and requires the additional capital cost of an indirect heat exchanger
- Total parasitic load is higher, compared to chiller and direct-evaporative systems alone, because of the power required for pushing the airstreams through the heat exchanger and the direct evaporative cooling sections

Chiller Systems

Chiller systems cool inlet air by exchange of heat through indirect or direct contact between warm ambient inlet air and a cold fluid produced by chillers. In **indirect heat exchange systems**, chilled fluid flows inside a coil ([Figure 10](#)) while the inlet air flows across the coil face (Sims 2014; Tillman 2013). Typical inlet-air-side pressure drop across the heat exchange coil is about 1 in. of water. The water vapor content (humidity ratio) of the inlet air remains constant as its dry-bulb temperature decreases. Ammonia is the most commonly used chilled fluid in direct refrigerant applications; for indirect-contact heat exchange systems, the preferred chilled fluid is often water, though water/glycol, HFCs, HCFCs, and other aqueous fluids are also used.

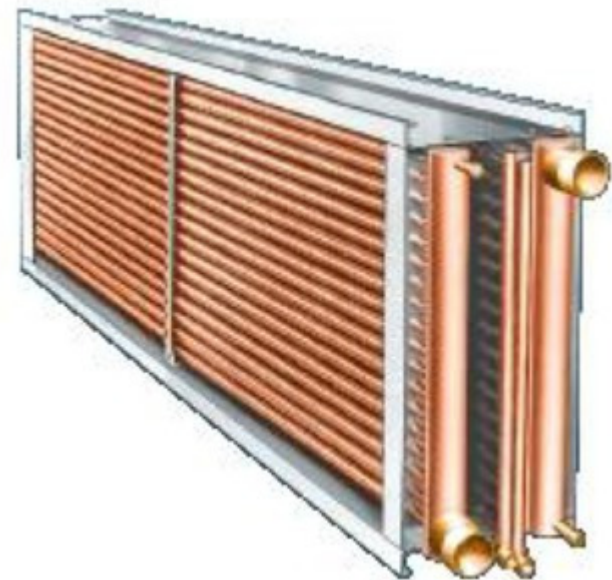


Figure 10. Cooling Coil Used for Indirect Cooling Chiller Systems (Courtesy of Aerotin)

A **direct heat exchange system** (also known as a **bulk air cooler**) uses wetted media in combination with chillers, and allows the flexibility of using wetted media either with ambient temperature water or with chilled water, depending on the desired power output capacity (Liebendorfer and Furlong 2008). A direct-contact heat exchanger operating without chilling the added water performs just as a wetted-media evaporative system does, except that the pressure drop is about 0.8 in. of water. Stewart (1999) describes the psychrometry of CTIC for chilled-fluid systems in detail.

The primary advantage of chiller systems is that they can cool inlet air to much lower temperatures (thus enhancing power output capacity more than evaporative cooling systems can), and can, if sized to do so, maintain any desired inlet air temperature down to 42°F, independent of ambient dry-bulb and wet-bulb temperature. Additional inlet air cooling of up to 8 to 10°F may occur in the bell-mouth section of the air compressor inlet housing, depending on housing design; during hot and humid weather, this additional temperature drop may be enough to cause the temperature of moisture-saturated air to fall below 32°F and form ice crystals, which could damage compressor blades. If, however, the ambient air is very dry, inlet air could be cooled below 42°F (Stewart 2001).

The primary disadvantages of chiller systems are that their installed costs and inlet air pressure drops (which lead to power loss even when CTIC is not being used) are much higher than those for evaporative systems. Chiller systems could be air or water cooled; water-cooled is the most common. Most water-cooled chiller systems require cooling towers, although some directly use seawater. Systems that use cooling towers require makeup water, which may require treatment, although usually less than is required by evaporative systems. Makeup water required for cooling towers is about 20 to 30 gpm per 1000 ton of chiller capacity. During hot, humid weather, most chiller systems produce saturated air and require mist eliminators downstream of the cooling to minimize the potential for water carryover from the cooling coil. It is also common to collect the condensate that forms on the inlet air coils; this can offset a substantial portion of the cooling tower makeup water requirements.

Chiller systems can use mechanical and/or absorption chillers, with or without thermal energy storage (TES).

Mechanical chillers used in CTIC systems could be centrifugal, screw, or reciprocating, and could be driven by electric motors, steam turbines, or engines. These chillers can use CFCs, HCFCs, or ammonia as a refrigerant and can cool the inlet air to 42°F (or below, if desired) without the risk of forming ice crystals. Installed cost of motor-driven mechanical chillers is lower than that for any other chiller, but their parasitic loads are the highest: 0.6 to 0.8 kW per ton of refrigeration. Mechanical chillers driven by steam turbines or engines have lower parasitic electrical loads (0.03 kW/ton), but require fuel or heat inputs and have a higher installed cost. Mechanical chillers are more commonly used for CTIC than are absorption chillers.

Absorption chillers require thermal energy from steam, hot water, hot exhaust gases, or natural gas as the primary source of energy, and need much less electric energy than mechanical chillers. If water is used as the refrigerant, as is most common for CTIC, inlet air can be cooled to about 50°F; if ammonia is the refrigerant, air temperatures will be similar to those available using mechanical chillers.

Absorption chillers can be single or double effect. Single-effect absorption chillers use hot water or 15 psig steam (18 lb/h ton), whereas double-effect chillers require less steam (10 lb/h ton) but need it at higher pressure (typically 115 psig). The advantage of an absorption chiller system is that it has much less parasitic electric load (typically, 0.03 kW/ton), but its capital cost is higher than that for mechanical chiller systems. The cost of the net kilowatt capacity enhancement provided by these chillers could be comparable.

Their main successful application is in power plants where excess waste thermal energy is available, and where use of this energy saves higher-value electric energy.

Thermal energy storage (TES) is used in chilled-fluid systems to increase the available net power output capacity during on-peak periods. It is typically used when only a limited number of hours per day require inlet air cooling, or when peak power enhancement is highly valued (Frankenfield 2013, 2015). TES systems incorporate tanks that store chilled fluid or ice, which is produced by chillers or refrigeration systems during off-peak periods, when the market value of electric energy is low. The stored chilled water or ice is used to cool the inlet air during on-peak periods, when the value of electric energy is high. The primary advantage of a TES system is that it can reduce total system capital cost by reducing chiller capacity requirements from that required to match the instantaneous on-peak demand for cooling. It also increases on-peak capacity and revenues for the power plant, because little or no electric energy is required to operate the chillers during the high-demand, high-value, on-peak periods. The disadvantage of a TES system is that it requires a larger site footprint for the TES tank.

There are two types of TES systems: full and partial shift. In **full-shift systems**, chillers are not operated during on-peak periods; all the required cooling is achieved by using the chilled fluid or ice from the TES tank. In **partial-shift systems**, the downsized chiller system also runs during on-peak periods to complement the cooling capacity available from the stored chilled fluid or ice.

Several publications compare the performance and economics of TES options for CTIC (Andrepoint 1994) or provide methodology for their analysis (Andrepoint and Pasteris 2003) and case studies (Liebendorfer and Andrepoint 2005). A database of TES-CTIC applications has been developed and analyzed, illustrating the trends in TES-CTIC technology, capacity, and geographic locales, as well as demonstrating the performance and economic advantages of combining TES with TIC in many applications (Andrepoint 2005).

LNG Vaporization Systems

These systems are useful for power plants located near a liquefied natural gas (LNG) import facility. In supplying natural gas for pipelines, power plants, or other applications, LNG must be vaporized by some heat source. For applications in CTIC, the inlet air is used as such a heat source. Cho et al. (2003) and Punwani and Pasteris (2004) give examples of LNG vaporization systems.

Hybrid Systems

Hybrid systems combine at least two technologies, which can be used simultaneously in a sequential process; in some systems, each technology may also be used individually (Punwani 2010).

[Additional Feature: CTIC Comparison Spreadsheet](#)

5. CALCULATION OF POWER CAPACITY ENHANCEMENT AND ECONOMICS

A CTIC system's power capacity enhancement and economics depends on several parameters, including the following:

- CT design and characteristics
 - CT heat rate versus compressor inlet air temperature
 - CT power output versus compressor inlet air temperature
 - CT airflow (not an independent variable; dependent on compressor inlet air temperature)
- CTIC design characteristics
 - Parasitic load
 - Pressure drop across the component inserted upstream of the compressor (insertion loss)
 - Water usage
- Hourly weather data (dry-bulb and coincident wet-bulb temperatures) for the geographic location of the CT
- Selected ambient design conditions
- Selected cooled air temperature upstream of compressor
- Cost of fuel
- Cost of water
- Power demand profile
- Hourly market value of electric energy
- Hourly market value of plant capacity

Preliminary estimates of net capacity enhancement by CTIC and the associated costs can be made by the following calculation procedure, which is based on several rules of thumb. More accurate calculations can require sophisticated combustion turbine models and site-specific cost analyses.

Direct Evaporative Cooling. Cooling achieved is easily calculated for all of the systems.

Media and fogger evaporative coolers cool a percentage of the difference between wet-bulb (WB) and dry-bulb (DB) temperatures:

$$\text{Degrees of cooling} = \text{Cooling efficiency} \times (\text{DB} - \text{WB})$$

Indirect Evaporative Cooling. Indirect evaporative cooling typically achieves 2 to 5°F of cooling less than direct evaporative cooling does.

Chiller-Based Cooling. Chillers are sized to cool to the selected design temperature:

$$\text{CCL} = AF_m(H_a - H_c)/12,000$$

where

CCL = chiller cooling load, tons

AF_m = mass flow rate of cooled air, lb/h

H_a = enthalpy of ambient air, Btu/lb

H_c = enthalpy of cooled air, Btu/lb

12,000 = conversion factor for Btu/h to ton of cooling

Parasitic Loss. Parasitic loss is the power required to run the CTIC system.

Media evaporative coolers consume the same amount of power any time the pump is energized, regardless of cooling produced. The total power required varies depending on pumping head, pressure drop of valves, and other restrictions, but a reasonable estimate is 0.02 W/cm.

Fogging systems power consumption is a function of the amount of water injected into the air, and water pressure. For a water pressure of 3000 psi, the parasitic loss is approximately 2 kW/gpm.

Parasitic power loss in indirect evaporative systems must account for two parasitic loads:

- Fan and pump power for direct evaporative cooling of a large flow rate of secondary air (i.e., air that does not enter the CT)
- Power associated with increased inlet pressure loss for primary air (i.e., air that enters the CT) through the indirect heat exchanger

Chillers consume power based on the cooling load and condenser temperature.

$$\text{Electric chiller parasitic load, kW} = 0.7 \times \text{CCL}$$

For single- and double-effect absorption chillers, use the appropriate power need (kW/ton).

The cooling load of the cooling tower (CTL), in tons, is 125% of the chiller load. Estimate the water flow rate capacity (CTC) of the cooling tower at a rate of 3 gpm × CTL. The power of the pump and fan is estimated by the following equation:

$$\text{Tower parasitic load, kW} = 6 \times \text{CTC}/(38 \times 1.341)$$

For air-cooled chillers, power usage is greater than for water-cooled chillers, and is a function of the dry-bulb (rather than wet-bulb) ambient air temperature.

For chillers integrated with TES, most or all of the chiller parasitic load (excluding some water pumps) can be eliminated during peak periods of CTIC operation, with the chiller operating (and the associated parasitic load) during off-peak times of lower power demand and lower power value.

Insertion Loss. All CTs have an insertion loss, which reduces the turbine's power output by approximately 0.25% per in. of water of pressure differential across the inserted component. The pressure differential for the evaporative cooler when no water is being injected (cooler not in operation) is about half as much as when it is running. Insertion loss on a cooling coil also decreases when it is not running or there is no condensate on the coil.

Net and Gross Power Increase. [Figure 1](#) shows typical power degradation caused by increased ambient temperature. For a new aeroderivative CT, power can be lost or restored at an estimated rate of 0.44% per °F of temperature change. Using these numbers, the power output of the CT can be estimated with and without CTIC. The gross power increase is the difference between these two values. The net power increase is the gross increase less all parasitic loads.

Fuel Usage. [Figure 2](#) shows the change in heat rate with increase in inlet air temperature. The curve for the industrial turbine can be estimated to be 0.08% per °F. Fuel usage of the CT at ISO standard conditions ranges between 8000 and 12,000 Btu/kWh.

Fuel usage must be calculated for the turbine with and without cooling. Fuel consumption is greater (but more efficient) when the air has been cooled, and the cost of this additional fuel should be deducted from the gross increase in revenue.

Water Usage. Water is often a precious commodity at industrial sites. Usage can be estimated as follows:

For media and fogging evaporative coolers, water usage is a function of the amount of cooling and the airflow:

$$\text{Water usage, gph} = \frac{1.2 \times \Delta t \times AF_v}{10,000}$$

where

Δt = degrees of cooling, °F

AF_v = volumetric airflow rate, cfm

Water evaporation can also be calculated by multiplying the difference in pounds of moisture of the entering (v₁) and leaving (v₂) air times the weight per minute of the airflow:

$$\text{Evaporation, gpm} = \frac{(v_2 - v_1) \times AF_m}{8.337}$$

Bleedoff from media evaporative coolers should be added to the evaporated water when calculating the cost of water. Typical bleed rates range between 10 and 50% of the evaporation rate. Foggers use high-purity water produced by reverse osmosis or demineralization; this water produces a waste stream of 10 to 30% that may need to be included in the water usage calculation.

Bleedoff and drift from the cooling tower should be added to the evaporated water when refining the calculation for water cost. The bleed depends on water treatment and quality, and drift is a function of the tower's water recirculation rate. For more information, refer to [Chapter 40](#).

In applications using cooling coils or direct heat exchangers to cool the turbine inlet air stream, water may be produced by condensing (if ambient air is cooled below its dew point) and capturing moisture contained in the inlet air. This water can then be used in other locations of the power plant.

CTIC Cost. There are many variables in the cost, including turbine capacity, location, local labor rates, applicable local codes, and customer specifications.

Total installed cost of the CTIC system increases (although the cost per unit of capacity decreases) with increases in CT output and airflow rate capacities, because an increase in CT capacity increases the face area of the media for an evaporative cooler, and increases capacity and the heat exchange coil for the chiller system. For inlet fogging systems, increased airflow means an increase in pumping capacity and in the number of nozzles, pumps and stages. For the same reason, fogging system cost also increases proportionately with increasing differences between the wet- and dry-bulb temperatures. This can be equated to the enthalpy difference between air entering and leaving the coil. When sizing the chiller system, calculations should be based on the actual airflow of cooled air.

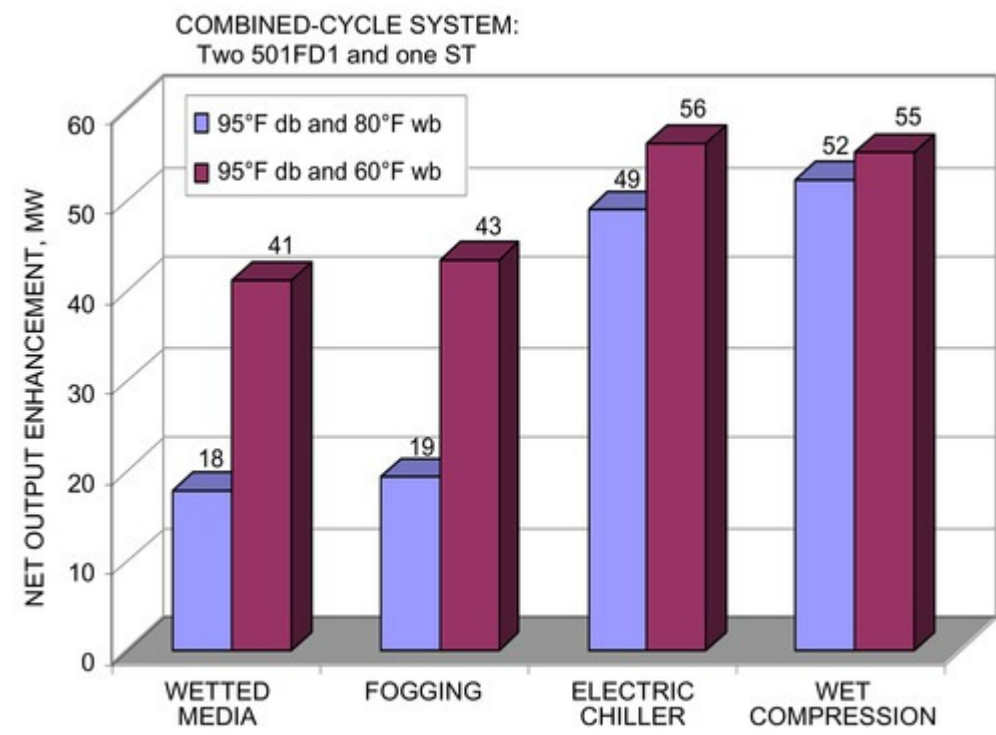


Figure 11. Examples of Effect of CTIC Technology and Ambient Condition on Capacity Enhancement Potential (TICA 2008)

The cost of chiller systems depends heavily on the cooling load for the design day, and on whether (and in what configuration) TES is integrated with the CTIC chiller system. [Figures 11](#) and [12](#) show examples of the effects of CTIC and ambient conditions on capacity enhancement potential and the unitized capital cost of capacity enhancement.

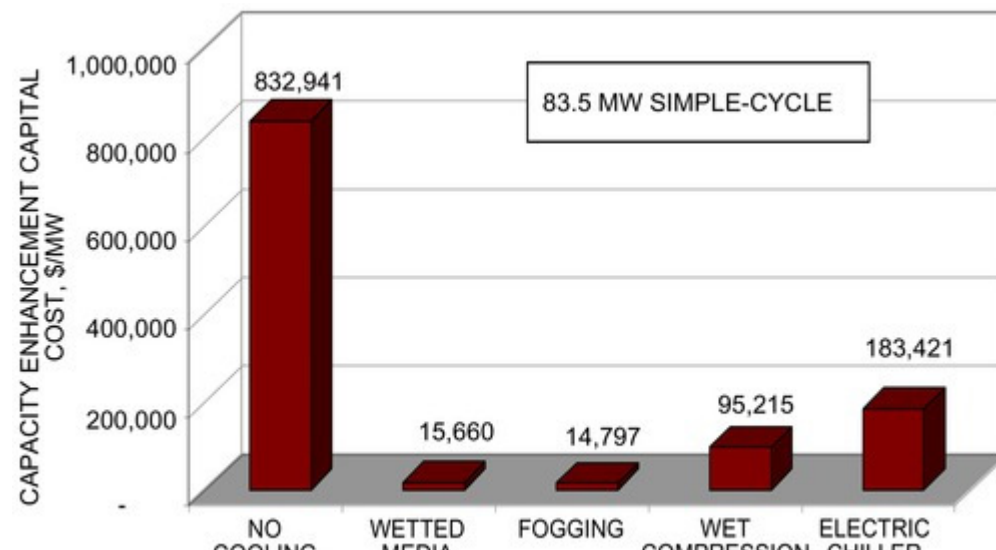


Figure 12. Example of Effects of CTIC Technology and Ambient Condition on Unitized Capital Cost of Capacity Enhancement (TICA 2008)

Operation and Maintenance (O&M) Cost. O&M cost must also be considered, and varies considerably with the type of CTIC technology used. For an overview of O&M costs in general, see [Chapter 37 of the 2015 ASHRAE Handbook—HVAC Applications](#).

REFERENCES

Andreport, J.S. 1994. Performance and economics of combustion turbine (CT) inlet air cooling using chilled water storage. *ASHRAE Transactions* 100(1):587-594.

Andreport, J.S. 2005. Combustion turbine plant power augmentation using turbine Inlet cooling with thermal energy storage. *Proceedings of POWER-GEN International*.

Andreport, J.S., and R.M. Pasteris. 2003. Methodology and case studies of enhancing the performance and economics of gas turbine power plants. *Proceedings of POWER-GEN International*.

ASHRAE. 2012. *International weather for energy calculations, version 2.0*.

Bastianen, M. 2013. Hybrid systems for turbine inlet cooling for increasing capacity and efficiency of combustion turbines during hot weather. Webinar. Turbine Inlet Cooling Association (June).

Cho, J., D. Ebbens, and R.J. Vardickle. 2003. Economic benefits of integrated LNG-to-power. Presented at AICHE 2003 Spring National Meeting, 3rd Topical Conference on Natural Gas Utilization, New Orleans.

Frankenfield, G. 2013. Thermal energy storage for capacity and efficiency enhancement of combustion turbines during hot weather. Webinar. Turbine Inlet Cooling Association (February).

Frankenfield, G. 2015. Best practices for thermal energy storage for capacity and efficiency enhancement of combustion turbines during hot weather. Webinar. Turbine Inlet Cooling Association (January).

Graef, P.T. 2004. Operation and maintenance of wetted-media evaporative coolers. *Energy-Tech* (December):19-20.

Hilberg, G.R. 2006. Case study for retrofit of turbine inlet cooling in Batam, Indonesia. *POWER-GEN Asia 2006 Proceedings*.

Jolly, S., S. Cloyd, and J. Hinrichs. 2005. Wet compression adds power, flexibility to aeroderivative GTs. *Power* 149(4).

Kraft, J.E. 2004. Evaporative cooling and wet compression technologies. *Energy-Tech* (February).

Lebedendorfer, K.M., and J.S. Andreport. 2005. Cooling the hot desert wind: Turbine inlet cooling with thermal energy storage (TES) increases net power plant output by 30%. *ASHRAE Transactions* 111(2):545-550.

Lebedendorfer, K.M., and J. Furlong. 2008. Bulk air cooling: The optimum solution for turbine inlet chilling. *POWER-GEN 2008* (December).

Oriando, J. 1996. *ASHRAE cogeneration design guide*.

Punwani, D.V. 2003. GT inlet air cooling boosts output on warm days to increase revenues. *Combined Cycle Journal* (October).

Punwani, D.V. 2010. Hybrid systems for cooling turbine inlet air for preventing capacity loss and energy efficiency reduction of combustion turbine systems. Presented at ASME 2010 Power Conference, Chicago.

Punwani, D.V. 2011. Turbine inlet cooling technologies and applications for optimizing cogeneration/CHP systems. Webinar. Midwest Cogeneration Association and U.S. Department of Energy Midwest Clean Energy Application Center (August).

Punwani, D.V. 2012. Turbine inlet cooling: An overview. Webinar. Turbine Inlet Cooling Association (June).

Punwani, D.V. 2014. Turbine inlet cooling for increasing capacity and efficiency during hot weather. Webinar. Turbine Inlet Cooling Association (February).

Punwani, D.V., and C.M. Hurlbert. 2005. Unearthing hidden treasure. *Power Engineering*.

Punwani, D.V., and R.M. Pasteris. 2004. Hybrid systems & LNG for turbine inlet cooling. *Energy-Tech* (October):19-20.

Schlom, L.A., and M.V. Bastianen. 2009. Increasing power output of gas turbines using evaporative technologies. *Energy-Tech* (June).

Schwieger, R.G. 2004. Recent experience indicates wet compression meets expectations when done correctly. *Combined Cycle Journal* (Spring).

Shepherd, D. 2012. Combustion turbine inlet cooling using fog evaporative cooling. Webinar. Turbine Inlet Cooling Association (October).

Shepherd, D. 2013. Combustion turbine inlet cooling using wet compression. Webinar. Turbine Inlet Cooling Association (April).

Shepherd, D. 2014. Best practices for fogging systems for capacity and efficiency enhancement of combustion turbines during hot weather. Webinar. Turbine Inlet Cooling Association (August).

Shepherd, D. 2015a. Best practices for wet compression systems for capacity and efficiency enhancement of combustion turbines during hot weather. Webinar. Turbine Inlet Cooling Association (February).

Shepherd, D. 2015b. Best practices for hybrid systems for capacity and efficiency enhancement of combustion turbines during hot weather. Webinar. Turbine Inlet Cooling Association (April).

Sims, T. 2014. Best practices for chiller systems for capacity and efficiency enhancement of combustion turbines during hot weather. Webinar. Turbine Inlet Cooling Association (February).

Stewart, W.E. 1999. *Design guide: Combustion turbine inlet air cooling systems*. ASHRAE.

Stewart, W.E. 2001. Condensation and icing in gas turbine systems: Inlet air temperature and humidity limits. *ASHRAE Transactions* 107(1):887-891.

TICA. 2008. Turbine inlet cooling: An energy solution that's good for the environment, rate payers and plant owners. Presented at POWER-GEN 2008. Turbine Inlet Cooling Association, Naperville, IL. Available from www.turbineinletcooling.org/resources/papers.html.

Tilman, T.C. 2013. Combustion turbine cooling using chiller systems. Webinar. Turbine Inlet Cooling Association (January).

Zeller, P. 2012. Combustion turbines cooling using direct evaporative cooling. Webinar. Turbine Inlet Cooling Association (August).

Zeller, P. 2014. Best practices for wetted media for capacity and efficiency enhancement of combustion turbines during hot weather. Webinar. Turbine Inlet Cooling Association (June).

BIBLIOGRAPHY

Andreport, J.S. 2000. Combustion turbine inlet air cooling (CTIAC): Benefits, technology options, and applications for district energy. *Proceedings of the 51st Annual IDEA Conference*.

Andreport, J.S. 2001. Combustion turbine inlet cooling: Benefits and options for district energy. *IDEA District Energy* 87(3):16-19.

Andreport, J.S. 2002. Demand-side and supply-side load management: Optimizing with thermal energy storage (TES) for the restructuring energy marketplace. *Proceedings of 24th Industrial Energy Technology Conference*.

Andreport, J.S. 2004. Thermal energy storage: Benefits and examples in high-tech industrial applications. *Proceedings of the AEE World Energy Engineering Congress (WEEEC)*.

Andreport, J.S. 2004. Thermal energy storage—Large new applications capture dramatic savings in both operating and capital costs. *Climatização* 4(44):40-46. (In Portuguese).

Andreport, J.S. 2004. Technologies for turbine inlet cooling. *Energy-Tech* (August):18-19.

Andreport, J.S. 2004. Turbine inlet cooling success stories, by technology. *Energy-Tech* (October):1-16.

Andreport, J.S. 2005. Developments in thermal energy storage: Large applications, low temps, high efficiency, and capital savings. *Proceedings of the AEE World Energy Engineering Congress (WEEEC)*.

Andreport, J.S. 2006. Maximizing power augmentation while lowering capital cost per MW via turbine inlet cooling (TIC) with thermal energy storage (TES). *Proceedings of Electric Power*.

Andreport, J.S. 2009. Supporting renewable power generation with energy storage—Supply-side and demand-side storage that is practical and economical. *Proceedings of Electric Power*, Rosemont, IL (May).

Andreport, J.S. 2011. Energy storage at near-zero capital cost and near-100% efficiency—Thermal energy storage coupled with turbine inlet cooling. *Proceedings of Electric Power*, Baltimore, MD (May).

Andreport, J.S. 2015. Two birds with one stone: NG-fueled peaking capacity for only a few hundred \$/kW plus energy storage at zero extra cost. *Proceedings of Electric Power*, Rosemont, IL (April).

Andreport, J.S., and T. Richter. 2012. Energy storage to help meet the challenge of integrating renewable resources. *Proceedings of Electric Power*, Rosemont, IL (May).

Anonymous. 2010. Inlet cooling. *Combined Cycle Journal* (Second Quarter):37-57.

Barigozzi, G., N. Palestira, A. Perdicchi, and G. Salvati. 2011. Combined cycle inlet air cooling by cold thermal storage: Aeroderivative vs. heavy-duty GT comparison. DRAFT GT2011-45997 submitted to IGTT Turbo Expo, Vancouver, BC, Canada (June).

Clark, K.M., et al. 1998. The application of thermal energy storage for district cooling and combustion turbine inlet air cooling. *Proceedings of the IDEA 89th Annual Conference*, San Antonio.

Dotson, S. 2012. Technologies to improve gas turbine efficiency. *Power Engineering* (July), pp. 50-52.

Evans, K. 2007. Gas turbine technology: Reaching the peak. *Middle East Energy* 4(1).

Farmer, R. 2003. Evap cooling and wet compression boost steam injected F18 output. *Gas Turbine World* (Summer).

Farmer, R., ed. 2010. Turbine inlet cooling. *Gas Turbine World Handbook*, vol. 28, pp. 32-39.

Kraft, J.E. 2004. Combustion turbine inlet air cooling—Check your design point. *Power Engineering* (May).

Kraft, J.E. 2006. Turbine inlet cooling system comparisons. *Energy-Tech* (August).

Kraft, J.E. 2006. Beating the heat with inlet cooling. *Power* (July/August).

Lebedendorfer, K.M., and J.S. Andreport. 2005. Cooling the hot desert wind: Turbine inlet cooling with thermal energy storage (TES) increases net power plant output by 30%. *ASHRAE Transactions* 111(2):545-550.

Mercer, M. 2004. Wet compression technologies for combustion turbines. *Diesel and Gas Turbine Worldwide* (May).

NAECA. 2015. Implementing EPA's clean power plan: A menu of options. *Report*, National Association of Clean Air Agencies (May).

Palestra, N., G. Barigozzi, and A. Perdicchi. 2006. Inlet air cooling through thermal storage systems for combined cycle power plants. *Proceedings of Joint ATI-ASME Conference on Energy Production, Distribution and Conservation*, Milan, vol. 1, pp. 541-550.

Palestra, N., G. Barigozzi, and A. Perdicchi. 2008. Inlet air cooling applied to combined cycle power plants: Influence of the site climate and thermal storage systems. *ASME Journal of Engineering for Gas Turbine and Power* 130 (March).

Palestra, N., G. Barigozzi, and A. Perdicchi. 2008. GT inlet air boosting and cooling coupled with cold thermal storage in combined cycle power plants. *ASME Paper* GT2008-51061.

Punwani, D.V. 2005. Turbine inlet cooling for power augmentation in combined heat & power (CHP) systems. *Proceedings of POWER-GEN International*.

Punwani, D.V. 2009. Hybrid and LNG systems for turbine inlet cooling. *Competitive Power College Curriculum (CPC 504)*, POWER-GEN International, Las Vegas (December).

Punwani, D.V. 2010. Turbine inlet cooling: Increased energy efficiency & reduced carbon footprint aspects for district energy systems. International District Energy Association (IDEA) Annual Conference, Indianapolis.

Punwani, D.V., and J.S. Andreport. 2011. Optimizing clean energy systems with thermal energy storage and/or turbine inlet cooling. Presented at U.S. Clean Heat & Power Association Spring CHP Forum, Washington, DC (May).

Punwani, D.V., and C.M. Hurlbert. 2006. Cool or not to cool. *Power Engineering*, pp. 19-23.

Punwani, D.V., T. Pierson, J. Bagley, and W.A. Ryan. 2001. A hybrid system for combustion turbine inlet cooling for a cogeneration plant in Pasadena, TX. *ASHRAE Transactions* 107(1):875-881.

Stewart, W.E. 2000. Air temperature depression and potential icing at the inlet of stationary combustion turbines. *ASHRAE Transactions* 106(2): 318-327.

Tilman, T.C., et al. 2003. Comparisons of power enhancement options for greenfield combined cycle power plants. *Proceedings of POWER-GEN International*.

Zheng, Q., Y. Sun, S. Li, and Y. Wang. 2002. Thermodynamic analysis of wet compression process in the compressor of gas turbine. *Proceedings of ASME EXPO 2002*, Amsterdam.