

CHAPTER 24. DESICCANT DEHUMIDIFICATION AND PRESSURE-DRYING EQUIPMENT

DEHUMIDIFICATION is the removal of water vapor from air, gases, or other fluids. There is no pressure limitation in this definition, and sorption dehumidification equipment has been designed and operated successfully for system pressures ranging from subatmospheric to as high as 6000 psi. In common practice, *dehumidification* refers to equipment operating at atmospheric pressures and built to standards similar to other types of air-handling equipment. For drying gases under pressure, or liquids, the term **dryer** or **dehydrator** is normally used.

This chapter mainly covers equipment and systems that dehumidify air rather than those that dry other gases or liquids. Both liquid and solid desiccants are used; they either adsorb water on the desiccant's surface (adsorption) or chemically combine with water (absorption).

Nonregenerative equipment uses hygroscopic salts such as calcium chloride, urea, or sodium chloride. Regenerative systems usually use a form of silica or alumina gel; activated alumina; molecular sieves; or lithium chloride, calcium chloride, or glycol solution. In regenerative equipment, the water removal mechanism is reversible. The choice of desiccant depends on installation requirements, equipment design, and chemical compatibility with the gas to be treated or impurities in the gas.

[Chapter 32 of the 2013 ASHRAE Handbook—Fundamentals](#) has more information on desiccant materials and how they operate.

Some applications of desiccant dehumidification include

- Ventilating buildings with cooled and dried outdoor air
- Addressing buildings with high internal humidity loads, such as pools, fitness centers, and beverage/food processing
- Keeping buildings and HVAC systems dry to prevent mold growth
- Lowering relative humidity to facilitate manufacturing and handling of hygroscopic materials
- Lowering the dew point to prevent condensation on products manufactured in low-temperature processes
- Providing protective atmospheres for heat treatment of metals
- Controlling humidity in warehouses and caves used for storage
- Preserving ships, aircraft, and industrial equipment that would otherwise deteriorate
- Maintaining a dry atmosphere in a closed space or container, such as the cargo hold of a ship or numerous static applications
- Eliminating condensation and subsequent corrosion
- Speeding drying of heat-sensitive products, such as candy, seeds, and photographic film
- Drying natural gas
- Drying gases that are be liquefied
- Drying instrument and plant air
- Drying process and industrial gases
- Dehydration of liquids
- Dehumidifying buildings using chilled beams
- Frost-free cooling for low-temperature process areas such as brewery cellars; blast freezers; and refrigerated warehouses
- Offering frost-free dehumidification for processes that require air at a subfreezing dew-point humidity
- Maintaining low dew points for electronics and battery production
- Maintaining low-dew-point space conditions for surgical suites
- Providing appropriate conditions for pneumatic conveying of hygroscopic materials
- Providing appropriate conditions for engine test cells
- Improving indoor air quality (IAQ)
- Eliminating fog formation and ceiling condensation in ice rinks.
- Minimizing frost build-up on refrigerated display cases in supermarkets.

This chapter covers (1) the types of dehumidification equipment for liquid and solid desiccants, including high-pressure equipment; (2) performance curves; (3) variables of operation; and (4) some typical applications. Using desiccants to dry refrigerants is addressed in [Chapter 8 of the 2014 ASHRAE Handbook—Refrigeration](#).

1. METHODS OF DEHUMIDIFICATION

Air may be dehumidified by (1) cooling it or increasing its pressure, reducing its capacity to hold moisture, or (2) removing moisture by attracting the water vapor with a liquid or solid desiccant. Frequently, systems use a combination of these methods to maximize operating efficiency and minimize installed cost.

[Figure 1](#) illustrates three methods to dehumidify with desiccant materials or equipment. Air in the condition at Point A is dehumidified and cooled to Point B. In a liquid-desiccant unit, air is simultaneously cooled and dehumidified directly from Point A to Point B. In a solid-desiccant unit, this process can be completed by precooling and dehumidifying from Point A to Point C, then desiccating from Point C to Point E, and finally cooling to Point B. It could also be done with solid-desiccant equipment by dehumidifying from Point A to Point D and then cooling from Point D to Point B.

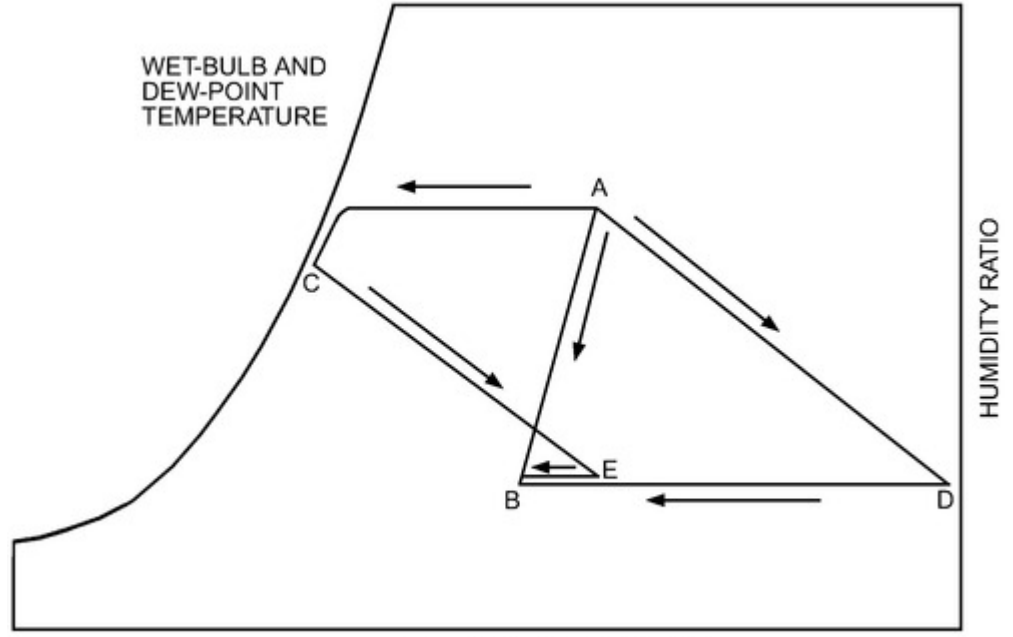


Figure 1. Methods of Dehumidification

Compression

Compressing air reduces its capacity to hold moisture. The resulting condensation reduces the air's moisture content in absolute terms, but produces a saturated condition: 100% relative humidity at elevated pressure. In atmospheric-pressure applications, this method is too expensive, but is worthwhile in pressure systems such as instrument air. Other dehumidification equipment, such as coolers or desiccant dehumidifiers, often follows the compressor to avoid problems associated with high relative humidity in compressed-air lines.

Cooling

Refrigerating air below its dew point is the most common method of dehumidification. This is advantageous when the gas is comparatively warm, has a high moisture content, and the desired outlet dew point is above 41°F. Frequently, refrigeration is combined with desiccant dehumidification to obtain an extremely low dew point at minimum cost.

Liquid Desiccants

Liquid desiccant conditioners (absorbers) contact the air with a liquid desiccant, such as a solution of lithium chloride or glycol ([Figures 24, 26, and 3](#)), to dehumidify and often cool that air. When the water vapor pressure of such a solution is lower than the partial pressure of water in the surrounding air, the solution will collect moisture, thereby decreasing its concentration and dehumidifying the air. The solution's water vapor pressure is a function of its temperature and concentration. Solutions of higher desiccant concentration and/or lower temperature result in lower water vapor pressures and have a stronger dehumidifying effect on the contacted air.

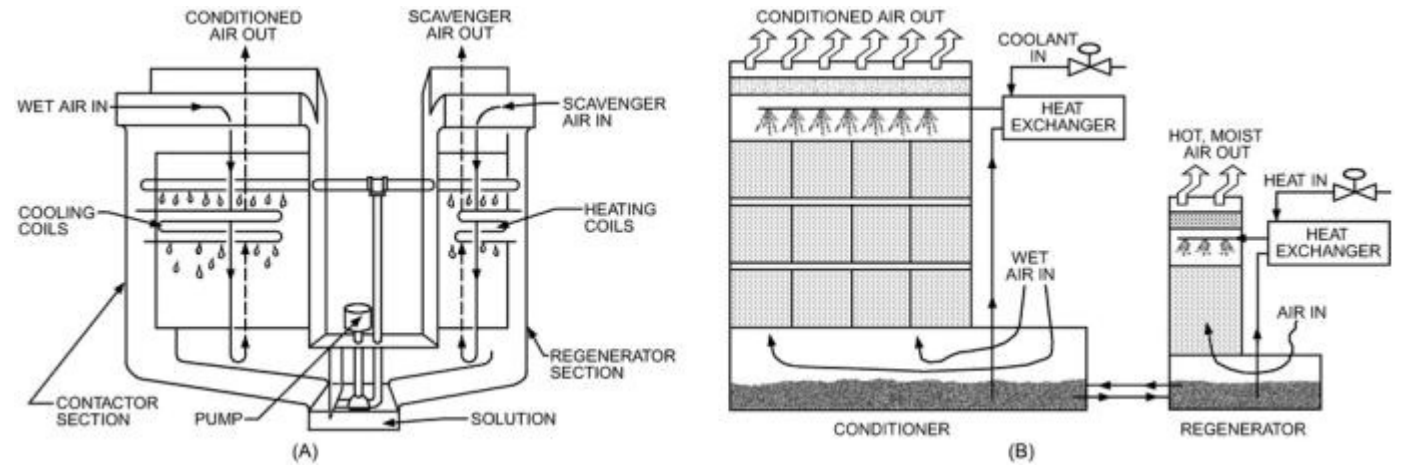


Figure 2. Flow Diagram for Liquid-Absorbent Dehumidifier (A) Without and (B) With Extended Surface Contact Medium

Conversely, liquid desiccant regenerators also contact the air with the same liquid desiccant. When the water vapor pressure of such a solution is higher than the partial pressure of water in the surrounding air, the solution will reject moisture, thereby increasing its concentration and humidifying the air. Solutions of lower desiccant concentration and/or higher temperature result in higher water vapor pressures and have a humidifying effect on the contacted air.

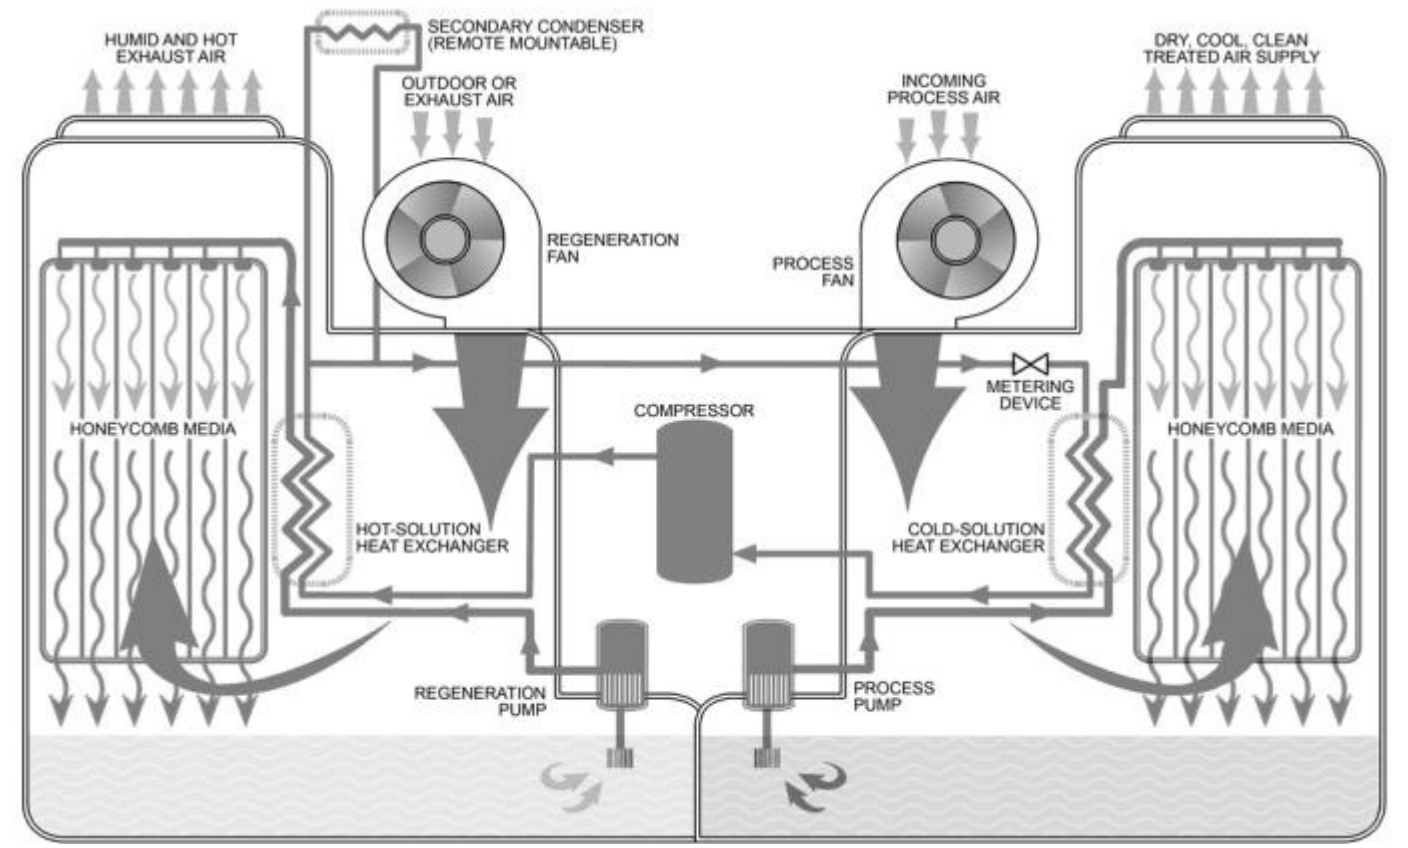


Figure 3. Flow Diagram for Liquid-Absorbent Unit with Onboard Refrigeration System

A simple way to show this relationship is to graph the humidity ratio of air in equilibrium with a liquid desiccant as a function of its concentration and temperature. [Figure 4](#) presents this relationship for lithium chloride/water solutions in equilibrium with air at 14.7 psi. The graph has the same general shape as a psychrometric chart, with the relative humidity lines replaced by desiccant concentration lines.

To dehumidify air, a first airstream (either outdoor, return, or mixed air) contacts a cooled solution in the conditioner; water condenses into the desiccant solution from the air, and the solution is diluted. The diluted solution is continuously reconcentrated in the regenerator, where it is heated to elevate its water vapor pressure and equilibrium humidity ratio. A second airstream, usually outdoor air, contacts the heated solution in the regenerator; water evaporates from the desiccant solution into the air, and the solution is reconcentrated. Desiccant solution is continuously circulated between the conditioner and regenerator to complete the cycle. Liquid desiccant conditioners typically have high contact efficiency, so air leaves the conditioner at a temperature and humidity ratio very close to the entering temperature and equilibrium humidity ratio of the desiccant.

Liquid desiccants are typically very effective antifreeze. As a result, liquid-desiccant conditioners can continuously deliver air at subfreezing temperatures without frosting or freezing problems. Lithium chloride/water solution, for example, has a eutectic point below -90°F; liquid desiccant conditioners using this solution can cool air to temperatures as low as -50°F.

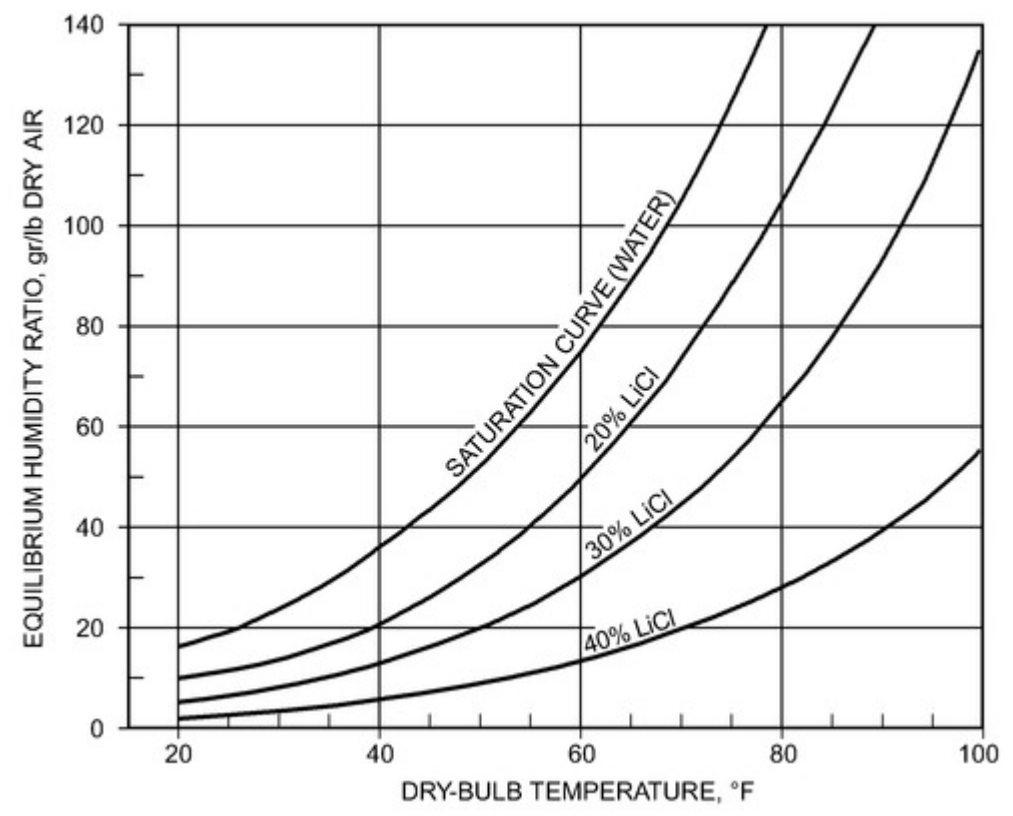


Figure 4. Lithium Chloride Equilibrium

Solid Sorption

Solid sorption passes air through a bed of granular desiccant or through a structured packing impregnated with desiccant. Humid air passes through the desiccant, which when active has a vapor pressure below that of the humid air. This vapor pressure differential drives water vapor from the air onto the desiccant. After becoming loaded with moisture, the desiccant is reactivated (dried out) by heating, which raises the vapor pressure of the material above that of the surrounding air. With the vapor pressure differential reversed, water vapor moves from the desiccant to a second airstream called the *reactivation air*, which carries moisture away from the equipment.

2. DESICCANT DEHUMIDIFICATION

Both liquid and solid desiccants may be used in equipment designed for drying air or other gases at atmospheric or elevated pressures. Regardless of pressure levels, basic principles remain the same.

Desiccant capacity and actual dew-point performance depend on the specific equipment used, characteristics of the various desiccants, initial temperature and moisture content of the gas to be dried, reactivation methods, etc. Factory-assembled units are available up to a capacity of about 80,000 cfm. Greater capacities can be obtained with field-erected units.

2.1 LIQUID DESICCANT EQUIPMENT

Liquid desiccant dehumidifiers are shown in [Figures 2 and 3](#). In [Figure 2A](#), liquid desiccant is distributed onto a cooling coil, which acts as both a contact surface and a means of removing heat released when the desiccant absorbs moisture from the air. In [Figure 2B](#), liquid desiccant is distributed onto an extended heat and mass transfer surface (a packing material similar to that used in cooling towers and chemical reactors). Additionally, [Figure 3](#) demonstrates a liquid desiccant air-conditioning system with an onboard refrigeration system, offering a packaged solution. The packing provides a great deal of surface for air to contact the liquid desiccant, allowing the desiccant to dehumidify and cool the air. It also uses a heat exchanger outside the airstream to cool the desiccant, thereby removing the heat of absorption and any other heat transferred from the air into the desiccant. Air can be passed through the contact surface vertically or horizontally to suit the best arrangement of air system equipment.

Depending on the air and desiccant solution inlet conditions, air can be either simultaneously cooled and dehumidified; heated and dehumidified; heated and humidified; or cooled and humidified. When the enthalpy of the air is to be increased in the conditioner unit, heat must be added either by preheating the air before it enters the conditioner or by heating the desiccant solution with a second heat exchanger. Conversely, when the enthalpy of the air is to be decreased in the conditioner unit, heat must be removed with a heat exchanger. When the air is to be humidified, makeup water is automatically added to the desiccant solution to keep it at the desired concentration. When air is to be dehumidified, a regenerator to reject the collected moisture to an exhaust airstream and a mechanism for transporting the gathered water from the collector to the regenerator are required.

Moisture Removal

In the conditioner, a pump continuously circulates the desiccant solution through a heat exchanger and distributes it over the packed bed contactor surface. The heat exchanger cools the desiccant solution either through an onboard refrigeration system or by transferring heat to an appropriate heat sink such as chilled water, ground water, or other low-temperature heat sink (e.g., even chilled ammonia for extremely low-temperature and low-dew-point applications). This maintains the water vapor pressure of the desiccant used for conditioning lower than that of the air to be treated.

Moisture is absorbed from or desorbed into the air because of the difference in water vapor pressure between the air and the desiccant solution. By controlling the temperature and concentration of the desiccant solution, the conditioner unit can deliver air at a precisely controlled temperature and humidity regardless of inlet air conditions. Therefore, a unit can dehumidify the air during humid weather and humidify it during dry weather. Thus, liquid desiccant conditioners can accurately control humidity without face-and-bypass dampers or after-humidifiers. System performance can easily be controlled as process drying requirements change by altering temperature, concentration, or both to meet the new requirements. Similarly, solution strength can be easily monitored and adjusted while the unit is in operation. The solution strength can be monitored while in operation and can easily be adjusted to compensate for aging. In most cases, the solution retains its effectiveness for the life of the equipment, assuming that proper filtration is maintained.

Heat Removal

When a liquid desiccant absorbs moisture, heat is generated. This heat of absorption consists of the latent heat of condensation of water vapor at the desiccant temperature and the heat of solution (heat of mixing) of the condensed water and the desiccant. The heat of mixing is a function of the equilibrium relative humidity of the desiccant: a lower equilibrium relative humidity produces a greater heat of mixing.

The total heat that must be absorbed by the desiccant solution consists of the (1) heat of absorption, (2) sensible heat associated with reducing the dry-bulb temperature of the air, and (3) residual heat carried to the conditioner by the warm, concentrated desiccant returning from the regenerator unit. This total heat is removed by cooling the desiccant solution in the conditioner heat exchanger ([Figure 2B](#)). Any coolant can be used, including cooling tower water, groundwater, seawater, chilled water or brine, and direct-expansion or flooded refrigerants.

Regenerator residual heat, generally called regenerator heat dumpback, can be substantially reduced by using a liquid-to-liquid heat exchanger to precool the warm, concentrated desiccant transferred to the conditioner using the cool, dilute desiccant transferred from the conditioner to the regenerator. This also improves the thermal efficiency of the system, typically reducing coolant and heat input by 10 to 15%.

Regeneration

When the conditioner is dehumidifying, water is automatically removed from the liquid desiccant to maintain the desiccant at the proper concentration. Removal takes place in a separate regenerator. A small sidestream of the desiccant solution is transferred to the regenerator unit. In the regenerator, a separate pump continuously circulates the desiccant solution through a heat exchanger and distributes it over the packed bed contactor surface. The heat exchanger heats the desiccant solution with waste energy from the onboard compressor system or low-pressure steam or hot water (e.g., from a boiler, solar water heater, or waste heat source) so that the water vapor pressure of the desiccant used for regeneration is substantially higher than that of the outdoor air. Outdoor air is passed through the packing, and water evaporates into it from the desiccant solution, concentrating the solution. The hot, moist air from the regenerator is discharged to the outdoors. A sidestream of concentrated solution is transferred to the conditioner to replace the sidestream of weak solution transferred from the conditioner and completes the cycle.

The regenerator's water removal capacity is controlled to match the moisture load handled by the conditioner. This is accomplished by regulating heat flow to the regenerator heat exchanger to maintain a constant desiccant solution concentration. This is most commonly done by maintaining a constant solution level in the system with a level controller, but specific-gravity or boiling-point controllers are used under some circumstances. Regenerator heat input is regulated to match the instantaneous water removal requirements, so no heat input is required if there is no moisture load on the conditioner. When the conditioner is used to humidify the air, the regenerator fan and desiccant solution pump are typically stopped to save energy.

The conditioner and regenerator can be in a single housing or in separate housings. If in a single housing, the installation, electrical wiring, and equipment cost can be lower than a unit with separate housings. If separated, they can be in different locations and connected by piping; this approach can substantially lower ductwork cost and required mechanical space. Commonly, a single regenerator serves several conditioner units ([Figure 5](#)). In the simplest control arrangement, concentrated desiccant solution is metered to each conditioner at a fixed rate. The return flow of weak solution from each conditioner is regulated to maintain a constant operating level in the conditioner. A level controller on the regenerator regulates heat flow to the regenerator solution heater to maintain a constant volume of desiccant solution, and hence a practically constant solution concentration.

The regenerator can be sized to match the dehumidification load of the conditioner unit or units. Regenerator capacity is affected by regenerator heat source temperatures (higher source temperatures increase capacity) and by desiccant concentration (higher concentrations reduce capacity). The relative humidity of air leaving the conditioner is practically constant for a given desiccant concentration, so regenerator capacity can be shown as a function of delivered air relative humidity and regenerator heat source temperature. [Figure 6](#) is a normalized graph showing this relationship. For a given moisture load, various regenerator heat sources may be used if the regenerator is sized for the heat source selected. In many cases, the greater capital cost of a larger regenerator is paid back very quickly by reduced operating cost when a lower-cost or waste-heat source (e.g., condenser heat, especially from the onboard refrigeration system; solar hot water; process or turbine tail stream; jacket heat from an engine-driven generator or compressor) is used.

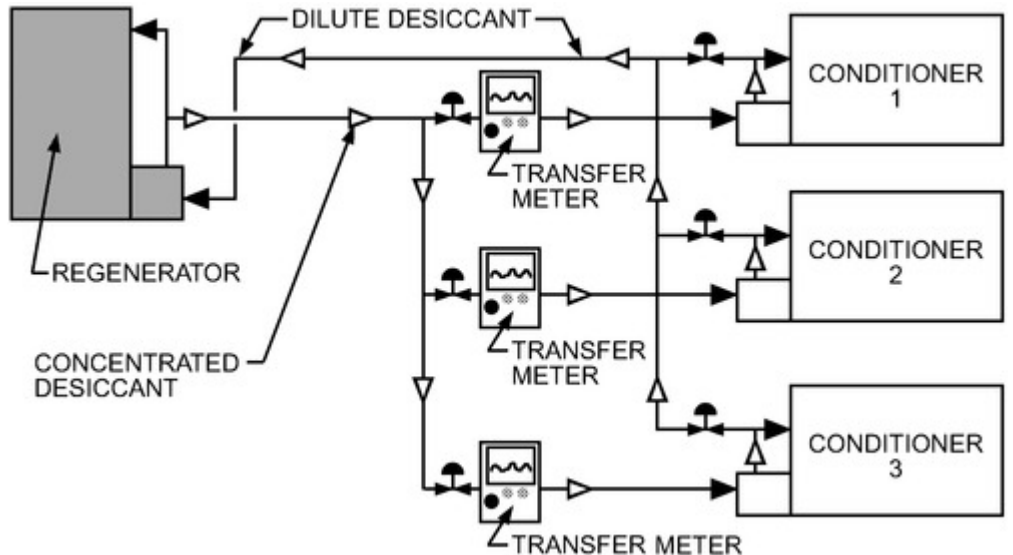


Figure 5. Liquid Desiccant System with Multiple Conditioners

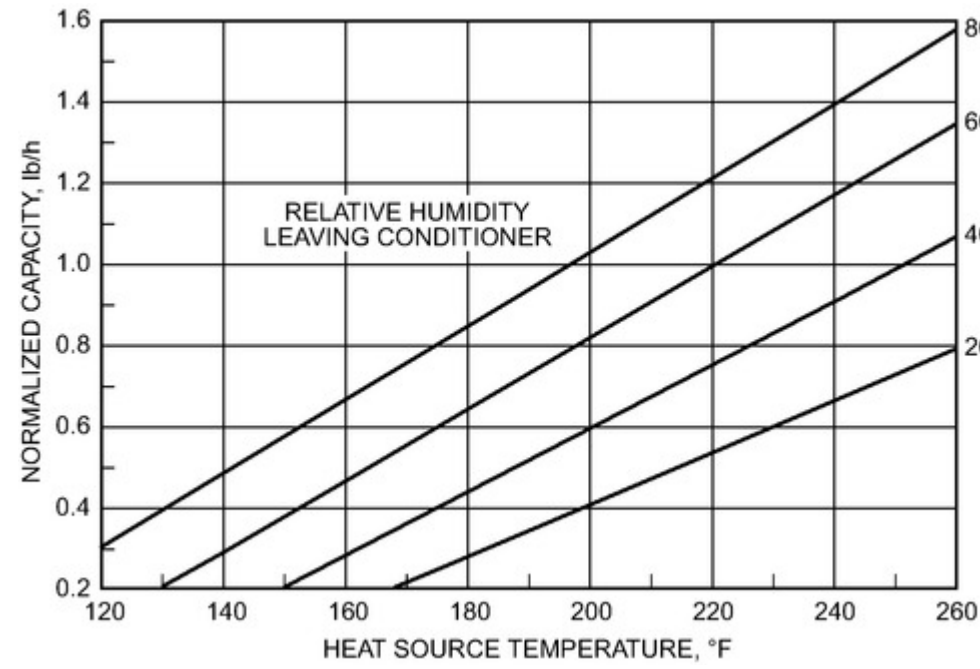


Figure 6. Liquid Desiccant Regenerator Capacity

2.2 SOLID-SORPTION EQUIPMENT

Solid desiccants, such as silica gel, zeolites (molecular sieves), activated alumina, or hygroscopic salts, are generally used to dehumidify large volumes of moist air, and are continuously reactivated. Solid desiccants can also be used in (1) nonreactivated, disposable packages and (2) periodically reactivated desiccant cartridges.

Disposable packages of solid desiccant are often sealed into packaging for consumer electronics, pharmaceutical tablets, and military supplies. Disposable desiccant packages rely entirely on vapor diffusion to dehumidify, because air is not forced through the desiccant. This method is used only in applications where there is no anticipated moisture load at all (such as hermetically sealed packages) because the moisture absorption capacity of any nonreactivated desiccant is rapidly exceeded if a continuous moisture load enters the dehumidified space. Disposable packages generally serve as a form of insurance against unexpected, short-term leaks in small, sealed packages.

Periodically reactivated cartridges of solid desiccant are used where the expected moisture load is continuous, but very small. A common example is the breather, a tank of desiccant through which air can pass, compensating for changes in liquid volume in petroleum storage tanks or drums of hygroscopic chemicals. Air dries as it passes through the desiccant, so moisture will not contaminate the stored product. When the desiccant is saturated, the cartridge is removed and heated in an oven to restore its moisture sorption capacity. Desiccant cartridges are used where there is no requirement for a constant humidity control level and where the moisture load is likely to exceed the capacity of a small, disposable package of desiccant.

Desiccant dehumidifiers for drying liquids and gases other than air often use a variation of this reactivation technique. Two or more pressurized containers of solid desiccant are arranged in parallel, and air is forced through one container for drying, while desiccant in the other container is reactivated. These units are often called dual-tower or twin-tower dehumidifiers.

Continuous reactivation dehumidifiers are the most common type used in high-moisture-load applications such as humidity control systems for buildings and industrial processes. In these units, humid process air is dehumidified in one part of the desiccant bed while a different part of the bed is dried for reuse by a second airstream (reactivation air). The desiccant generally rotates slowly between these two airstreams, so that dry, high-capacity desiccant leaving the reactivation air is always available to remove moisture from the process air. This type of equipment is generally called a rotary desiccant dehumidifier. It is most commonly used in building air-handling systems, and the section on Rotary Solid-Desiccant Dehumidifiers describes its function in greater detail.

2.3 ROTARY SOLID-DESICCANT DEHUMIDIFIERS

Operation

Figure 7 illustrates the principle of operation and arrangement of major components of a typical rotary solid-desiccant dehumidifier. The desiccant can be beads of granular material packed into a bed, or it can be finely divided and impregnated throughout a structured medium. The structured medium resembles corrugated cardboard rolled into a drum, so that air can pass freely through flutes aligned lengthwise through the drum. In both granular and structured-medium units, the desiccant itself can be either a single material, such as silica gel, or a combination, such as silica gel blended with zeolites. The wide range of dehumidification applications requires flexibility in selecting desiccants to minimize operating and installed costs.

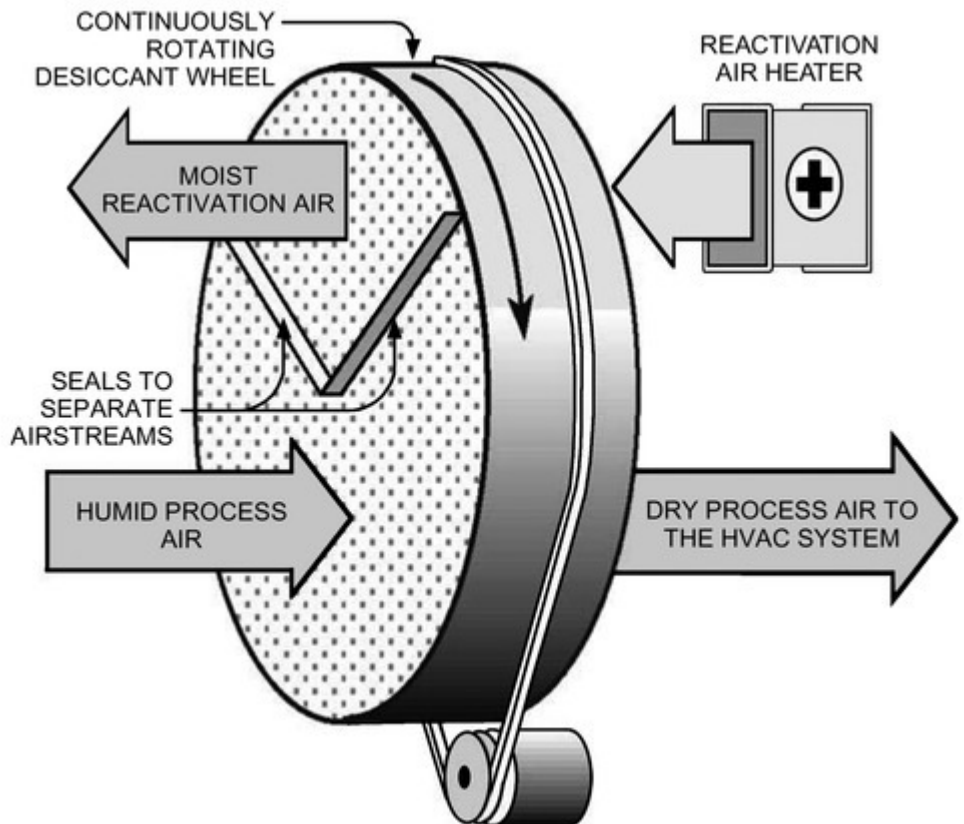


Figure 7. Typical Rotary Dehumidification Wheel

In rotary desiccant dehumidifiers, more than 20 variables can affect performance. In general, equipment manufacturers fix most of these to provide predictable performance in common applications for desiccant systems. Primary variables left to the system designer to define include the following for both process and reactivation air:

- Inlet air temperature
- Moisture content
- Velocity at face of the desiccant bed

In any system, these variables change because of weather, variations in moisture load, and fluctuations in reactivation energy levels. It is useful for the system designer to understand the effect of these normal variations on dehumidifier performance.

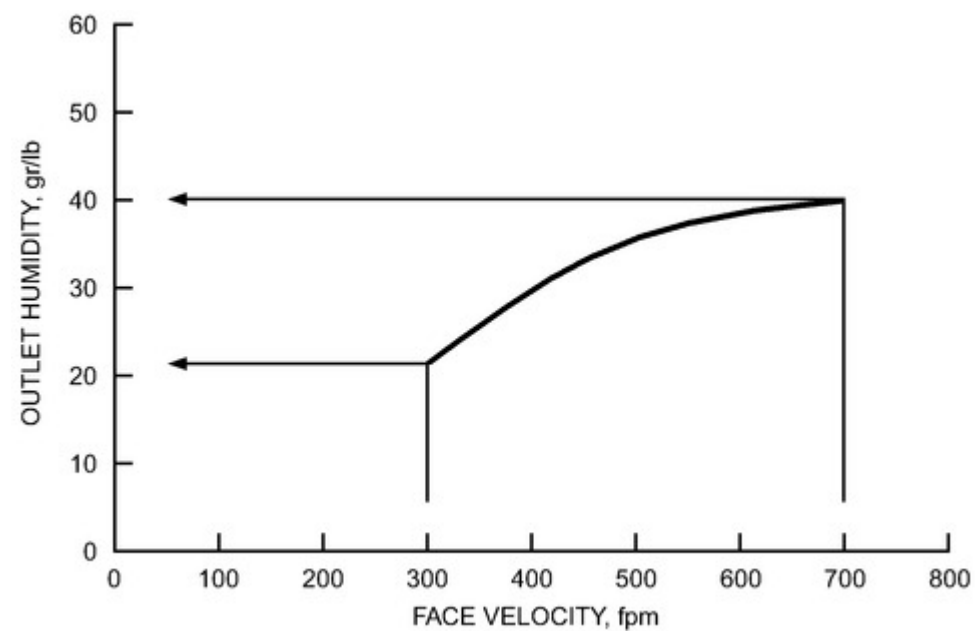


Figure 8. Effect of Changes in Process Air Velocity on Dehumidifier Outlet Moisture

Figures 8 to 12 show changes in process air temperature and moisture leaving a generic rotary desiccant dehumidifier as modeled by a finite difference analysis program (Worek and Zheng 1991). Commercial unit performance differs from this model because such units are generally optimized for very deep drying. However, for illustration purposes, the model accurately reflects the relationships between the key variables.

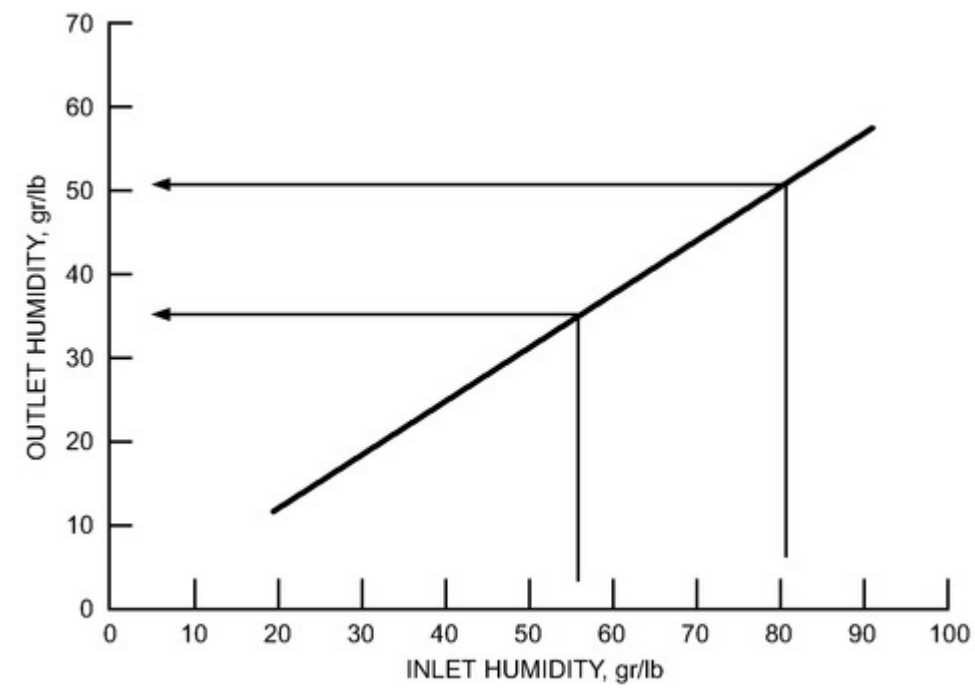


Figure 9. Effect of Changes in Process Air Inlet Moisture on Dehumidifier Outlet Moisture

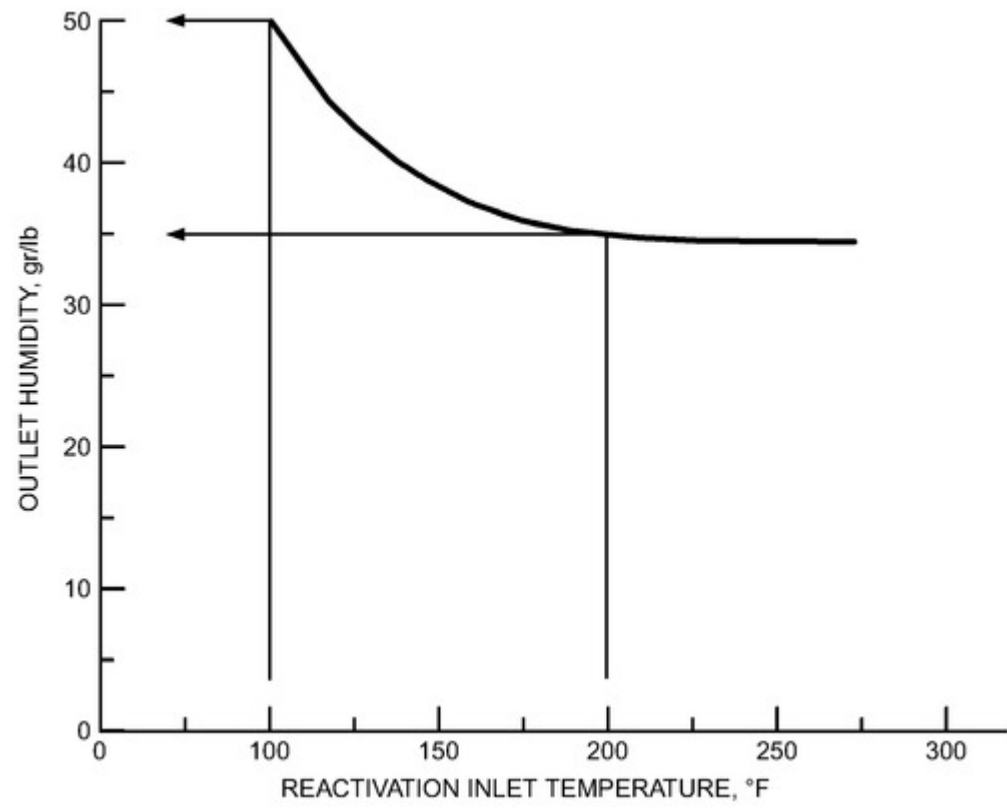


Figure 10. Effect of Changes in Reactivation Air Inlet Temperature on Dehumidifier Outlet Moisture

The desiccant used for the model is silica gel; the bed is a structured, fluted medium; the bed depth is 16 in. in the direction of airflow; and the ratio of process air to reactivation air is approximately 3:1. **Process air velocity** through the desiccant bed strongly affects leaving moisture. As shown in Figure 8, if the entering moisture is 56 gr/lb and all other variables are held constant, the outlet moisture varies from 22 gr/lb at 300 fpm to 40 gr/lb at 700 fpm. Thus, air that passes through the bed more slowly is dried more deeply. Therefore, if air must be dried very deeply, a large unit (slower air velocities) must be used.

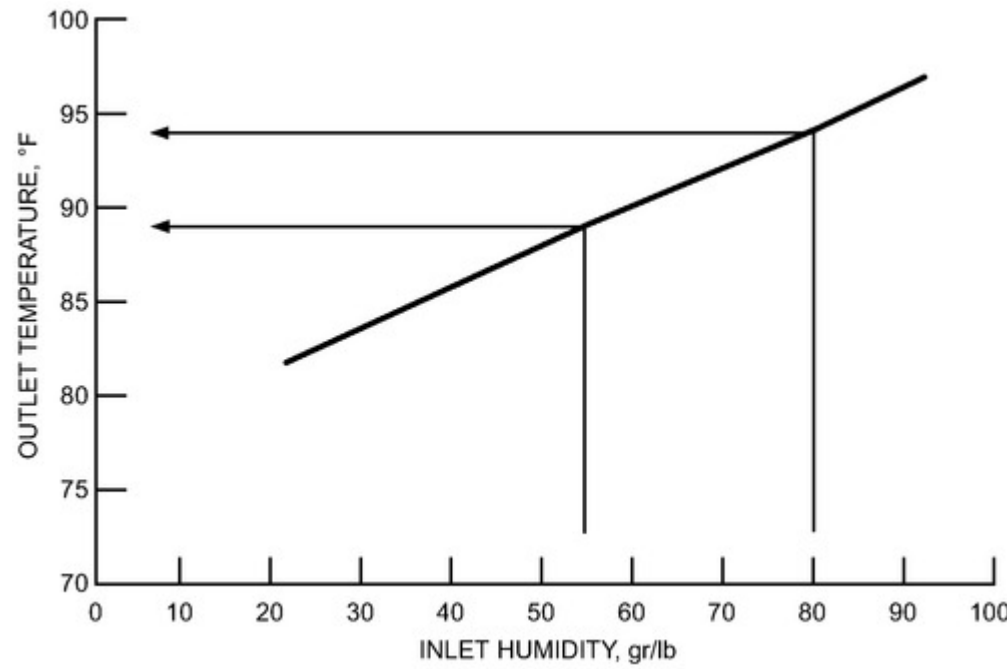


Figure 11. Effect of Changes in Process Air Inlet Moisture on Dehumidifier Outlet Temperature

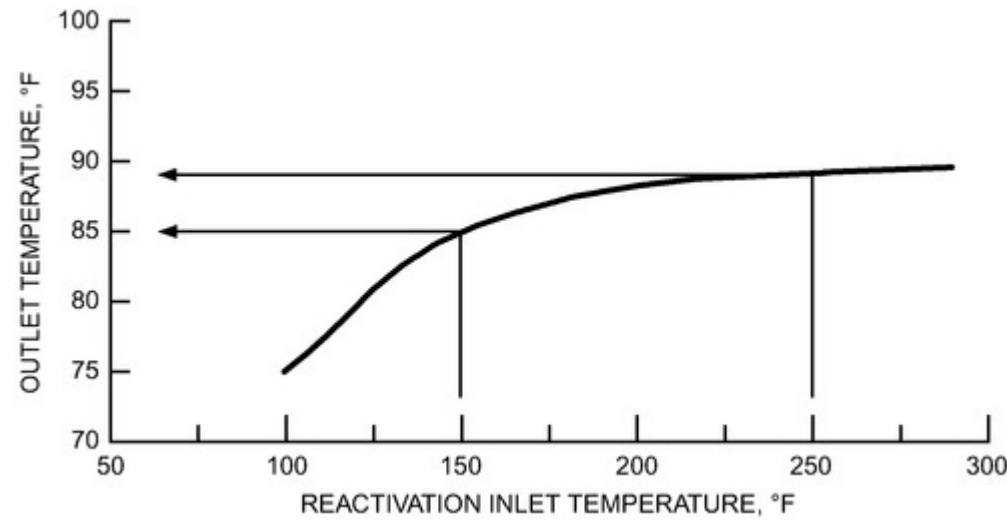


Figure 12. Effect of Changes in Reactivation Air Inlet Temperature on Dehumidifier Outlet Temperature

Process air inlet moisture content affects outlet moisture: if air is more humid entering the dehumidifier, it will be more humid leaving the unit. For example, Figure 9 indicates that, for an inlet humidity of 56 gr/lb, the outlet humidity is 35 gr/lb. If inlet moisture content rises to 80 gr/lb, the outlet humidity rises to 50 gr/lb. Therefore, if constant outlet humidity is necessary, the dehumidifier needs capacity control unless the process inlet airstream does not vary in temperature or moisture throughout the year (a rare circumstance).

Reactivation air inlet temperature changes the outlet moisture content of the process air. From 100 to 250°F, as more heat is added to the reactivation air, the desiccant dries more completely, which means that it can attract more moisture from the process air (see Figure 10). If reactivation air is only heated to 100°F, process outlet moisture is 50 gr/lb, or only 6 gr/lb lower than the entering humidity. In contrast, if reactivation air is heated to 200°F, the outlet moisture is 35 gr/lb, so that almost 40% of the original moisture is removed.

This relationship has two important consequences. If the design needs dry air, it is generally more economical to use high reactivation air temperatures. Conversely, if leaving humidity from the dehumidifier need not be especially low, inexpensive, low-grade heat sources (e.g., solar heat, waste heat, cogeneration heat, or rejected heat from refrigeration condensers) can be used to reactivate the desiccant.

Process air outlet temperature is higher than the inlet air temperature primarily because the heat of sorption of moisture removed from the air is converted to sensible heat. The heat of sorption includes the latent heat of condensation of the removed moisture, plus additional chemical heat, which varies depending on the desiccant type and process air outlet humidity. Also, some heat is carried over to the process air from the reactivation sector because the desiccant is warm as it enters the relatively cooler process air. Generally, 80 to 90% of the temperature rise of process air is from the heat of sorption, and the balance is from heat carried over from reactivation.

Process outlet temperature versus inlet humidity is shown in Figure 11. Note that as more moisture is removed (higher inlet humidity), outlet temperature rises. Air entering at room comfort conditions of 70°F, 56 gr/lb leaves the dehumidifier at 89°F. If the dehumidifier removes more moisture, such as when the inlet humidity is 80 gr/lb, outlet temperature rises to 94°F. The increase in temperature rise is roughly proportional to the increase in moisture removal.

Process outlet temperature versus reactivation air temperature is shown in Figure 12, which shows the effect of increasing reactivation temperature when the moisture content of the process inlet air stays constant. If the reactivation sector is heated to elevated temperatures, more moisture is removed on the process side, so the temperature rise from latent-to-sensible heat conversion is slightly greater. In this constant-moisture inlet situation, if the reactivation sector is very hot, more heat is carried from reactivation to process as the desiccant mass rotates from reactivation to process. Figure 12 shows that if reactivation air is heated to 150°F, the process air leaves the dehumidifier at 85°F. If reactivation air is heated to 250°F, the process air outlet temperature rises to 89°F. The 4°F increase in process air temperature is primarily caused by the increase in heat carried over from reactivation.

One consequence of this relationship is that desiccant equipment manufacturers constantly seek to minimize the “waste mass” in a desiccant dehumidifier, to avoid heating and cooling extra, nonfunctional material such as heavy desiccant support structures or extra desiccant that air cannot reach. Theoretically, the most efficient desiccant dehumidifier has an infinitely large effective desiccant surface combined with an infinitely low mass.

Use of Cooling

In process drying applications, desiccant dehumidifiers are sometimes used without additional cooling because the temperature increase from dehumidification helps the drying process. In semiprocess applications such as controlling frost formation in supermarkets, excess sensible cooling capacity may be present in the system as a whole, so warm air from a desiccant unit is not a major consideration. However, in most other applications for desiccant dehumidifiers, provision must be made to remove excess sensible heat from process air after dehumidification.

In a liquid-desiccant system, heat is removed by cooling the liquid desiccant itself, so process air emerges from the desiccant medium at the appropriate temperature. In a solid-desiccant system, cooling is accomplished downstream of the desiccant bed with cooling coils. The source of this cooling can affect the system's operating economics.

In some systems, postcooling is accomplished in two stages, with cooling tower water as the primary source followed by compression or absorption cooling. Alternatively, various combinations of indirect and direct evaporative cooling equipment are used to cool the dry air leaving the desiccant unit.

In systems where the latent and sensible loads peak at different times, the sensible cooling capacity of the basic air-conditioning system is sufficient to handle the process air temperature rise without additional equipment. Systems in moderate climates with high ventilation requirements often combine high latent loads in the morning, evening, and night with high sensible loads at midday, so desiccant subsystems to handle latent loads are especially economical.

Using Units in Series

Solid-desiccant dehumidifiers are often used to provide air at low dew points. Applications requiring large volumes of air at moisture contents as high as 45 gr/lb (45°F dew point) are quite common and can be easily achieved by rotary desiccant units in a single pass beginning with inlet moisture contents as high as 45 gr/lb (45°F dew point). Some solid-desiccant units commonly deliver air at 2 gr/lb (–18°F dew point) without special design considerations. Where extremely low dew points must be achieved, or where air leakage inside the unit may be a concern, two desiccant dehumidifiers can be placed in series, with dry air from one unit feeding both process and reactivation air to a second unit. The second unit delivers very dry air, because there is reduced risk of moisture being carried over from reactivation to process air when dry air is used to reactivate the second unit.

Industrial Rotary Desiccant Dehumidifier Performance

Figures 8 to 12 are based on the generalized model of a desiccant dehumidifier described by Worek and Zheng (1991). The model, however, differs somewhat from commercial products. Figure 13 shows typical performance of an industrial desiccant dehumidifier.

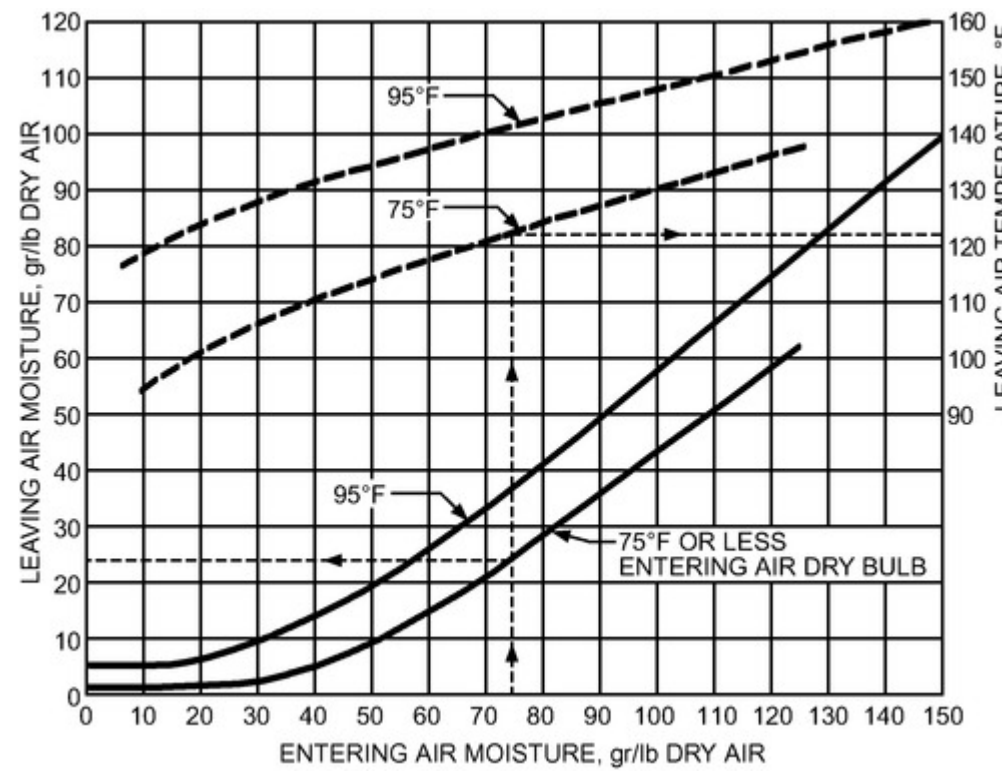


Figure 13. Typical Performance Data for Rotary Solid Desiccant Dehumidifier

2.4 EQUIPMENT RATINGS

ASHRAE *Standard* 139 describes the parameters used in the desiccant industry to calculate desiccant dehumidifier performance:

- Moisture removal capacity (MRC)
- Regeneration specific heat input (RSHI)
- Process outlet temperature
- Pressure drop through the wheel

These performance parameters can be obtained from any manufacturer by means of performance curves or selection software. However, they are generally rated at sea-level conditions. ASHRAE research project RP-1339 (Funo and Mago 2011) investigated how the performance parameters are affected by altitude. The main objectives were to test a desiccant dehumidifier both at sea level and at altitude, and then to develop a general methodology that can be applied to any desiccant wheel to estimate performance at altitude. The test results showed that, by keeping process and regeneration mass flow rates, inlet temperature, and inlet humidity ratio constant between sea level and altitude, performance of a solid-desiccant dehumidifier at altitudes up to 5000 ft is constant regardless of altitude, except for pressure drop through the desiccant wheel. Therefore, the MRC, RSHI, and process-outlet temperature obtained from the manufacturer's performance data at sea level do not require correction for altitude. Note that, when air at altitude is near saturation, its humidity ratio can be above saturation at sea level. In this situation, determine the relative humidity of the air at altitude and use the same mass flow rate, temperature, and relative humidity with the manufacturer's sea-level performance data when determining MRC and process outlet temperature. The humidity ratio change (grain depression) used to calculate MRC will be the same at altitude and should be subtracted from the inlet humidity ratio at altitude to determine the exit condition.

The pressure drop through the wheel obtained from the manufacturer's performance data at sea level must be corrected by the ratio of atmospheric pressure at sea level and altitude using the density ratio methodology:

$$\Delta P_z = \frac{P_0}{P_z} \Delta P_0$$

$$\Delta P_z = \frac{1}{(1 - 6.8754 \times 10^{-6} Z)^{5.2559}} \Delta P_0$$

where

- ΔP_z = wheel pressure drop at altitude, in. of water
- ΔP_0 = wheel pressure drop at sea level, in. of water
- ρ_z = moist air density at altitude, lb/ft³
- ρ_0 = moist air density at sea level, lb/ft³
- Z = elevation, ft

The following example shows the method for rating desiccant equipment at altitude.

Example 1. Find the exit air humidity ratio and wheel pressure drop for a dehumidifier operating at Denver International Airport with process air precooled to 55°F and 98.0% rh.

Solution: Design inlet conditions are based on the 1% design conditions from [Chapter 14 of the 2013 ASHRAE Handbook—Fundamentals](#).

Site altitude: 5430 ft
Process flow rate: 800 scfm
Process inlet humidity ratio W_p : 77.5 gr/lb
Regeneration flow rate: 267 scfm
Regeneration inlet temperature: 67.8°F (before heater)
Regeneration inlet humidity ratio W_r : 92.2 gr/lb (73.8% rh)
Regeneration inlet temperature: 248°F (after heater)
Convert humidity ratios at altitude to equivalent values at sea level.

Process airstream:
Dry-bulb temperature: 55°F
Relative humidity: 98%
Humidity ratio W_p : 63.3 gr/lb

Regeneration airstream:
Dry-bulb temperature: 67.8°F
Relative humidity: 73.8%
Humidity ratio W_r : 75.2 gr/lb

Obtain sea-level performance data from dehumidifier manufacturer using above psychrometric inputs.

Process airstream out:
Dry-bulb temperature: 97.7°F
Humidity ratio W_{p0} : 15.7 gr/lb
Pressure drop: 0.63 in. of water

Regeneration airstream out:
Dry-bulb temperature: 120.0°F
Humidity ratio W_{r0} : 217.4 gr/lb
Pressure drop: 0.86 in. of water

Calculate humidity ratio change and MRC, where

MRC = cfm 0.0006428 ΔW_p = lb/h
 ΔW_p = 63.3 – 15.7 = 47.6 gr/lb
 ΔW_r = 217.4 – 75.3 = 142.2 gr/lb
MRC 800 0.0006428 47.6 = 24.48 lb/h

Restate outlet conditions for altitude.
 $W_{p0,z}$ = W_{p0} – ΔW_p = 77.5 – 47.6 = 29.9 gr/lb
 $W_{r0,z}$ = 63.3 – 15.7 = 234.4 gr/lb
MRC_z = MRC₀ = 24.48 lb/h

Restate wheel pressure drops for altitude.

$$\Delta P_{p,z} = \frac{1}{1 - 6.8754 \times 10^{-6} (5430)^{5.2559} (0.63)} = 0.77 \text{ in. of water}$$

$$\Delta P_{r,z} = \frac{1}{1 - 6.8754 \times 10^{-6} (5430)^{5.2559} (0.86)} = 1.05 \text{ in. of water}$$

2.5 EQUIPMENT OPERATING RECOMMENDATIONS

Desiccant equipment tends to be very durable if maintained properly, often operating at high efficiency 30 years after it was originally installed. Required maintenance is specific to the type of desiccant equipment, the application, and the installation. Each system requires a somewhat different maintenance and operational routine. The information in this section does not substitute for or supersede any recommendations of equipment manufacturers, and it is not a substitute for owners' experience with specific applications.

Process Air Filters

Clean filters are the most important item in a maintenance routine. If a solid desiccant is clogged with particulates, or if a liquid desiccant's sorption characteristics are changed by entrained particulates, the material may have to be replaced prematurely. Filters are much less expensive and much easier to change than the desiccant. Although each application is different, the desiccant usually must be replaced, replenished, or reconditioned after 5 to 10 years of operation. Without attention to filters, desiccant life can be reduced to 1 or 2 years of operation or less. Filters should be checked at least four times per year, and more frequently when airstreams are heavily laden with particulates. Differential pressure sensors across the filter bank to detect loading and alarm a building management system (BMS) may be an alternative to manual inspection.

The importance of filter maintenance requires that filter racks and doors on desiccant systems be freely accessible and that enough space be allowed to inspect, remove, and replace filters. Optimal design ensures that filter locations, as well as the current condition of each filter, are clearly visible to maintenance personnel.

Reactivation/Regeneration Filters

Air is filtered before entering the heater of a desiccant unit. If filters are clogged and airflow is reduced, unit performance may be reduced because there is not enough air to carry all the moisture away from the desiccant. If electrical elements or gas burners are used to heat the air, reducing airflow may damage the heaters. Thus, the previous suggestions for maintaining process air filters also apply to reactivation/regeneration filters.

Liquid-Phase Strainers

In liquid-desiccant systems, clean strainers are an important item in a maintenance routine. Depending on the atmospheric cleanliness and air-phase filtration used, strainers in both the process and regeneration desiccant systems require rinsing every 3 to 6 months.

Reactivation/Regeneration Ductwork

Air leaving the reactivation/regeneration section is hot and moist. When units first start up in high-moisture-load applications, the reactivation air may be nearly saturated and even contain water droplets. Thus, ductwork that carries air away from the unit should be corrosion resistant, because condensation can occur inside the ducts, particularly if the ducts pass through unheated areas in cool weather. If heavy condensation seems probable, the ductwork should be designed with drains at low points or arranged to let condensation flow out of the duct where the air is vented to the weather. The high temperature and moisture of the leaving air may make it necessary to use dedicated ductwork, rather than combining the air with other exhaust airflows, unless the other flows have similar characteristics.

Leakage

All desiccant units produce dry air in part of the system. If humid air leaks into either the dry air ductwork or the unit itself, system efficiency is reduced. Energy is also wasted if dry air leaks out of the distribution duct connections. Therefore, duct connections for desiccant systems should be sealed tightly. In applications requiring very low dew points (below 10°F), the ductwork and desiccant system are almost always tested for leaks at air pressures above those expected during normal operation. In applications at higher dew points, similar leak testing is considered good practice and is recommended by many equipment manufacturers.

Because desiccant equipment tends to be durably constructed, workers often drill holes in the dehumidifier unit casing to provide support for piping, ductwork, or instruments. Such holes eventually leak air, desiccant, or both. Designers should provide other means of support for external components so contractors do not puncture the system unnecessarily.

Contractors installing desiccant systems should be aware that any holes made in the system must be sealed tightly using both mechanical means and sealant compounds. Sealants must be selected for long life at the working temperatures of the application and of the casing walls that have been punctured. For example, reactivation/regeneration sections often operate in a range from a cold winter ambient of –40°F to a heated temperature as high as 300°F. Process sections may operate in a range of –40°F at the inlet to 150°F at the outlet.

Airflow Indication and Control

As explained in the section on Rotary Solid-Desiccant Dehumidifiers, performance depends on how quickly air passes through the desiccant; changes in air velocity affect performance. Thus, it is important to quantify the airflow rate through both the process and reactivation/regeneration parts of the unit. Unless both airflows are known, it is impossible to determine whether the unit is operating properly. In addition, if velocity exceeds the maximum design value, the air may carry desiccant particles or droplets out of the unit and into the supply air ductwork. Thus, manufacturers often provide airflow gages on larger equipment so the owner can be certain the unit is operating within the intended design parameters.

Low humidity readings can be difficult to take with wet-bulb thermometers because the wet wick dries out very quickly, sometimes before the true wet-bulb reading is reached. Also, when the wet-bulb temperature is below the freezing point of water, readings take much longer, which may allow the wick to dry out, particularly in solid-desiccant systems where there may be considerable heat in the air leaving the desiccant. Therefore, wicks must be monitored for wetness. Many technicians avoid wet-bulb readings in air leaving a solid-desiccant bed, partly for these reasons, and partly because of the difficulty and time required to obtain average readings across the whole bed.

Like air temperature, air moisture level leaving a solid-desiccant bed varies considerably; if taken close to the bed, readings must be averaged to obtain a true value for the whole air mass.

When very low dew points are expected, the commissioning technician should be especially aware of limitations of the air-sampling system and the sensor. Even the most accurate sensors require more time to come to equilibrium at low dew points than at moderate moisture levels. For example, at dew points below –20°F, the sensor and air sample tubing may take many hours rather than a few minutes to equilibrate with the air being measured. Time required to come to equilibrium also depends on how much moisture is on the sensor before it is placed into the dry airstream. For example, taking a reading in the reactivation/regeneration outlet essentially saturates the sensor, so it will take much longer than normal to equilibrate with the low relative humidity of the process leaving air.

Reactivation/Regeneration Air Moisture Leaving Desiccant. Air leaving the reactivation/regeneration side of the desiccant is warm and close to saturation. If the humidity measurement sensor is at ambient temperature, moisture may condense on its surface, distorting the reading. It is good practice to warm the sensor (e.g., by taking the moisture reading in the warm, dry air of the process-leaving airstream) before reading moisture in reactivation air. If a wet-bulb instrument is used, water for the wet bulb must be at or above the dry-bulb temperature of the air, or the instrument will read lower than the true wet-bulb temperature of the air.

Owners' and Operators' Perspectives

Designers and new owners are strongly advised to consult other equipment owners and the manufacturer's service department early in design to gain the useful perspective of direct operating experience (Harriman 2003).

2.6 APPLICATIONS FOR ATMOSPHERIC- PRESSURE DEHUMIDIFICATION

Preservation of Materials in Storage

Special moisture-sensitive materials are sometimes kept in dehumidified warehouses for long-term storage. Tests by the Bureau of Supplies and Accounts of the U.S. Navy (DOD 1987, 2004) concluded that 40% rh is a safe level to control deterioration of materials. Others (Sterling et al. 1985) have indicated that 60% rh is low enough to control microbiological attack. With storage at 40% rh, no undesirable effects on metals or rubber compounds have been noted. Some organic materials such as silk, hemp, and paper may lose flexibility and strength, but they recover these characteristics when moisture is regained.

Commercial storage relies on similar equipment for applications that include beer fermentation rooms, meat storage, and penicillin processing, as well as storage of machine tools, candy, food products, furs, furniture, seeds, paper stock, and chemicals. For recommended conditions of temperature and humidity, refer to [Chapters 21](#) and [28](#) of [the 2014 ASHRAE Handbook—Refrigeration](#).

Process Dehumidification

Requirements for dehumidification in industrial processes are many and varied. Some of these processes are as follows:

- Metallurgical processes, with controlled-atmosphere annealing of metals
- Conveying hygroscopic materials
- Film drying
- Manufacturing candy, chocolate, and chewing gum
- Manufacturing drugs and chemicals
- Manufacturing plastic materials
- Manufacturing laminated glass
- Packaging moisture-sensitive products
- Assembling motors and transformers
- Solid propellant mixing
- Manufacturing electronic components, such as transistors and microwave components
- Processing poultry and other meats
- Processing food and other powders

For information about the effect of low-dew-point air on drying, refer to [Chapters 20](#), [22](#), [25](#), and [30](#) of [the 2015 ASHRAE Handbook—HVAC Applications](#).

Ventilation Air Dehumidification

Over a full year, ventilation air loads a cooling system with much more moisture than heat. Except in desert and high-altitude regions, ventilation moisture loads in the United States exceed sensible loads by at least 3:1, and often by as much as 5:1 (Harriman et al. 1997). Consequently, desiccant systems are used to dehumidify ventilation air before it enters the main air-conditioning system.

Drying ventilation air has gained importance because building codes mandate larger amounts of ventilation air than in the past, in an effort to improve indoor air quality. Large amounts of humid ventilation air carry enough moisture to upset the operation of high-efficiency cooling equipment, which is generally designed to remove more sensible heat than moisture (Kosar et al. 1998). Removing excess moisture from the ventilation air with a ventilation dehumidification system improves both humidity control and cooling system effectiveness. For example, field tests suggest that when the environment is kept dry, occupants prefer warmer temperatures, which in turn saves cooling operational costs (Fischer and Bayer 2003). Also, cooling equipment is often oversized to remove ventilation-generated moisture. Pre-drying with a desiccant system may reduce the building's construction cost, if excess cooling capacity is removed from the design (Spears and Judge 1997).

[Figures 14](#), [15](#), and [16](#) show the relative importance of moisture load from ventilation, how a commercial building can use a desiccant system to remove that load, and how such a system is applied in the field (Harriman et al. 2001).

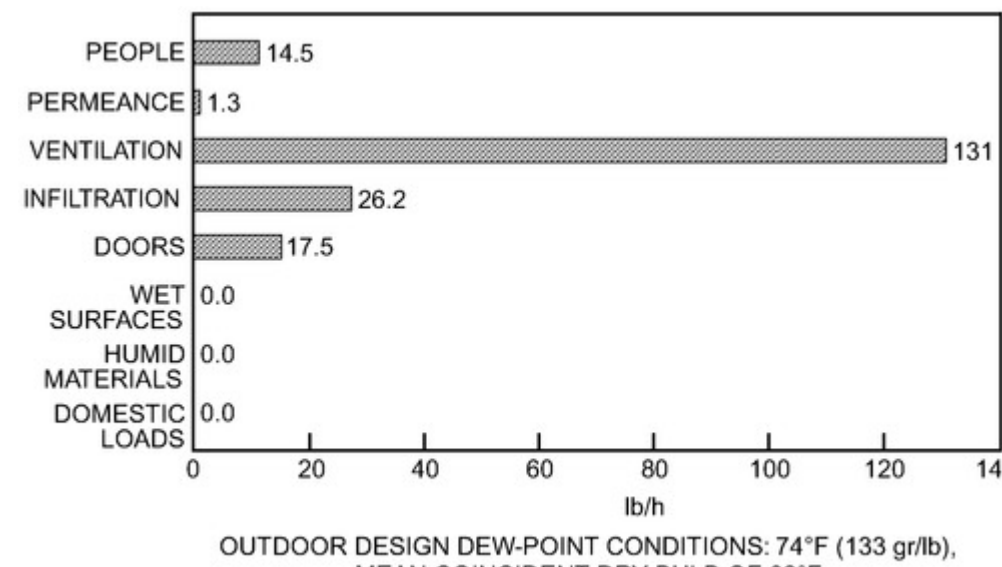


Figure 14. Typical Peak Moisture Loads for Medium-Sized Retail Store in Atlanta, Georgia (Harriman et al. 2001)

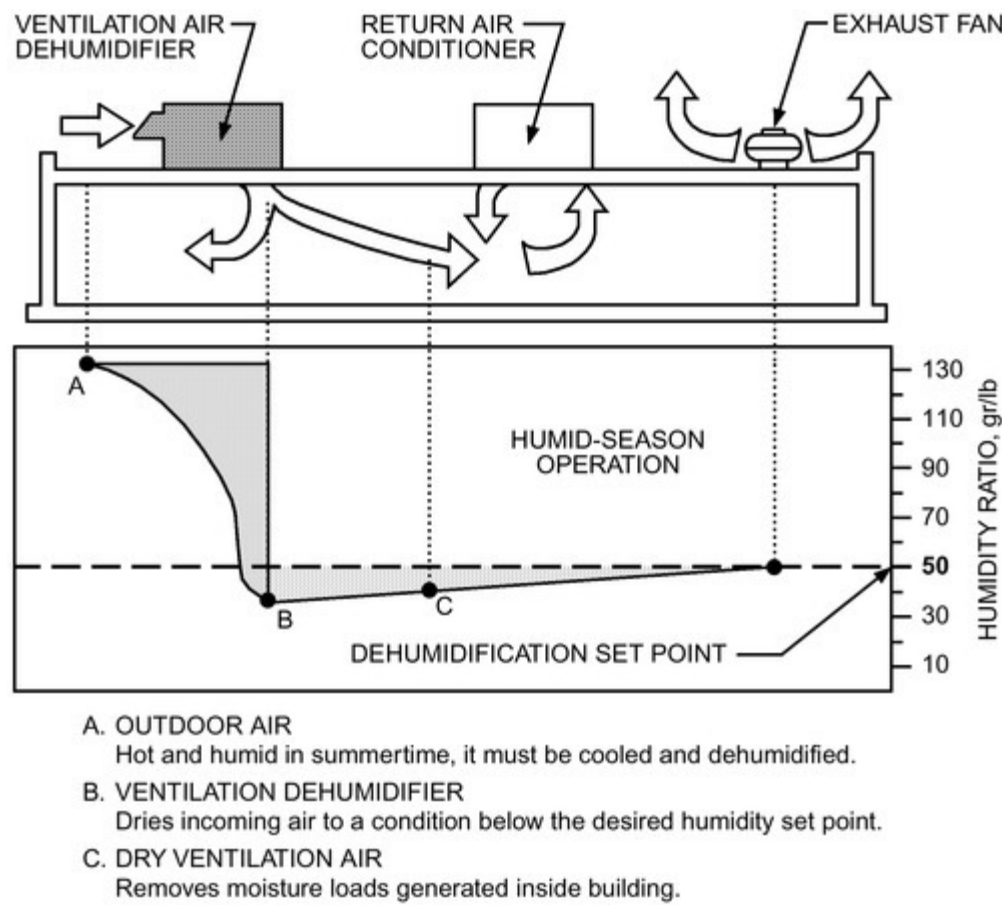


Figure 15. Predrying Ventilation Air to Dehumidify a Commercial Building (Harriman et al. 2001)

Ventilation dehumidification is most cost effective for buildings with high ventilation airflow rather than high sensible loads from internal heat or from heat transmitted through the building envelope. As a result, this approach is most common in densely occupied buildings such as schools, theaters, elder care facilities, large-scale retail buildings, and restaurants (Harriman 2003).

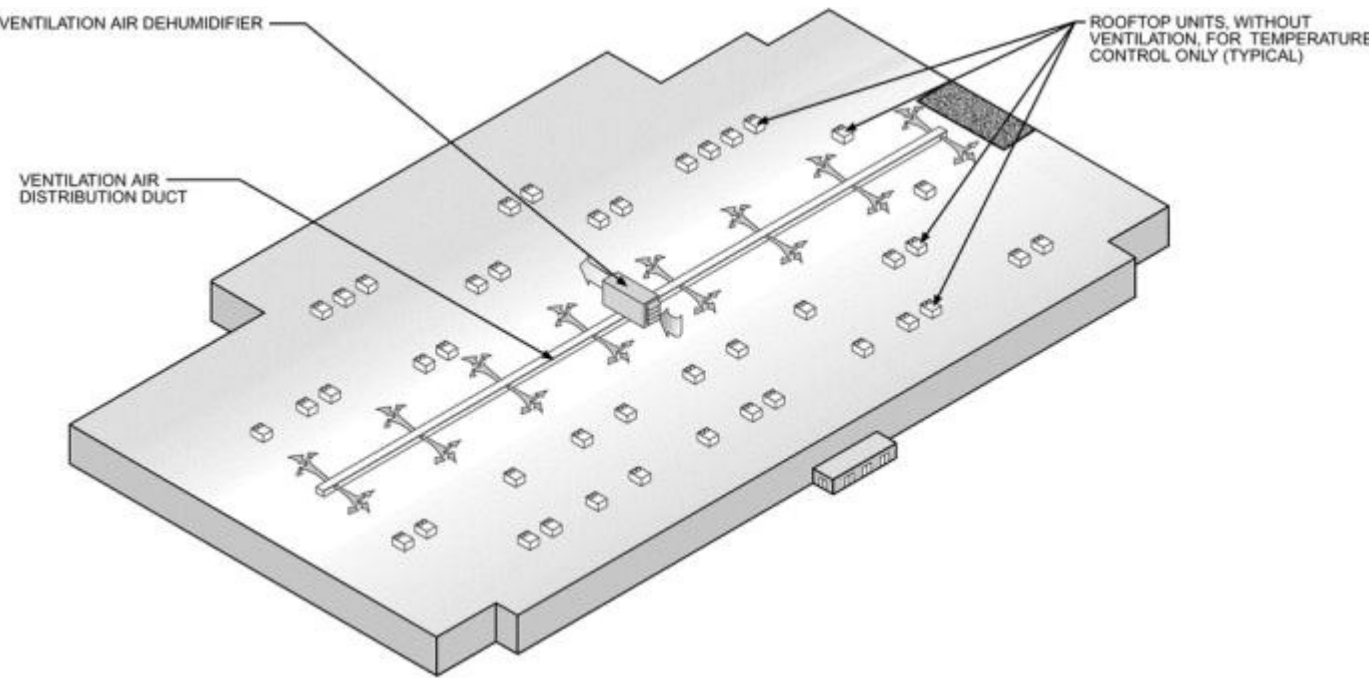


Figure 16. Typical Rooftop Arrangement for Drying Ventilation Air Centrally, Removing Moisture Load from Cooling Units (Harriman et al. 2001)

Condensation Prevention

Many applications require moisture control to prevent condensation. Airborne moisture condenses on cold cargo in a ship's hold when it reaches a moist climate. Moisture condenses on a ship when the moist air in its cargo hold is cooled by the hull and deck plates as the ship passes from a warm to a cold climate. A similar problem occurs when aircraft descend from high, cold altitudes into a high dew point at ground level. Desiccant dehumidifiers are used to prevent condensation inside the airframe and avionics that leads to structural corrosion and failure of electronic components. In pumping stations and sewage lift stations, moisture condenses on piping, especially in the spring when the weather warms and water in the pipes is still cold. Dehumidification is also used to prevent airborne moisture from dripping into oil and gasoline tanks and open fermentation tanks. Electronic equipment is often cooled by refrigeration, and dehumidifiers are required to prevent internal condensation of moisture. Electronic and instrument compartments in missiles are purged with low-dew-point air before launching to prevent malfunctioning caused by condensation. Waveguides and radomes are also usually dehumidified, as are telephone exchanges and relay stations. For proper operation of their components, missile and radar sites depend largely on prevention of condensation on interior surfaces.

Dry Air-Conditioning Systems

Cooling-based air-conditioning systems remove moisture from air by condensing it onto cooling coils, producing saturated air at a lower absolute moisture content. In many circumstances, however, there is a benefit to using a desiccant dehumidifier to remove the latent load from the system, avoiding problems caused by condensation, frost, and high relative humidity in air distribution systems. For example, low-temperature product display cases in supermarkets operate less efficiently when humidity in the store is high because condensate freezes on the cooling coils, increasing operating cost. Desiccant dehumidifiers remove moisture from the air, using rejected heat from refrigeration condensers to reduce the cost of desiccant reactivation. Combining desiccants and conventional cooling can lower installation and operating costs (Calton 1985). For information on the effect of humidity on refrigerated display cases, see Chapter 15 of the 2014 ASHRAE Handbook—Refrigeration and Chapter 2 of the 2015 ASHRAE Handbook—HVAC Applications. Air conditioning in hospitals, nursing homes, and other medical facilities is particularly sensitive to biological contamination in condensate drain pans, filters, and porous insulation inside ductwork. These systems often benefit from drying ventilation air with a desiccant dehumidifier before final cooling. Condensate does not form on cooling coils or drain pans, and filters and duct lining stay dry so that mold and mildew cannot grow inside the system. Refer to ASHRAE Standard 62.1 for guidance concerning maximum relative humidity in air distribution systems. Chapter 8 of the 2015 ASHRAE Handbook—HVAC Applications has information on ventilation of health care facilities. Hotels and large condominium buildings historically suffer from severe mold and mildew problems caused by excessive moisture in the building structure. Desiccant dehumidifiers are sometimes used to dry ventilation air so it can act as a sponge to remove moisture from walls, ceilings, and furnishings (AHMA 1991). Dehumidified ventilation air that positively pressurizes the building may help counter moist air infiltration. See Chapter 6 of the 2015 ASHRAE Handbook—HVAC Applications for more information on ventilating hotels and similar structures. Like supermarkets, ice rinks have large exposed cold surfaces that condense and freeze moisture in the air, particularly during spring and summer. Desiccant dehumidifiers remove excess humidity from air above the rink surface, preventing fog and improving both the ice surface and operating economics of the refrigeration plant. For recommended temperature and humidity for ice rinks, see Chapter 44 of the 2014 ASHRAE Handbook—Refrigeration.

Indoor Air Quality Contaminant Control

Desiccant sorption is not restricted to water vapor. Both liquid and solid desiccants collect both water and large organic molecules at the same time (Hines et al. 1993). As a result, desiccant systems can be used to remove volatile organic compound (VOC) emissions from building air systems. In addition to preventing growth of mold, mildew, and bacteria by keeping buildings dry, desiccant systems can supplement filters to remove bacteria from the air itself. This is particularly useful for hospitals, medical facilities, and related biomedical manufacturing facilities where airborne microorganisms can cause costly problems. The usefulness of certain liquid and solid desiccants in such systems stems from their ability to either kill microorganisms or avoid sustaining their growth (Battelle 1971; SUNY Buffalo School of Medicine 1988).

Testing

Many test procedures require dehumidification with sorption equipment. Frequently, other means of dehumidification may be used with sorbent units, but the low moisture content required can be obtained only by liquid or solid sorbents. Some typical testing applications are as follows:

- Wind tunnels
- Spectroscopy rooms
- Paper and textile testing
- Bacteriological and plant growth rooms
- Dry boxes
- Environmental rooms and chambers

3. DESICCANT DRYING AT ELEVATED PRESSURE

The same sorption principles that pertain to atmospheric dehumidification apply to drying high-pressure air and process or other gases. The sorbents described previously can be used with equal effectiveness.

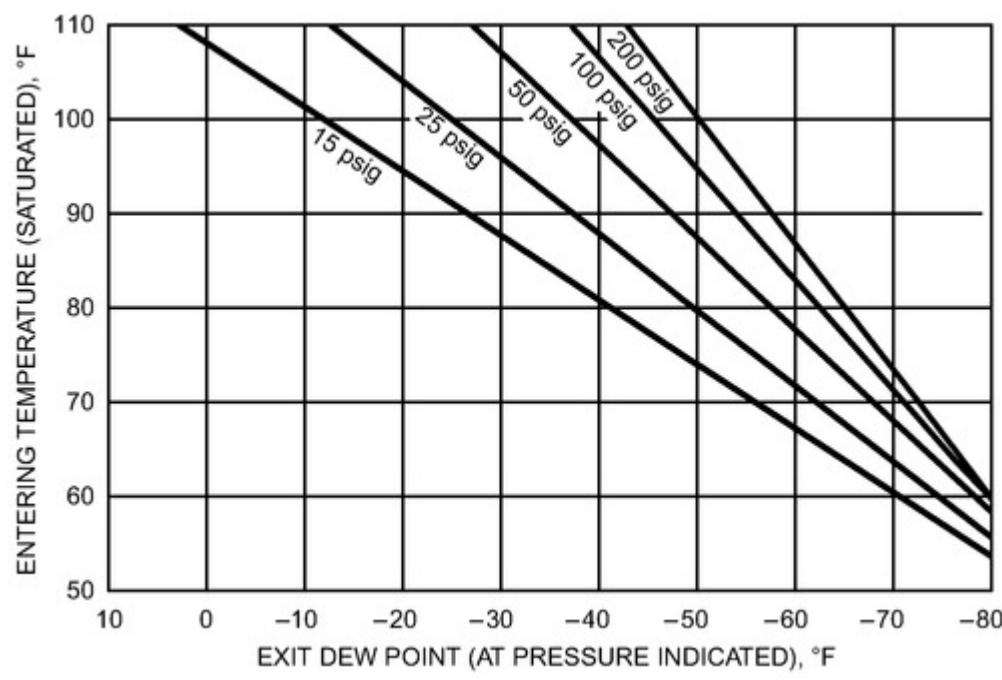


Figure 17. Typical Performance Data for Solid Desiccant Dryers at Elevated Pressures

3.1 EQUIPMENT TYPES

Absorption

Solid absorption systems use a calcium chloride desiccant, generally in a single-tower unit that requires periodic replacement of the desiccant that is dissolved by the absorbed moisture. Normally, inlet air or gas temperature does not exceed 90 to 100°F saturated. The rate of desiccant replacement is proportional to the moisture in the inlet process flow. A dew-point depression of 20 to 40°F at pressure can be obtained when the system is operated in the range of 60 to 100°F saturated entering temperature and 100 psig operating pressure. At lower pressures, the ability to remove moisture decreases in proportion to absolute pressure. Such units do not require a power source for operation because the desiccant is not regenerated. However, additional desiccant must be added to the system periodically.

Adsorption

Drying with an adsorptive desiccant such as silica gel, activated alumina, or a molecular sieve usually incorporates regeneration equipment, so the desiccant can be reactivated and reused. These desiccants can be readily reactivated by heat, purging with dry gas, or both. Depending on the desiccant selected, dew-point performance expected is in the range of -40 to -100°F measured at the operating pressure with inlet conditions of 90 to 100°F saturated and 100 psig. Figure 17 shows typical performance using activated alumina or silica gel desiccant. To prevent condensation and freezing, it's necessary to dry plant air used for pneumatically operated valves, tools, and other equipment where piping is exposed to low ambient temperatures. Additionally, dry air prevents rusting of the air lines, which produces abrasive impurities, causing excessive wear on tools. Industrial gases or fuels such as natural gas are dried. For example, fuels (including natural gas) are cleaned and dried before storage underground to ensure that valves and transmission lines do not freeze from condensed moisture during extraordinarily cold weather, when the gas is most needed. Propane must also be clean and dry to prevent ice accumulation. Other gases, such as bottled oxygen, nitrogen, hydrogen, and acetylene, must have a high degree of dryness. In liquid oxygen and ozone manufacturing, air supplied to the process must be clean and dry.

Prior compression or cooling (by water, brine, or refrigeration) to below the dew point of the gas to be dried reduces the total moisture load on the sorbent, permitting the use of smaller drying units. The cost of compression, cooling, or both must be balanced against the cost of a larger adsorption unit. The many different dryer designs can be grouped into the following basic types: Heat-activated, purge dryers. Normally operating on 4 h (or longer) adsorption periods, these dryers are generally designed with heaters embedded in the desiccant. They use a small portion of dried process gas as a purge to remove the moisture liberated during reactivation heating (see Figure 18). Heatless dryers. These dryers operate on a short adsorption period (usually 60 to 300 s). Depressurizing gas in the desiccant tower lowers the vapor pressure, so adsorbed moisture is liberated from the desiccant and removed by a high purge rate of the dried process gas. Using an ejector reduces the purge gas requirements.

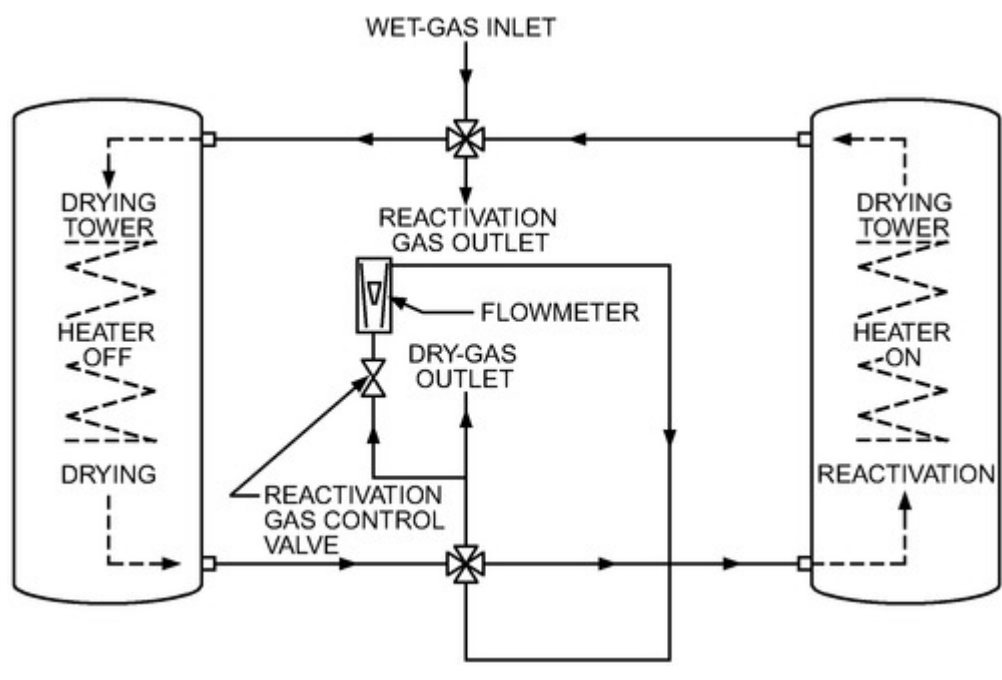


Figure 18. Typical Adsorption Dryer for Elevated Pressures

Convection dryers. These dryers usually operate on 4 h (or longer) adsorption periods and are designed with an external heater and cooler as the reactivation system. Some designs circulate reactivation process gas through the system by a blower; others divert some or all of the process gas flow through the reactivation system before adsorption. Both heating and cooling are by convection. Radiation dryers. Also operating on 4 h (or longer) adsorption periods, radiation dryers are designed with an external heater and blower to force heated atmospheric air through the desiccant tower for reactivation. Desiccant tower cooling is by radiation to atmosphere.

3.2 APPLICATIONS

Material Preservation

Generally, materials in storage are preserved at atmospheric pressure, but a few materials are stored at elevated pressures, especially when the dried medium is an inert gas. These materials deteriorate when subjected to high relative humidity or oxygen content in the surrounding medium. Drying high-pressure air, subsequently reduced to 3.5 to 10 psig, has been used most effectively in pressurizing coaxial cables to eliminate electrical shorts caused by moisture infiltration. This same principle, at somewhat lower pressures, is also used in waveguides and radomes to prevent moisture film on the envelope.

Process Drying of Air and Other Gases

Drying instrument air to a dew point of -40°F, particularly where air lines are outdoors or exposed to temperatures below the dew point of air leaving the aftercooler, prevents condensation or freeze-up in instrument control lines. To prevent condensation and freezing, it's necessary to dry plant air used for pneumatically operated valves, tools, and other equipment where piping is exposed to low ambient temperatures. Additionally, dry air prevents rusting of the air lines, which produces abrasive impurities, causing excessive wear on tools. Industrial gases or fuels such as natural gas are dried. For example, fuels (including natural gas) are cleaned and dried before storage underground to ensure that valves and transmission lines do not freeze from condensed moisture during extraordinarily cold weather, when the gas is most needed. Propane must also be clean and dry to prevent ice accumulation. Other gases, such as bottled oxygen, nitrogen, hydrogen, and acetylene, must have a high degree of dryness. In liquid oxygen and ozone manufacturing, air supplied to the process must be clean and dry. Drying air or inert gas for conveying hygroscopic materials in a liquid or solid state ensures continuous, trouble-free plant operation. Normally, gases for this purpose are dried to a -40°F dew point. Purging and blanketing operations in the petrochemical industry depend on using dry inert gas for reducing problems such as explosive hazards and the reaction of chemicals with moisture or oxygen.

Equipment Testing

Dry, high-pressure air is used extensively for testing refrigeration condensing units to ensure tightness of components and to prevent moisture infiltration. Similarly, dry inert gas is used in testing copper tubing and coils to prevent corrosion or oxidation. Manufacture and assembly of solid-state circuits and other electronic components require exclusion of all moisture, and final testing in dry boxes must be carried out in moisture-free atmospheres. Simulation of dry high-altitude atmospheres for testing aircraft and missile components in wind tunnels requires extremely low dew-point conditions.

REFERENCES

AHMA. 1991. *Mold and mildew in hotels and motels*. Executive Engineers Committee Report. American Hotel and Motel Association, Washington, D.C.

ASHRAE. 2006. Standard method for measurement of moist air properties. *ANSI/ASHRAE Standard* 41.6-1994 (RA 2006).

ASHRAE. 2010. Ventilation for acceptable indoor air quality. *ANSI/ASHRAE Standard* 62.1-2010.

ASHRAE. 2015. Method of testing for rating desiccant dehumidifiers utilizing heat for the regeneration process. *ANSI/ASHRAE Standard* 139-2015.

Battelle Memorial Institute. 1971. *Project N-0914-5200-1971*. Battelle Memorial Institute, Columbus, OH.

Calton, D.S. 1985. Application of a desiccant cooling system to supermarkets. *ASHRAE Transactions* 91(1B):441-446.

DOD. 1967. *Military handbook—Covered storage*. MIL-HDBK-1032/2. U.S. Department of Defense, Washington, D.C.

DOD. 2004. *Unified facilities criteria (UFC), design: Covered storage*. UFC-4-442-01N. U.S. Department of Defense, Washington, D.C.

Fischer, J.C., and C.W. Bayer. 2003. Report card on humidity control. *ASHRAE Journal* 45(5):30-39.

Fumo, N., and P. Mago. 2011. Selection of desiccant equipment at altitude. ASHRAE Research Project RP-1339, *Final Report*.

Harriman, L.G., III. 2003. 20 years of commercial desiccant systems: Where they've been, where they are now and where they're going. *Heating/Piping/Air Conditioning Engineering* (June & July):43-54.

Harriman, L.G., III, D. Plager, and D. Kosar. 1997. Dehumidification and cooling loads from ventilation air. *ASHRAE Journal* 39(11):37-45.

Harriman, L.G., III, G. Brundrett, and R. Kitter. 2001. *Humidity control design guide for commercial and institutional buildings*. ASHRAE.

Hines, A.L., T.K. Ghosh, S.K. Loyalka, and R.C. Warder, Jr. 1993. *Investigation of co-sorption of gases and vapors as a means to enhance indoor air quality*. Gas Research Institute, Chicago. Available from the National Technical Information Service, Springfield, VA. Order PB95-104675.

Kosar, D.R., H.J. Witte, D.B. Shirey, and R.L. Hedrick. 1998. Dehumidification issues of *Standard* 62-1989. *ASHRAE Journal* 40(5):71-75.

Spears, J.W., and J.J. Judge. 1997. Gas-fired desiccant system for retail superstore. *ASHRAE Journal* 39(10):65-69.

Sterling, E.M., A. Arundel, and T.D. Sterling. 1985. Criteria for human exposure to humidity in occupied buildings. *ASHRAE Transactions* 91(1B):611-622.

SUNY Buffalo School of Medicine. 1988. Effects of glycol solutions on microbiological growth. *Niagara Blower Report* 03188.

Worek, W., and W. Zheng. 1991. *UIC IMPLICIT rotary desiccant dehumidifier finite difference program*. University of Illinois at Chicago, Department of Mechanical Engineering.

BIBLIOGRAPHY

ASHRAE. 1992. *Desiccant cooling and dehumidification*, L. Harriman, ed.

ASHRAE. 2009. Method of test for rating desiccant-based dehumidification equipment. *ANSI/ASHRAE Standard* 174-2009.

Bradley, T.J. 1994. Operating an ice rink year-round by using a desiccant dehumidifier to remove humidity. *ASHRAE Transactions* 100(1): 116-131.

Collier, R.K. 1989. Desiccant properties and their effect on cooling system performance. *ASHRAE Transactions* 95(1):823-827.

Harriman, L.G., III. 1990. *The dehumidification handbook*. Munters Cargocaire, Amesbury, MA.

Harriman, L.G., III. 1996. *Applications engineering manual for desiccant systems*. American Gas Cooling Center, Arlington, VA.

Harriman, L.G., III, and J. Judge. 2002. Dehumidification equipment advances. *ASHRAE Journal* 44(8):22-29.

Jones, B.W., B.T. Beck, and J.P. Steele. 1983. Latent loads in low humidity rooms due to moisture. *ASHRAE Transactions* 89(1A):35-55.

Lowenstein, A.L., and R.S. Gabruk. 1992. The effect of absorber design on the performance of a liquid-desiccant air conditioner. *ASHRAE Transactions* 98(1):712-720.

Lowenstein, A.L., and R.S. Gabruk. 1992. The effect of regenerator performance on a liquid-desiccant air conditioner. *ASHRAE Transactions* 98(1):704-711.

Meckler, M. 1994. Desiccant-assisted air conditioner improves IAQ and comfort. *Heating/Piping/Air Conditioning Engineering* 66(10): 75-84.

Pesaran, A., and T. Penney. 1991. Impact of desiccant degradation on cooling system performance. *ASHRAE Transactions* 97(1):595-601.

Vineyard, E.A., J.R. Sand, and D.J. Durfee. 2000. Parametric analysis of variables that affect the performance of a desiccant dehumidification system. *ASHRAE Transactions* 106(1):87-94.

ADDITIONAL INFORMATION

ASHRAE Technical Committee 8.12 posts updated and additional information regarding desiccant equipment and systems on the committee's subsection of the ASHRAE website, located at tc0812.ashraetcs.org.