

CHAPTER 45. MOTORS, MOTOR CONTROLS, AND VARIABLE-FREQUENCY DRIVES

1. MOTORS

MANY TYPES of alternating-current (AC) motors are available; direct-current (DC) motors are also used, but to a more limited degree. National Electrical Manufacturers Association (NEMA) *Standard* MG 1 provides technical information on most types of AC and DC motors.

1.1 ALTERNATING-CURRENT POWER SUPPLY

Important characteristics of an AC power supply include (1) voltage, (2) number of phases, (3) frequency, (4) voltage regulation, and (5) continuity of power. According to AHRI *Standard* 110, the **nominal system voltage** is the value assigned to the circuit or system to designate its voltage class. The voltage at the connection between supplier and user is the **service voltage**. **Utilization voltage** is the voltage at the line terminals of the equipment. Utilization voltages are about 5% lower than their corresponding nominal voltages, to allow for distribution system impedance. Single- and three-phase motor and control voltage ratings shown in [Table 1](#) are adapted to the nominal voltages indicated. Motors with these ratings are considered suitable for ordinary use on their corresponding systems; for example, a 230 V motor should generally be used on a nominal 240 V system. A 230 V motor should not be installed on a nominal 208 V system because the utilization voltage is below the tolerance on the voltage rating for which the motor is designed. Such operation generally results in overheating and a serious reduction in torque. Single- and three-phase 200 V motors are designed for nominal 208 V systems. Motors that are nameplate rated for 208/230 V and 208/230-460 V can also be successfully used on nominal 208 V power systems. Motors are usually guaranteed to operate satisfactorily and to deliver their full power at the rated frequency and at a voltage 10% above or below their rating, or at the rated voltage and plus or minus 5% frequency variation. Some U.S. single-phase HVAC components that are dual-voltage rated (e.g., 208/230-1-60) may carry a –5% voltage allowance (at rated frequency) from the lower voltage rating of 208 volts. [Table 2](#) shows the effect of voltage and frequency variation on induction motor characteristics.

Table 1. Motor and Motor Control Equipment Voltages (Alternating Current)

System Nominal Voltage	U.S. Domestic Equipment Nameplate Voltage Ratings (60 Hz)				
	Integral Horsepower		Fractional Horsepower		
	Three-Phase	Single-Phase	Three-Phase	Single-Phase	
120	—	115	—	115	
208	208/230 or 200/230	208/230 or 200/230	208/230 or 200/230	208/230 or 200/230	
240	208/230 or 200/230	208/230 or 200/230	208/230 or 200/230	208/230 or 200/230	
277	—	265	—	265	
480	460	—	460	—	
600 ²	575	—	575	—	
2,400	2,300	—	—	—	
4,160	4,000	—	—	—	
4,800	4,600	—	—	—	
6,900	6,600	—	—	—	
13,800	13,200	—	—	—	

² Some control and protective equipment has maximum voltage limit of 600 V. Consult manufacturer, power supplier, or both to ensure proper application.

System Nominal Voltage	International Equipment Nameplate Voltage Ratings				
	50 Hz		60 Hz		
	Three-Phase	Single-Phase	Three-Phase	Single-Phase	
127	—	127	—	127	
200	220/200	200	230/208 or 230/200	—	
220	220/240	220/240 or 230/208	230/208 or 230/200	230/208	
230	230/208	220/240 or 230/208	230/208 or 230/200	230/208	
240	230/208	220/240	230/208	230/208	
250	—	250	—	—	
380	380/415	—	460/380	—	
400	380/415	—	—	—	
415	380/415	—	—	—	
440	440	—	460	—	
480	500	—	—	—	

Note: Primary operating voltage for a dual-voltage rating is usually listed first (e.g., 220 is primary for a 220/240 volt rating).

Phase voltages of three-phase motors should be balanced. If not, a small voltage imbalance can cause a large current imbalance. This leads to high motor operating temperatures that can result in nuisance overload trips or motor failures and burnouts. Motors should not be operated where the voltage imbalance is greater than 1%. If an imbalance does exist, contact the motor manufacturer for recommendations. Voltage imbalance is defined in NEMA *Standard* MG 1 as

$$\% \text{ Voltage imbalance} = 100 \times \frac{\text{Maximum voltage deviation from average voltage}}{\text{Average voltage}}$$

In addition to voltage imbalance, current imbalance can be present in a system where Y-Y transformers without tertiary windings are used, even if the voltage is in balance. Again, this current imbalance is not desirable. If current imbalance exceeds either 10% or the maximum imbalance recommended by the manufacturer, corrective action should be taken (see NFPA *Standard* 70).

$$\% \text{ Current imbalance} = 100 \times \frac{\text{Maximum current deviation from average current}}{\text{Average current}}$$

Another cause of current imbalance is normal winding impedance imbalance, which adds or subtracts from the current imbalance caused by voltage imbalance.

Table 2. Effect of Voltage and Frequency Variation on Induction Motor Characteristics

Voltage and Frequency Variation		Starting and Maximum Running Torque	Synchronous Speed	% Slip	Full-Load Speed	Efficiency		
						Full Load	0.75 Load	0.5 Load
Voltage variation	120% Voltage	Increase 44%	No change	Decrease 30%	Increase 1.5%	Small increase	Decrease 0.5 to 2%	Decrease 7 to 20%
	110% Voltage	Increase 21%	No change	Decrease 17%	Increase 1%	Increase 0.5 to 1%	Practically no change	Decrease 1 to 2%
	90% Voltage	Decrease 19%	No change	Increase 23%	Decrease 1.5%	Decrease 2%	Practically no change	Increase 1 to 2%
Frequency variation	105% Frequency	Decrease 10%	Increase 5%	Practically no change	Increase 5%	Slight increase	Slight increase	Slight increase
	95% Frequency	Increase 11%	Decrease 5%	Practically no change	Decrease 5%	Slight decrease	Slight decrease	Slight decrease

Voltage and Frequency Variation	Power Factor			Full-Load Current	Starting Current	Temperature Rise, Full Load	Maximum Overload Capacity	Magnetic Noises, No Load in Particular
	Full Load	0.75 Load	0.5 Load					
Voltage variation	120% Voltage	Decrease 5 to 15%	Decrease 10 to 30%	Decrease 11%	Increase 25%	Decrease 9 to 11°F	Increase 44%	Noticeable increase
	110% Voltage	Decrease 3%	Decrease 4%	Decrease 7%	Increase 10 to 12%	Decrease 5 to 7°F	Increase 21%	Increase slightly
	90% Voltage	Increase 3%	Increase 2 to 3%	Increase 11%	Decrease 10 to 12%	Increase 11 to 13°F	Decrease 19%	Decrease slightly
Frequency variation	105% Frequency	Slight increase	Slight increase	Decrease slightly	Decrease 5 to 6%	Decrease slightly	Decrease slightly	Decrease slightly
	95% Frequency	Slight decrease	Slight decrease	Increase slightly	Increase 5 to 6%	Increase slightly	Increase slightly	Increase slightly

Note: Variations are general and differ for specific ratings.

1.2 CODES AND STANDARDS

The *National Electrical Code*[®] (NEC) (NFPA *Standard* 70) and *Canadian Electrical Code*, Part I (CSA *Standard* C22.1) are important in the United States and Canada. The NEC contains minimum recommendations considered necessary to ensure safety of electrical installations and equipment. It is referred to in the Occupational Safety and Health Administration (OSHA 2007) electrical standards and, therefore, is part of OSHA requirements. In addition, practically all communities in the United States have adopted the NEC as a minimum electrical code.

Underwriters Laboratories (UL) promulgates standards for various types of equipment. UL standards for electrical equipment cover construction and performance for the safety of such equipment and interpret requirements to ensure compliance with the intent of the NEC. A complete list of available standards may be obtained from UL, which also publishes lists of equipment that comply with their standards. Listed products bear the UL label and are recognized by local authorities.

The *Canadian Electrical Code*, Part I, is a standard of the Canadian Standards Association (CSA). It is a voluntary code with minimum requirements for electrical installations in buildings of every kind. The *Canadian Electrical Code*, Part II, contains specifications for construction and performance of electrical equipment, in compliance with Part I. UL and CSA standards for electrical equipment are similar, so equipment designed to meet the requirements of one code may also meet the requirements of the other. However, agreement between the codes is not complete, so individual standards must be checked when designing equipment for use in both countries. The CSA examines and tests material and equipment for compliance with the *Canadian Electrical Code*.

1.3 MOTOR EFFICIENCY

Some of the many factors that affect motor efficiency include (1) sizing the motor to the load, (2) type of motor specified, (3) motor design speed, (4) number of rewinds, (5) voltage imbalance, (6) current imbalance, and (7) type of bearing specified. Oversizing a motor may reduce efficiency. As shown in the performance characteristic curves for single-phase motors in [Figures 1, 2, and 3](#), efficiency usually falls off rapidly at loads lower than the rated full load. Three-phase motors usually reach peak efficiency around 75% load, and the efficiency curve is usually fairly flat from 50 to 100% ([Figure 4](#)). Motor performance curves (available from the motor manufacturer) can help in specifying the optimum motor for an application. The U.S. Department of Energy's (DOE) MotorMaster+ software gives part-load efficiency as well as efficiency at rated load. Larger-output motors tend to be more efficient than smaller motors at the same percentage load. Four-pole induction motors tend to have the highest range of efficiencies.

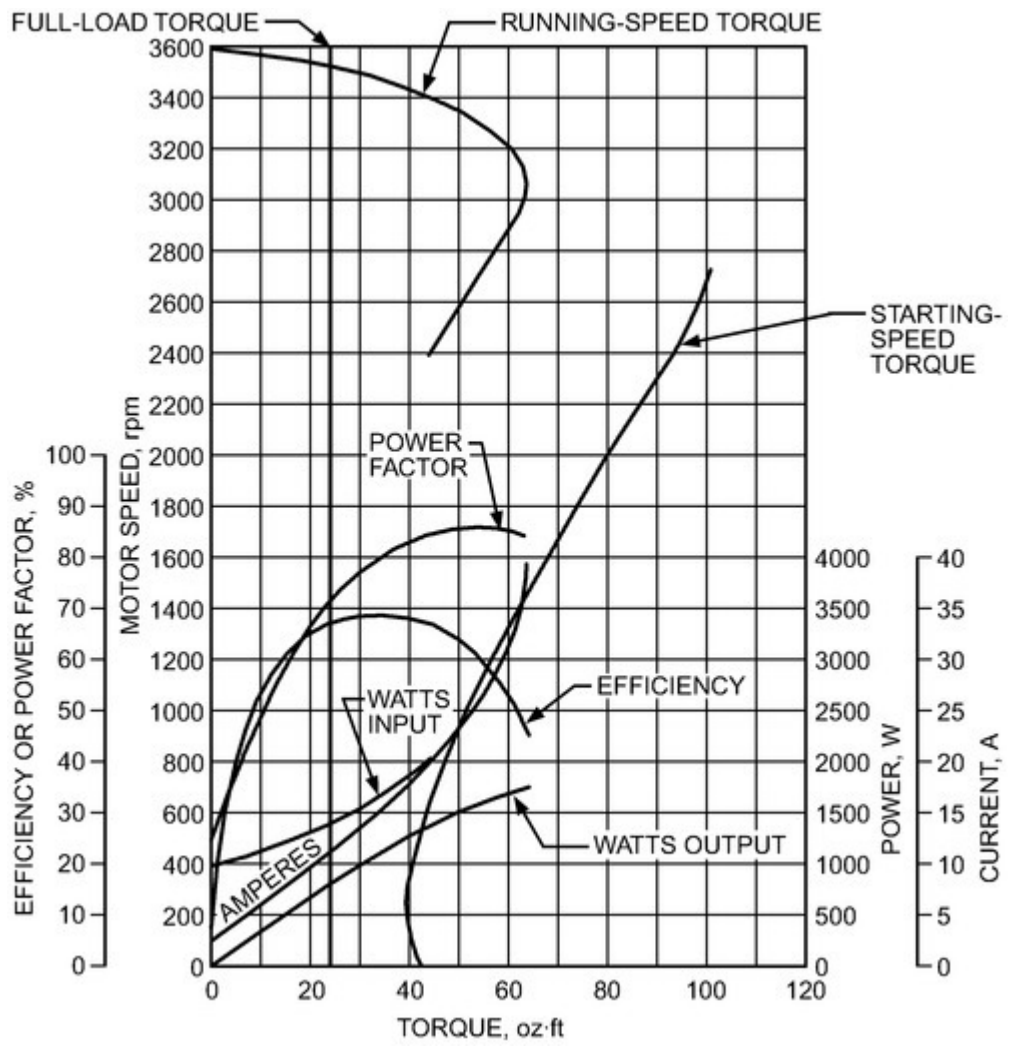


Figure 1. Typical Performance Characteristics of Capacitor-Start/Induction-Run Two-Pole General-Purpose Motor, 1 hp

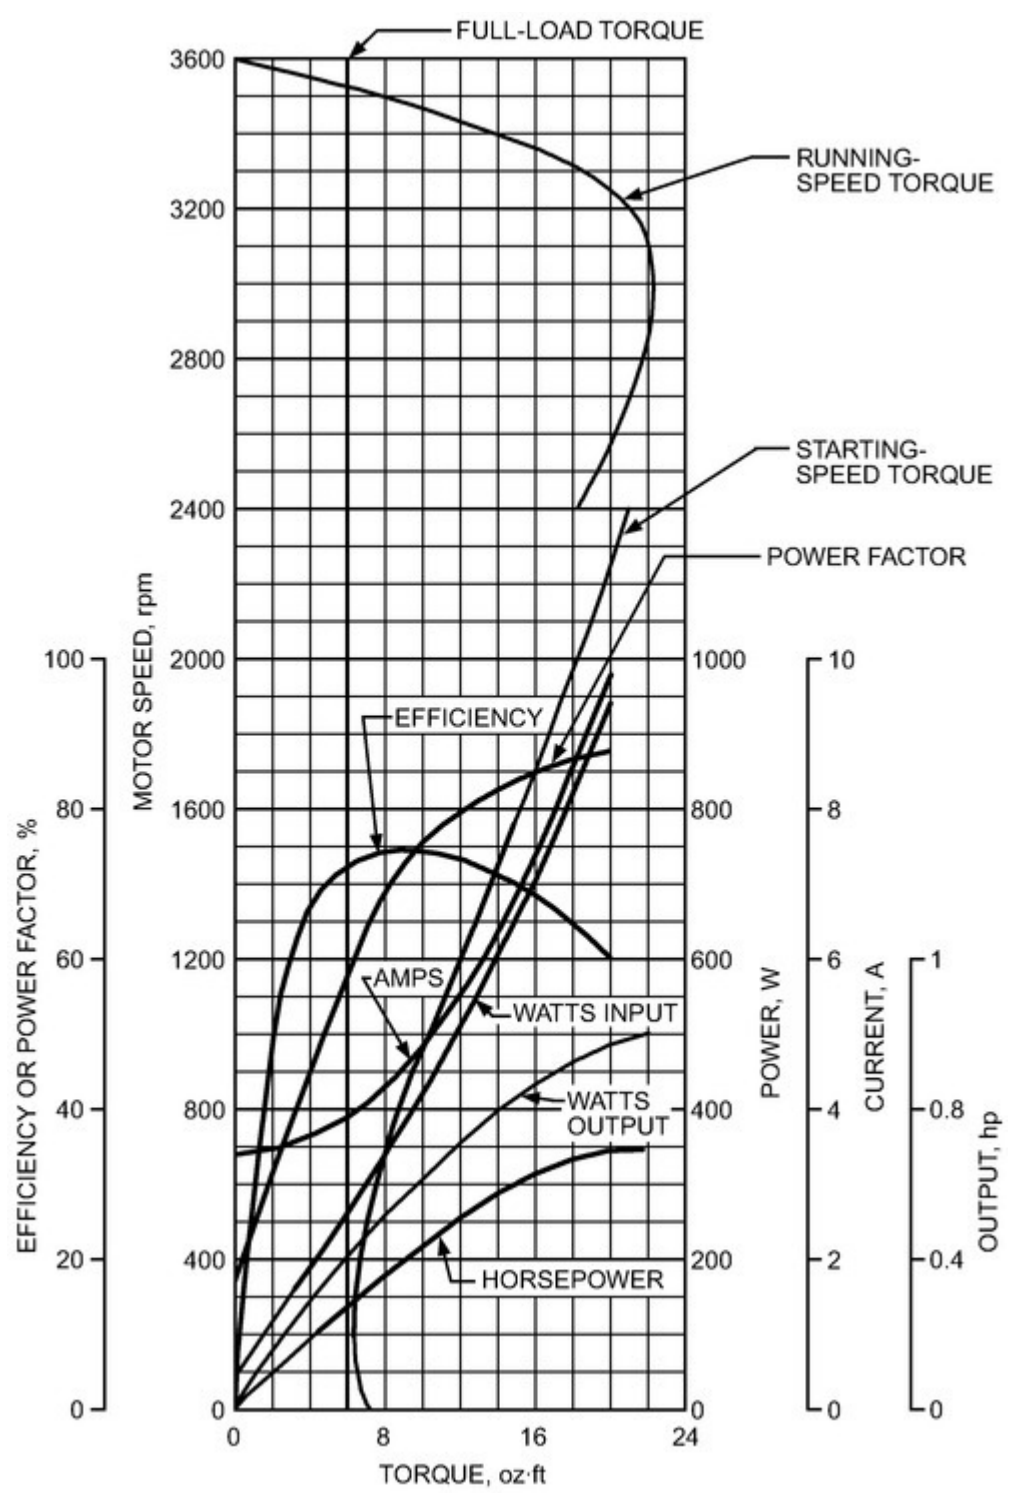


Figure 2. Typical Performance Characteristics of Resistance-Start Split-Phase Two-Pole Hermetic Motor, 0.25 hp

It is important to understand motor types before specifying one. For example, a permanent split-capacitor motor is more efficient than a shaded-pole fan motor. A capacitor-start/capacitor-run motor is more efficient than either a capacitor-start or a split-phase motor. Three-phase motors are much more likely to have published efficiency; NEMA and the DOE promulgate efficiency standards for three-phase motors between 1 and 500 hp.

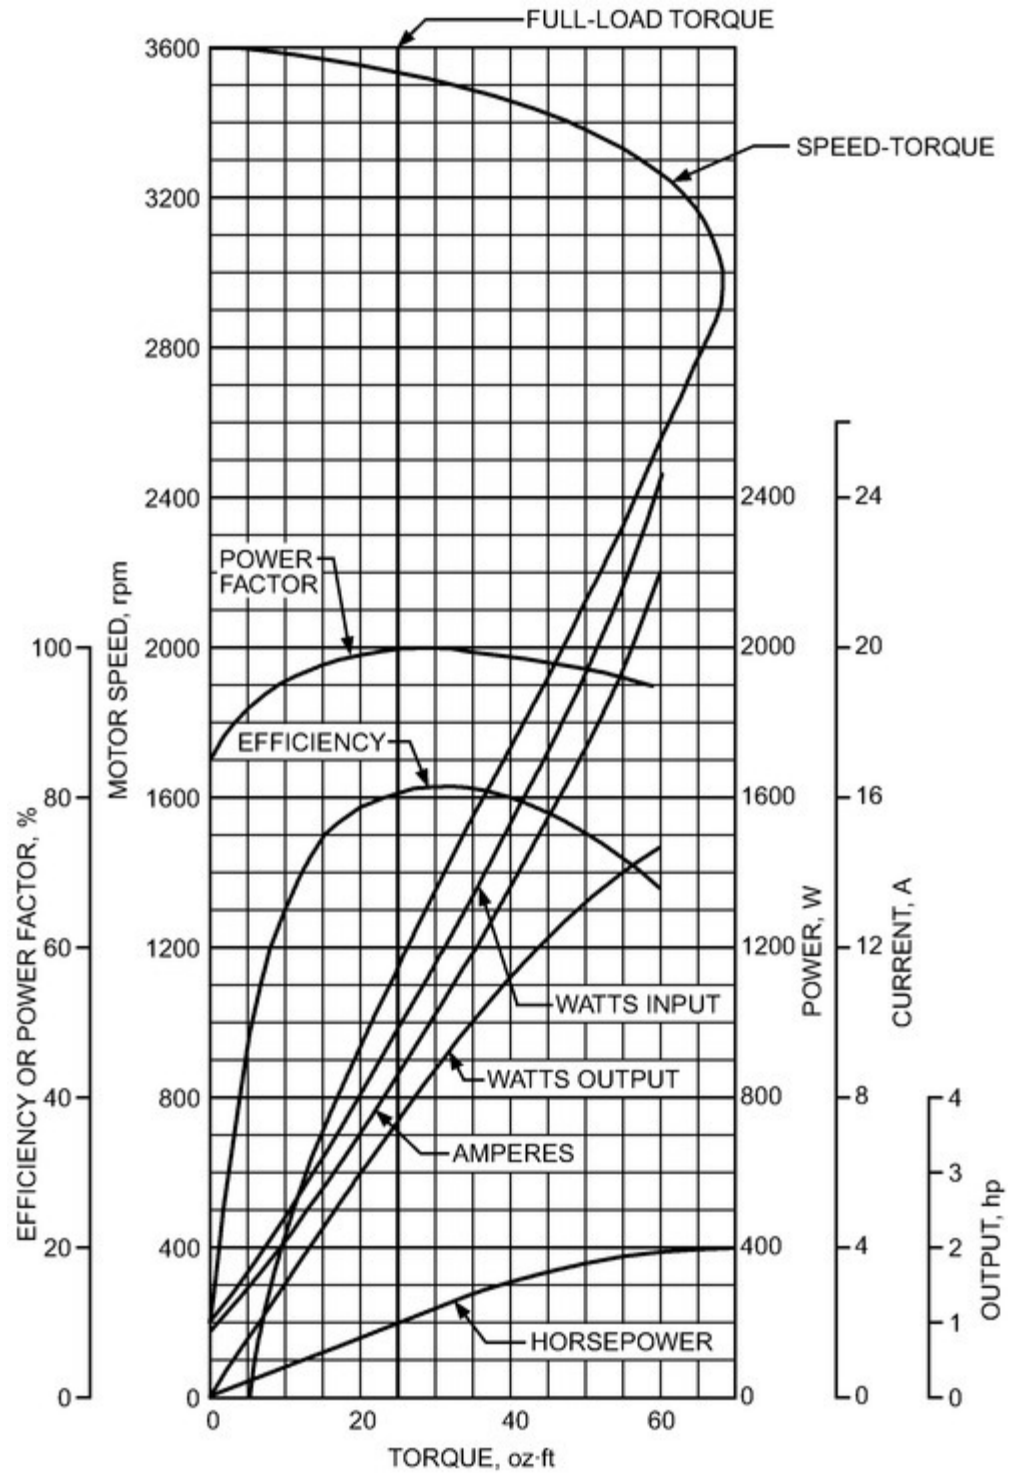


Figure 3. Typical Performance Characteristics of Permanent Split-Capacitor Two-Pole Motor, 1 hp

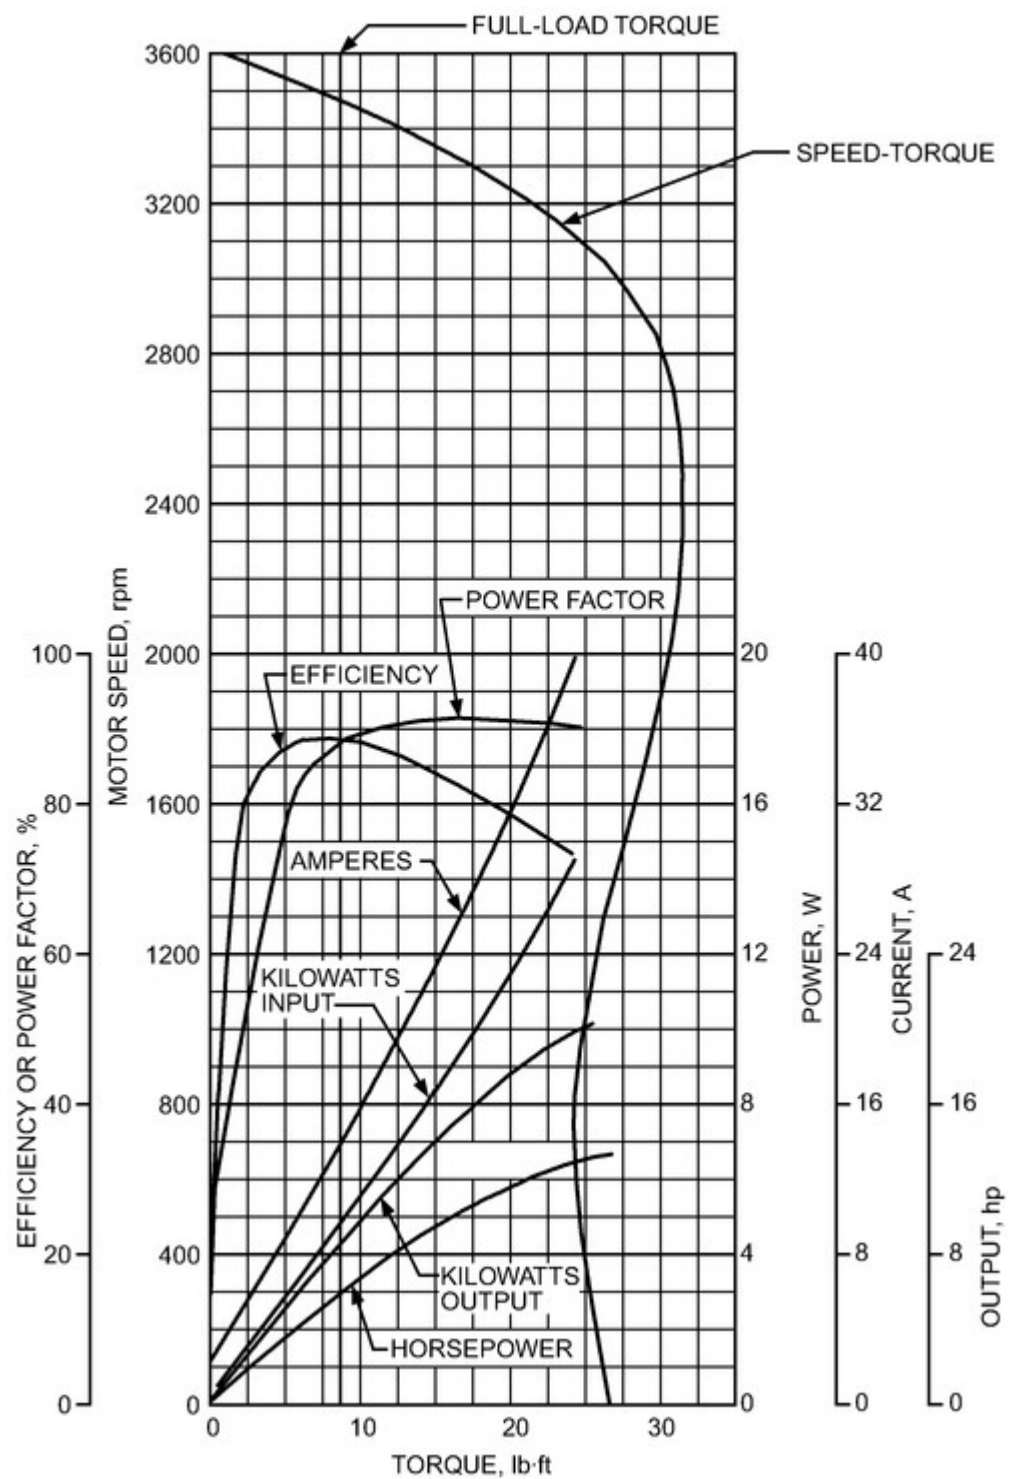


Figure 4. Typical Performance Characteristics of Three-Phase Two-Pole Motor, 5 hp

Motor manufacturers offer motors over a range of efficiencies. NEMA *Standard* MG 1 describes two efficiency categories: energy efficient and premium (Table 12-12 and Table 12-208). These standards pertain to most three-phase induction motors between 1 to 500 hp. Note that the NEMA Premium[®] level was made a mandatory minimum for general-purpose induction motors from 1 to 500 hp in the United States by the U.S. Department of Energy (DOE). In 2015, the U.S. DOE also mandated higher efficiency levels for small electric motors that are rated as general purpose as defined by NEMA MG 1 [GPO (annual)]. Small electric motors are categorized by NEMA frames 42, 48, and 56 [International Electrotechnical Commission (IEC) equivalents 63, 71, and 80] ranging from 0.25 to 3 hp.

Higher-efficiency motors are available in standard frame sizes and performance ratings. Premium-rated motors are more costly than less efficient counterparts, but the additional costs are usually recovered by energy savings very early in the motor's service life; most manufacturers also cite extra reliability features added into premium-rated motors. NEMA *Standards* MG 10 and MG 11 have more information on motor efficiency for single-phase and three-phase motors, respectively.

1.4 GENERAL-PURPOSE MOTORS

The electrical industry classifies motors as **small kilowatt (fractional horsepower)** or **integral kilowatt (integral horsepower)**. In this context, *kilowatt* refers to power output of the motor. Small-kilowatt motors have ratings of less than 1 hp at 1700 to 1800 rpm for four-pole and 3500 to 3600 rpm for two-pole machines. Single-phase motors are readily available through 5 hp and are most common through 0.75 hp, because motors larger than 0.75 hp are usually three phase.

Table 3 lists motors by types indicating the normal power range and type of power supply. All motors listed are suitable for either direct or belt drive, except shaded-pole motors (limited by low starting torque).

Application

When applying an electric motor, the following characteristics are important: (1) mechanical arrangement, including position of the motor and shaft, type of bearing, portability desired, drive connection, mounting, and space limitations; (2) speed range desired; (3) power requirement; (4) torque; (5) inertia; (6) frequency of starting; and (7) ventilation requirements. Motor characteristics that are frequently applied are generally presented in curves (see [Figures 1](#) to [4](#)).

Table 3. Motor Types		
Type	Range, hp	Type of Power Supply
Fractional Sizes		
Split-phase	0.05 to 0.5	Single phase
Capacitor-start	0.05 to 1.5	Single phase
Repulsion-start	0.13 to 1.5	Single phase
Permanent split-capacitor	0.05 to 1.5	Single phase
Shaded-pole	0.01 to 0.25	Single phase
Permanent magnet, electronically commutated (EC)	0.01 to 1.5	Single phase
Squirrel cage induction	0.17 to 1.5	Three phase
Direct current	0.5 to 1.5	DC
Integral Sizes		
Capacitor-start/capacitor-run	1 to 5	Single phase
Capacitor-start	1 to 5	Single phase
Squirrel cage induction (normal torque)	1 and up	Three phase
Slip-ring	1 and up	Three phase
Permanent magnet EC	1 and up	Three phase
Direct current	1 and up	DC
Permanent split-capacitor	1 to 5	Single phase

Torque. The torque required to operate the driven machine at all times between initial breakaway and final shutdown is important in determining the type of motor. The torque available at zero speed or standstill (**starting torque**) may be less than 100% or as high as 400% of full-load torque, depending on motor design. The **starting current**, or **locked-rotor current**, is usually 400 to 600% of the current at rated full load.

Full-load torque is the torque developed to produce the rated power at the rated speed. **Full-load speed** also depends on the motor's design. For induction motors, a speed of 1750 rpm is typical for four-pole motors, and a speed of 3450 rpm is typical for two-pole motors at 60 Hz.

Motors have a **maximum or breakdown torque**, which cannot be exceeded. The relation between breakdown torque and full-load torque varies widely, depending on motor design.

Power. The power delivered by a motor is a product of its torque and speed. Because a given motor delivers increasing power up to maximum torque, a basis for power rating is needed. NEMA bases **power rating** on breakdown torque limits for single-phase motors, 10 hp and less. All others are rated at their power capacity within voltage and temperature limits as listed by NEMA.

Full-load rating is based on the maximum winding temperature. If the nameplate marking includes the maximum ambient temperature for which the motor is designed and the insulation designation, the maximum temperature rise of the winding may be determined from the appropriate section of NEMA *Standard* MG 1.

Service Factor. This factor is the maximum overload that can be applied to general-purpose motors and certain definite-purpose motors without exceeding the temperature limitation of the insulation. When the voltage and frequency are maintained at the values specified on the nameplate and the ambient temperature does not exceed 104°F, the motor may be loaded to the power obtained by multiplying the rated power by the service factor shown on the nameplate. Operating a motor continuously at service factor loading reduces insulation and bearing life compared to operation within the load rating.

The power rating is normally established on the basis of a test-run in still air. However, most direct-drive, air-moving applications are checked with air flowing over the motor. If the motor nameplate marking does not specify a service factor, refer to the appropriate section of NEMA *Standard* MG 1. Characteristics of alternating current motors are given in [Table 4](#).

1.5 PERMANENT-MAGNET AC MOTORS

Permanent-magnet AC motors, often referred to as brushless, differ from standard induction motors by their rotors, which contain permanent magnets, either surface mounted or internal to the rotor. Permanent-magnet motors are more efficient than induction motors because they do not need to induce a magnetic field in the rotor to follow the rotating magnet field in the stator. Also, because of their flatter efficiency curve, these motors can maintain higher efficiency at low loads compared to induction motors. However, permanent-magnet motors cannot be started by simply applying AC line power. To operate properly, these motors must always be applied with a suitable variable-frequency drive. Sometimes, the variable-frequency drive is integrated with the motor.

Table 4. Characteristics of AC Motors (Nonhermetic)						
Connection Diagram	Split-Phase	Permanent Split-Capacitor	Capacitor-Start/ Induction-Run	Capacitor-Start/ Capacitor-Run	Shaded-Pole	Three Phase
Typical Speed Torque Curves						
Starting Method	Centrifugal switch	None	Centrifugal switch	Centrifugal switch	None	None
Ratings, hp	0.05 to 0.5	0.05 to 0.1	0.125 to 5	0.125 to 5	0.01 to 0.25	0.5 and up
Approximate Full-Load Speeds at 60 Hz (Two-Pole/Four-Pole)	3450/1725	3450/1725	3450/1725	3500/1750	3100/1550	3500/1750
Torque ²						
Locked Rotor	125 to 150%	30 to 150%	250 to 350%	250%	25%	150 to 350%
Breakdown	250 to 300%	250 to 300%	250 to 300%	250%	125%	250 to 350%
Speed Classification	Constant	Constant	Constant	Constant	Constant or adjustable	Constant
Full-Load Power Factor	60%	95%	65%	95%	60%	80%
Efficiency	Medium	High	Medium	High	Low	High-Medium

²Expressed as percent of rated horsepower torque.

1.6 HERMETIC MOTORS

A hermetic motor is a partial motor usually consisting of a stator and a rotor without shaft, end shields, or bearings. It is for installation in hermetically sealed refrigeration compressor units. With the motor and compressor sealed in a common chamber, the winding insulation system must be impervious to the action of the refrigerant and lubricating oil. Hermetic motors are used in both welded and accessible hermetic (semihhermetic) compressors.

Application

Domestic Refrigeration. Hermetic motors up to 0.33 hp are used. They are split-phase, permanent split-capacitor, or capacitor-start motors for medium- or low-starting-torque compressors and capacitor-start and special split-phase motors for high-starting-torque compressors.

Room Air Conditioners. Motors from 0.33 to 3 hp are used. They are permanent split-capacitor or capacitor-start/capacitor-run types. These designs have high power factor and efficiency and meet the need for low current draw, particularly on 115 V circuits.

Central Air Conditioning (Including Heat Pumps). Both single-phase (6 hp and below) and three-phase (1.5 hp and above) motors are used. The single-phase motors are permanent split-capacitor or capacitor-start/capacitor-run types.

Small Commercial Refrigeration. Practically all these units are below 5 hp, with single-phase being the most common. Capacitor-start/induction-run motors are normally used up to 0.75 hp because of starting torque requirements. Capacitor-start/capacitor-run motors are used for larger sizes because they provide high starting torque and high full-load efficiency and power factor.

Large Commercial Refrigeration. Most motors are three-phase and larger than 5 hp.

Power ratings of motors for hermetic compressors do not necessarily have a direct relationship to the thermodynamic output of a compressor. Designs are tailored to match the compressor characteristics and specific applications. [Chapter 38](#) briefly discusses hermetic motor applications for various compressors.

1.7 INTEGRAL THERMAL PROTECTION

The *National Electrical Code* (NEC) and UL standards cover motor protection requirements. Separate, external protection devices include the following:

Thermal Protectors. These protective devices are an integral part of a motor or hermetic motor refrigerant compressor. They protect the motor against overheating caused by overload, failure to start, or excessive operating current. Thermal protectors are required to protect three-phase motors from overheating because of an open phase in the primary circuit of the supply transformer. Thermal protection is accomplished by either a line break device or a thermal sensing control circuit.

The protector of a hermetic motor-compressor has some unique capabilities compared to nonhermetic motor protectors. The refrigerant cools the motor and compressor, so the thermal protector may be required to prevent overheating from loss of refrigerant charge, low suction pressure and high superheat at the compressor, obstructed suction line, or malfunction of the condensing means.

Article 440 of the NEC limits the maximum continuous current on a motor-compressor to 155% of rated load current if an integral thermal protector is used. NEC Article 430 limits the maximum continuous current on a nonhermetic motor to different percentages of full-load current as a function of size. If separate overload relays and fuses are used for protection, Article 430 limits maximum continuous current to 140% and 125%, respectively, of rated load.

UL *Standard* 984 specifies that the compressor enclosure must not exceed 302°F under any conditions. The motor winding temperature limit is set by the compressor manufacturer based on individual compressor design requirements.

Line-Break Protectors. Integral with a motor or motor-compressor, line-break thermal protectors that sense both current and temperature are connected electrically in series with the motor; their contacts interrupt the total motor line-current. These protectors are used in small, single-phase and three-phase motors up through 15 hp.

Protectors installed inside a motor-compressor are hermetically sealed because exposed arcing in the presence of refrigerant cannot be tolerated. They provide better protection than the external type for loss of charge, obstructed suction line, or low voltage on the stalled rotor. This is because of low current associated with these fault conditions, hence the need to sense the motor temperature increase by thermal contact. Protection inside the compressor housing must withstand pressure requirements established by UL.

Protectors mounted externally on motor-compressor shells, sensing only shell temperature and line current, are typically used on smaller compressors, such as those in household refrigerators and small room air conditioners. One benefit occurs during high-head-pressure starting conditions, which can occur if voltage is lost momentarily or if the user inadvertently turns off the compressor with the temperature control and then turns it back on immediately. Usually, these units do not start under these conditions. When this happens, the protector takes the unit off the line and resets automatically when the compressor cools and pressures have equalized to a level that allows the compressor to start.

Protectors installed in nonhermetic motors may be attached to the stator windings or may be mounted off the windings but in the motor housing. Those protectors placed on the winding are generally installed before stator varnish dip and bake, and their construction must prevent varnish from entering the contact chamber.

Because the protector carries full motor line current, its size is based on adequate contact capability to interrupt the stalled current of the motor on continuous cycling for periods specified in UL *Standard* 984.

The compressor or motor manufacturer applies and selects appropriate motor protection in cooperation with the protector manufacturer. Any change in protector rating, by other than the specifying manufacturer after the proper application has been made, may result in either overprotection and frequent nuisance trippouts or underprotection and burnout of the motor windings. Connections to protector terminals, including lead wire sizes, should not be changed, and no additional connections should be made to the terminals. Any change in connection changes the terminal conditions and affects protector performance.

Control Circuit Protectors. Protection systems approved for use with a motor or motor-compressor, either sensing both current and temperature or sensing temperature only, are used with integral horsepower single-phase and three-phase motors.

The current and temperature protector uses a bimetallic temperature sensor installed in the motor winding in conjunction with thermal overload relays. The sensors are connected in series with the control circuit of a magnetic contactor that interrupts the motor current. Thermostat sensors of this type, which depend on their size and mass, are capable of tracking motor winding temperature for running overloads. When a rotor is locked (when the rate of change in winding temperature is rapid), the temperature lag is usually too great for such sensors to provide protection when they are used alone. However, when the bimetallic sensor is used with separate thermal overload or magnetic time-delay relays that sense motor current, the combination provides excellent protection. On a locked rotor condition, the current-sensing relay protects for the initial cycle, and the combined functioning of relay and thermostat protects for subsequent cycles.

The temperature-only protector uses the resistance change of a thermistor-type sensor to provide a switching signal to an electronic circuit, whose output is in series with the control circuit of a magnetic contactor used to interrupt the motor current. The output of the electronic protection circuitry (module) may be an electromechanical relay or a power triac. Sensors may be installed directly on the stator winding end turns or buried inside the windings. Their small size and good thermal transfer allow them to track the temperature of the winding for locked rotor, as well as running overload.

Three types of sensors are available. One type uses a ceramic material with a positive temperature coefficient of resistance; the material exhibits a large, abrupt change in resistance at a particular design temperature. This change occurs at the **anomaly point**, which is inherent in the sensor. The anomaly point remains constant once the sensor is manufactured; sensors are produced with anomaly points at different temperatures to meet different requirements. However, a single module calibration can be supplied for all anomaly temperatures of a given sensor type.

Another type of sensor uses a metal wire, which has a linear increase in resistance with temperature. The sensor assumes a specified value of resistance corresponding to each desired value of response or operating temperature. It is used with an electronic protection module calibrated to a specific resistance. Modules supplied with different calibrations are used to achieve various values of operating temperatures.

A third type is a negative temperature coefficient of resistance sensor, which is integrated with electronic circuitry similar to that used with the metal wire sensor.

More than one sensor may be connected to a single electronic module in parallel or series, depending on design. However, the sensors and modules must be of the same design and intended for use with the particular number of sensors installed and the wiring method used. Electronic protection modules must be paired only with sensors specified by the manufacturer, unless specific equivalency is established and identified by the motor or compressor manufacturer.

1.8 MOTOR PROTECTION AND CONTROL

In general, four functions are accomplished by motor protection and control. Separate or integral control components are provided to (1) disconnect the motor and controller from the power supply and protect the operator; (2) start and stop the motor and, in some applications, control the speed or direction of rotation; (3) protect motor branch circuit conductors and control apparatus against short-circuiting; and (4) protect the motor itself from overloading and overheating.

Separate Motor Protection

Most air-conditioning and refrigeration motors or motor-compressors, whether open or hermetic, are equipped with integral motor protection by the equipment manufacturer. If this is not the case, separate motor-protection devices, sensing current only, must be used. These consist of thermal or magnetic relays, similar to those used in industrial control, that provide running overload and stalled-rotor protection. Because hermetic motor windings heat rapidly because of the loss of the cooling effect of refrigerant gas flow when the rotor is stalled, **quick-trip devices** must be used.

Thermostats or thermal devices are sometimes used to supplement current-sensing devices. Supplements are necessary (1) when automatic restarting is required after trip or (2) to protect from abnormal running conditions that do not increase motor current. These devices are discussed in the section on Integral Thermal Protection.

Protection of Control Apparatus and Branch Circuit Conductors

In addition to protection of the motor itself, Articles 430 and 440 of the *National Electrical Code* require the control apparatus and branch circuit conductors to be protected from overcurrent resulting from motor overload or failure to start. This protection can be given by some thermal protective systems that do not allow a continuous current in excess of required limits. In other cases, a current-sensing device, such as an overload relay, a fuse, or a circuit breaker, is used.

Circuit Breakers. These devices are used for disconnecting as well as circuit protection, and are available in ratings for use with small household refrigerators as well as in large commercial and industrial installations. Manual switches for disconnecting and fuses for short-circuit protection are also used. For single-phase motors up to 3 hp, 230 V, an attachment plug is an acceptable disconnecting device.

Controllers. The motor control used is determined by the size and type of motor, power supply, and degree of automation. Control may be manual, semi-automatic, or fully automatic.

Central air conditioners are generally located some distance from the controlled space environment control, such as room thermostats. Therefore, **magnetic controllers** must be used in these installations. Also, all DC and all large AC installations must be equipped with in-rush **current-limiting controllers**, which are discussed later. **Synchronous motors** are sometimes used to improve the power factor. **Multispeed motors** provide flexibility for many applications.

Manual Control. For an AC or DC motor, manual control is usually located near the motor. If so, an operator must be present to start and stop or change the motor speed by adjusting the control mechanism.

Manual control is the simplest and least expensive control method for small AC motors, both single-phase and three-phase, but it is seldom used with hermetic motors. The manual controller usually consists of a set of main line contacts, which are provided with thermal overload relays for motor protection.

Manual speed controllers can be used for large air conditioners using **slip-ring motors**; they may also provide reduced-current starting. Different speed points are used to vary the amount of cooling provided by the compressor.

Across-the-Line Magnetic Controllers. These controllers are widely used for central air conditioning. They may be applied to motors of all sizes, provided power supply and motor are suitable to this type of control. Across-the-line magnetic starters may be used with automatic control devices for starting and stopping. Where push buttons are used, they may be wired for either low-voltage release or low-voltage protection.

Three-Phase Motor Starting

One advantage of three-phase induction motors is their inherently good starting torque without special coils or components. However, some applications require current reduction or additional starting torque.

Full-Voltage and Reduced-Voltage Starting. For motors, full-voltage starting is commonly used because of its lower initial cost and simplicity of control. Except for DC machines, most motors are mechanically and electrically designed for full-voltage starting. The maximum allowable starting current, however, is limited in many cases by power utility requirements made because of voltage fluctuations, which may be caused by heavy current surges. Therefore, to meet the limitations of available power supplies, the starting current must often be reduced below that obtained by across-the-line starting. Many alternative methods have been applied to accomplish this.

Primary Resistance Starting. This method is one of the simplest ways to make this reduction, with resistors placed in the primary circuit. As the motor accelerates, the resistance is cut out by the use of timing or current relays.

Autotransformer Motor Starters. In this method, starting voltage is reduced, and, when the motor accelerates, it is disconnected from the transformer and connected across the line by timing or current relays. Primary resistor starters are generally smaller and less expensive than autotransformer starters for moderate size motors; however, primary resistor starters require more line current for a given starting torque.

Solid-State Electronic Soft Starters. These starters can ramp the supply voltage at preprogrammed rates to reduce in-rush current and provide optimum torque for each application. This method has become widely accepted because of the reliability of power electronics and the electronic capability to program acceleration and deceleration ramp times. Current limit may also be used with this motor starting method. Once the motor reaches full speed, bypass contactors may be used to remove power electronic devices used during the motor start.

Star-Delta (Wye Delta) Motor Starters. This starting method limits current efficiently, but these starters require motors configured with extra windings and leads for this type of starting. The motor is started with its windings connected in a star (wye) configuration. This increases the line-to-line impedance of the motor, reducing its starting current. After a time delay, a set of contactors reconfigures the motor's windings into a delta configuration. This allows the motor to produce its full rated output. They are particularly suited for centrifugal, rotary screw, and reciprocating compressor drives starting without load.

Part-Winding Motor Starters. These starters limit line disturbances by connecting only part of the motor winding to the line and connecting the second motor winding to the line after a time interval of 1 to 3 s. If the motor is not heavily loaded, it accelerates when the first part of the winding is connected to the line; if it is too heavily loaded, the motor may not start until the second winding is connected to the line. In either case, the voltage sag is less than the sag that would result if a standard squirrel-cage motor with an across-the-line starter were used. Part-winding motors may be controlled either manually or magnetically. The magnetic controller consists of two contactors and a timing device for the second contactor.

Multispeed Motor Starters. Multispeed motors provide flexibility in many types of drives in which variation in capacity is needed. Two types of multispeed motors are used: (1) motors with one reconnectable winding and (2) motors with two separate windings. Motors with separate windings need a contactor for each winding, and only one contactor can be closed at any time. Motors with a reconnectable winding are similar to motors with two windings, but the contactors and motor circuits are different.

Slip-Ring Motor Starters. Slip-ring AC motors provide reduced-current starting with high torque during acceleration and variable speed after acceleration. The wound rotor of these motors functions in the same manner as in the squirrel-cage motor, except that the rotor windings are connected through slip rings and brushes to external circuits with resistance to vary the motor speed. Increasing resistance in the rotor circuit reduces motor speed, and decreasing resistance increases motor speed. When resistance is shorted out, the motor operates with maximum speed, efficiency, and power factor. On some large installations, manual drum controllers are used as speed-setting devices. Complete automatic control can be provided with special control devices for selecting motor speeds. Operation at reduced speed is at reduced efficiency. These controllers have become less common with the advent of variable-frequency drives, which provide low-current, high-torque starting with good efficiency at reduced speed.

Direct-Current Motor Starting

These motors have constant torque characteristics, and their speed can be precisely controlled by varying voltage in the field, armature, or both. Large DC motors are started with resistance in the armature circuit, which is reduced step by step until the motor reaches its base speed. Higher speeds are provided by weakening the motor field. These systems are becoming less common as better speed control strategies in AC motor drive systems develop.

Single-Phase Motor Starting

Motor-starting switches and relays for single-phase motors must provide a means for disconnecting the starting winding of split-phase or capacitor-start/induction-run motors or the start capacitor of capacitor-start/capacitor-run motors. Motors may have a centrifugal switch mounted on the motor shaft, which disconnects the starting winding at about 70% of full-load speed.

Thermally Operated Relay. When the motor is started, a contact that is normally closed applies power to the starting winding. A thermal element that controls these contacts is in series with the motor and carries line current. Current flowing through this element heats it until, after a definite time, it is warmed sufficiently to open the contacts and remove power from the starting winding. The running current then heats the element enough to keep the contacts open. Setting the time for the starting contacts to open is determined by tests on the components (i.e., the relay, motor, and compressor) and is based on a prediction of the time delay required to bring the motor up to speed.

An alternative form of a thermally operated relay is a positive temperature coefficient of resistance (PTC) starting device. This device has a ceramic element with low resistance at room temperature that increases about 1000 times when it is heated to a predetermined temperature. It is placed in series with the start winding of split-phase motors and allows current flow when power is applied. After a definite period, the self-heating of the PTC resistive element causes it to reach its high-resistance state, which reduces current flow in the start winding. The small residual current maintains the PTC element in the high-resistance state while the motor is running. A PTC starting device may also be connected in parallel with a run capacitor, and the combination may be connected in series with the starting winding. It allows the motor to start like a split-phase motor and then, when the PTC element reaches the high-resistance state, operate as a capacitor-run motor. When power is removed, the PTC element must be allowed to cool to its low resistance state before restarting the motor.

Current-Operated Relay. In this type of connection, a relay coil carries the line current going to the motor. When the motor is started, the in-rush current to the running winding passes through the relay coil, causes the normally open contacts to close, and applies power to the starting winding. As the motor comes up to speed, the current decreases until, at a definite calibrated value of current corresponding to a preselected speed, the magnetic force of the coil diminishes to a point that allows the contacts to open to remove power from the starting winding. This relay takes advantage of the **main winding current** as opposed to the **speed** characteristics of the motor. The current/speed curve varies with line voltage, so the starting relay must be selected for the voltage range likely to be encountered in service. Ratings established by the manufacturer should not be changed because this may result in undesirable starting characteristics. They are selected to disconnect the starting winding or start capacitor at approximately 70 to 90% of synchronous speed for four-pole motors.

Voltage-Operated Relay. Capacitor-start and capacitor-start/ capacitor-run hermetically sealed motors above 0.5 hp are usually started with a normally closed contact voltage relay. In this method of starting, the relay coil is connected in parallel with the starting winding. When power is applied to the motor, the relay does not operate because it is calibrated to operate at a higher voltage. As the motor comes up to speed, the voltage across the starting winding and relay coil increases in proportion to the motor speed. At a definite voltage corresponding to a preselected speed, the relay opens; this opens the starting winding or disconnects the starting capacitor. The relay keeps these contacts open because sufficient voltage is induced in the starting winding when the motor is running to hold the relay in the open position.

Operating AC Induction Motors above Nameplate Speed Using Variable-Frequency Drives

Increasingly, variable-frequency drives (VFDs) are used to operate motors above nameplate speeds. This is done to increase the capacity of fans or pumps during normal operation or, sometimes, only during emergency peak demand situations (e.g., smoke evacuation). In either case, it is critical that these systems have properly sized motors to perform at the increased loads these speeds require. Care is necessary when operating the motor at a frequency other than its nameplate frequency. The voltage applied to the motor must be adjusted along with the frequency. Supplying too much voltage can force too much current through the motor, generating excess heat. This reduces the motor's efficiency and could damage it. Applying too little voltage to the motor reduces its output torque capacity and causes the motor's slip to increase. This also increases the motor's current and thermal stress, even though its torque is reduced. This may cause the motor to stall when attempting to drive the connected load. Consideration should also be given to the maximum allowable speed of the load.

The ideal amount of voltage depends on both operating speed and amount of torque required by the load. Because most HVAC applications use drives on variable-torque loads, this section discusses only this type of load profile. Variable-torque loads require reduced torque at reduced operating speeds but also require increased torque as the speed is increased, even above base speed. In a pure variable-torque application, the torque required is proportional to the square of the load's speed. VFDs that are programmed for variable-torque applications often significantly reduce the voltage applied to the motor as its speed is reduced. Most now have added advanced control algorithms that allow them to go beyond simply controlling the voltage applied to the motor at any speed and instead try to reduce the current at any given load/speed condition.

Although operating a motor above its nameplate frequency would seem to be similar to operating it below its nameplate frequency, the situation is actually quite different, because at some point the drive runs out of additional voltage that can be applied to the motor. Standard VFDs only switch the supplied line voltage to obtain the output that the motor requires; they do not have the ability to significantly step up the power line voltage. As a result, the voltage applied to the motor stops increasing once it reaches rated, base speed. At the same time, the torque required by the driven load can increase significantly. Therefore, it is critical to properly size the motor and VFD to produce the torque which these speeds require.

[Figure 5](#) shows a typical motor voltage versus frequency output for a variable-torque VFD and motor operating at up to 150% of the motor nameplate frequency. Because the voltage applied to the motor is no longer enough to provide full magnetizing current, the output torque capacity of the motor is reduced above the 100% rated frequency. [Figure 6](#) shows how, after passing the motor's rated frequency and voltage, the available torque from the motor drops. In [Figure 6](#), increasing speed by 50% drops the motor's available torque to a bit less than 66% of its full-load rating. Because power is torque × speed, this results in approximately the same output power capacity during this extended-frequency operation as was available at rated frequency. Output power available from the motor may drop slightly, because of additional losses in the motor at the higher output speed. In general, this relationship between output frequency and output power holds for VFD output frequencies up to twice the motor's base frequency.

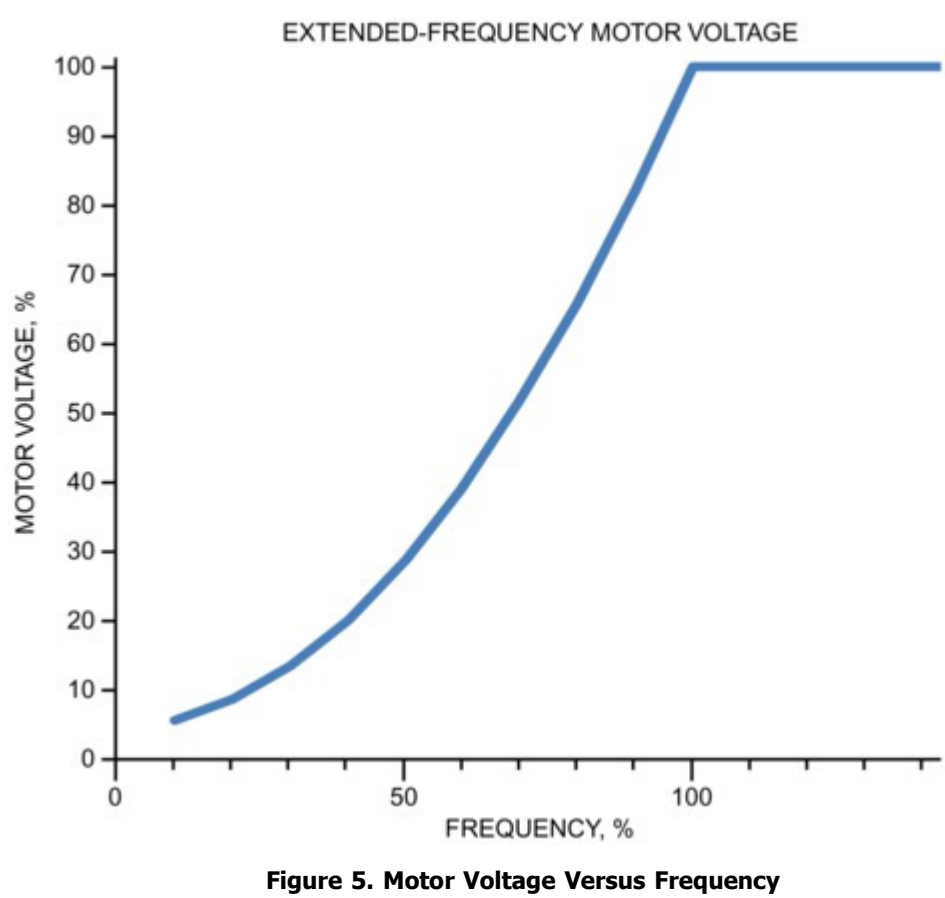


Figure 5. Motor Voltage Versus Frequency

To properly size the VFD and motor for extended-frequency control of variable-torque fans and pumps, it is important to remember that the load's power requirement increases approximately in proportion to the cube of its speed, but the motor's output power capacity may drop slightly as its speed increases above its rated speed. Therefore, it is essential to size the motor and VFD so that their base-speed power ratings are slightly greater than the power requirement of the load at the maximum extended frequency that will be used, as shown in [Figure 7](#).

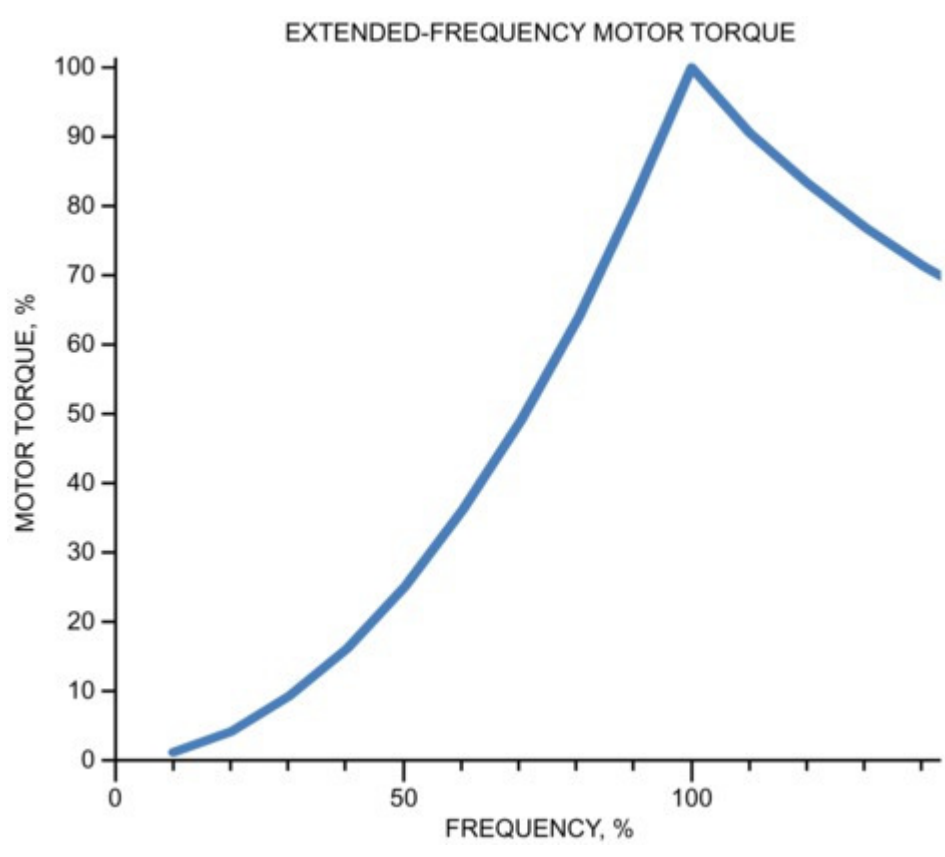


Figure 6. Motor Torque Limits Versus Frequency

VFD-Induced Bearing Currents

Causes of Bearing Currents. Although motor bearing currents have been recognized since the 1920s, recent developments have increased their frequency of occurrences and so the concerns about them.

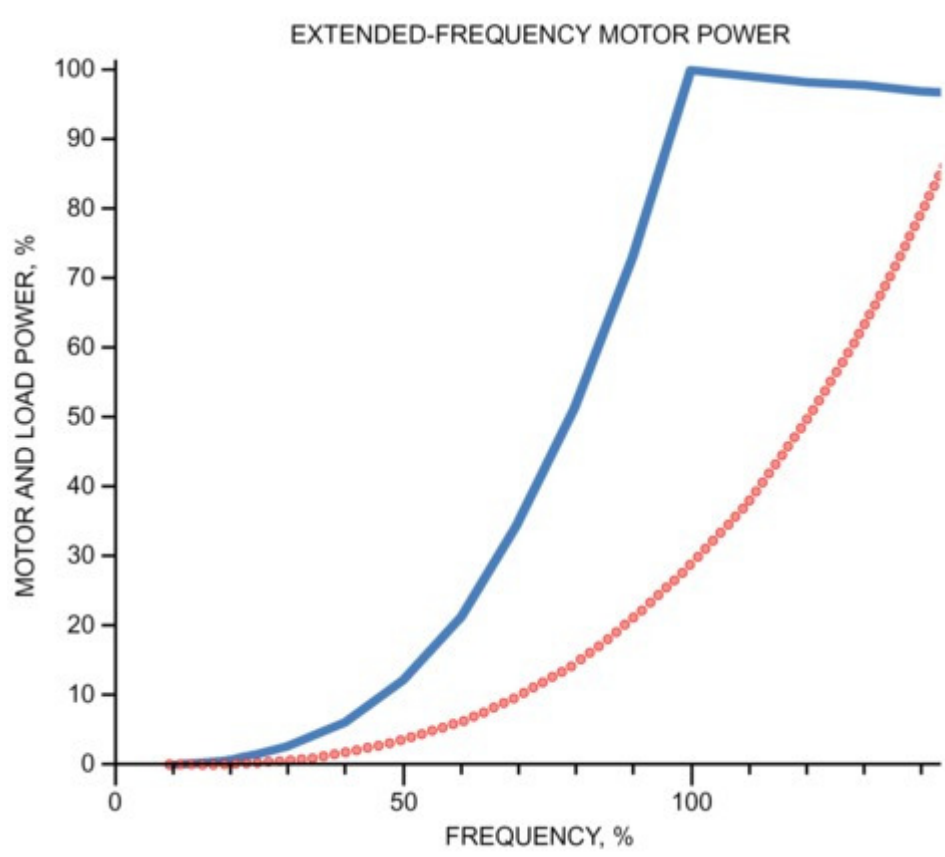


Figure 7. Motor Power Capacity at Maximum Extended Frequency

The following are major factors in the recent concern about motor bearing damage:

- Expanded use of pulse-width modulation (PWM) VFDs to control the speed of AC induction motors. Although PWM VFDs are very efficient and reliable, two aspects of them can contribute to motor bearing damage:
 - They convert incoming AC power into a DC bus. Energy from this DC bus is then switched to provide three-phase current to the driven motor. The AC power line can be symmetric with respect to earth ground, but it is very difficult to maintain this symmetry as the two polarities from the DC bus are switched to the three phases of the driven motor. This lack of symmetry results in common-mode voltages and currents being applied to the motor.
 - The PWM waveform consists of pulses of voltage from the DC bus that are used to control the voltage and frequency of the AC current applied to the motor. These pulses may have a frequency of 2 to 20 kHz or even higher; they also have a rise time of significantly less than 1 μs. This sharp voltage rise increases the efficiency of the VFD by reducing its switching losses, but it also results in high-frequency components in the PWM pulse that can capacitively couple an unbalanced voltage distribution onto the motor's rotor and so its shaft.

The PWM-generated voltage applied to the motor may affect the motor in three different ways:

- It may couple an AC voltage directly onto the motor's frame.
- It may drive a circulating AC current from one end of the shaft, through the bearing into the motor frame, through the bearing at the far end of the motor, and back into the shaft. This is seen primarily only in motors that are 100 hp and larger.
- It may capacitively couple a voltage with respect to ground onto the motor's shaft. If this voltage is high enough, it may arc across the capacitor formed by the races of the bearing, its rolling elements, and the lubricant, which acts as a dielectric.

Current pulsing across the bearing's lubricant will cause a minor mark in the bearing's races and/or its rolling elements. Although this damage will be minor at first, over time, these discharges may cause significant pitting or fluting of the bearing's races and/or its rolling elements ([Figure 8](#)).

Detecting Bearing Currents

The end result of prolonged arcing across a motor's bearings is increased vibration and audible noise. Therefore, detecting the presence of such discharges can be useful. In the field, it is nearly impossible to directly measure the discharge current through the bearing. However, there are two tests that can be performed to detect the presence of such discharges.

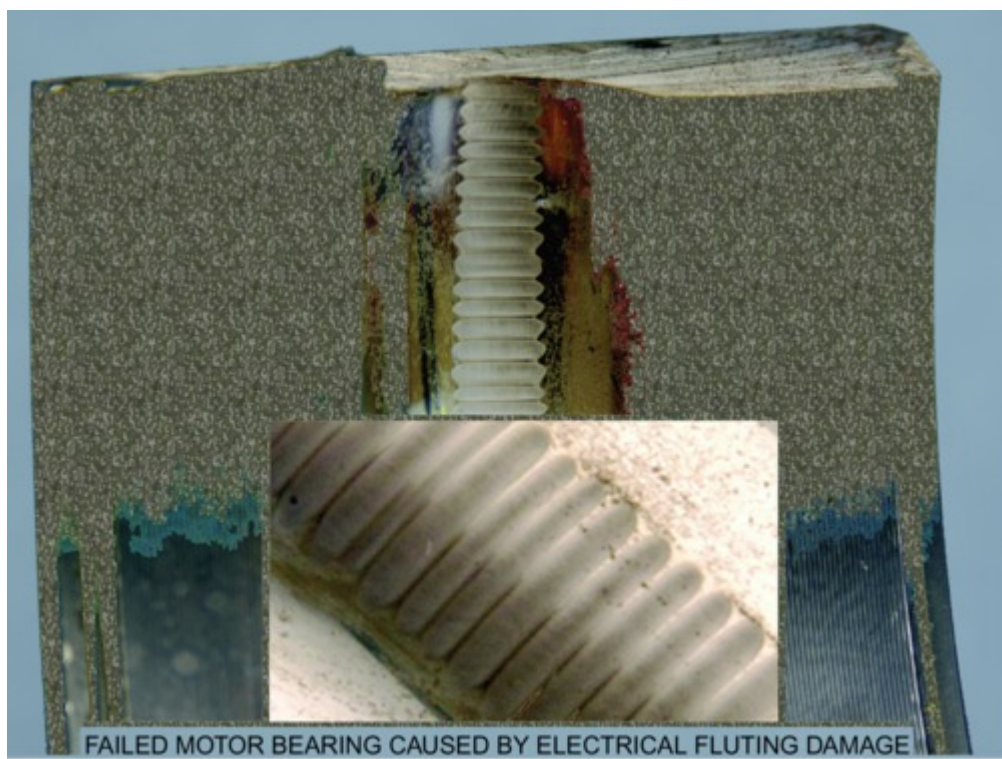


Figure 8. Fluted Bearing from VFD-Induced Electrical Bearing Current Discharges (Oh and Willwerth 2008)

The first is to use a storage oscilloscope to record the voltage from the motor shaft to the motor's frame. The following equipment is needed:

- Digital storage oscilloscope with a bandwidth of at least 50 MHz
- Probe to contact the rotating motor shaft, such as
 - Commercially available probes
 - Carbon brush adapted to be held on the motor's shaft
 - Any other device that can be adapted to contact the rotating shaft while using a minimum of bare lead length, which may pick up stray electrical noise
- Magnetic mount stand or some other device to hold the shaft probe in place while measurements are made

Use the following procedure:

- With the motor stopped, set up the measurement equipment.
- Set up the oscilloscope similar to this:
 - Direct current coupling.
 - Trigger ON.
 - Initial trigger level: approximately 2 V.
 - Initial time base: with a minimum sampling rate of at least 10 μs/division.
 - Vertical scale: approximately ±30 V full scale.
- Start the motor and adjust the oscilloscope to see the voltage on the motor's shaft.
- Increase the trigger level until the highest shaft voltage is shown.

If the shaft voltage increases and decreases relatively gradually, no discharges are occurring across the bearing ([Figures 9 and 10](#)). If the shaft voltage increases relatively gradually and then collapses quickly, a discharge across the bearing has been detected ([Figures 11 and 12](#)).

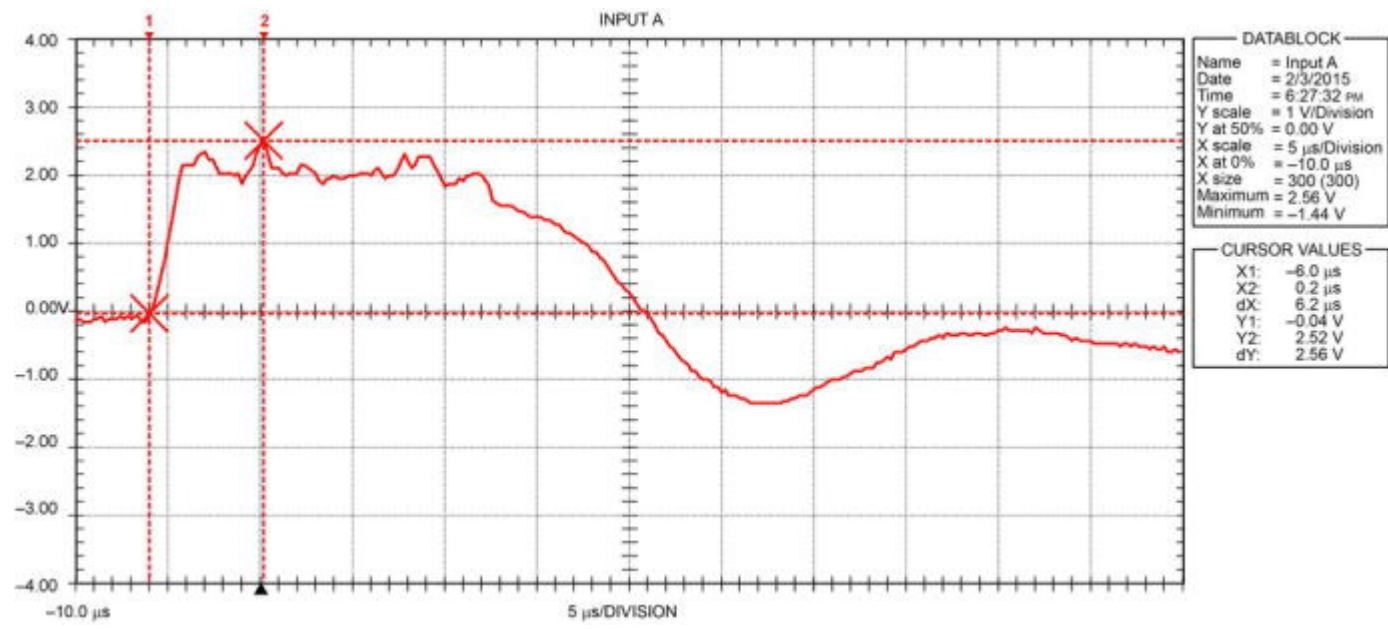


Figure 9. 2.5 V Peak Shaft Voltage, No Discharge

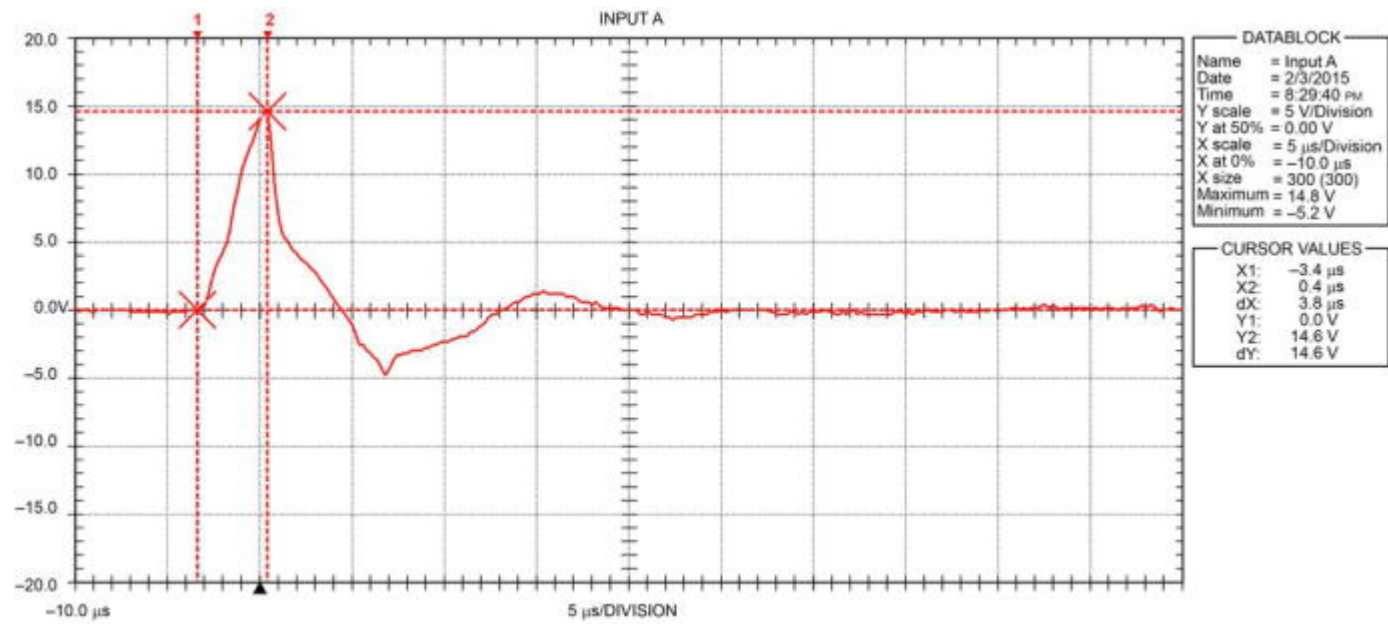


Figure 10. 14.6 V Peak Shaft Voltage, No Discharge

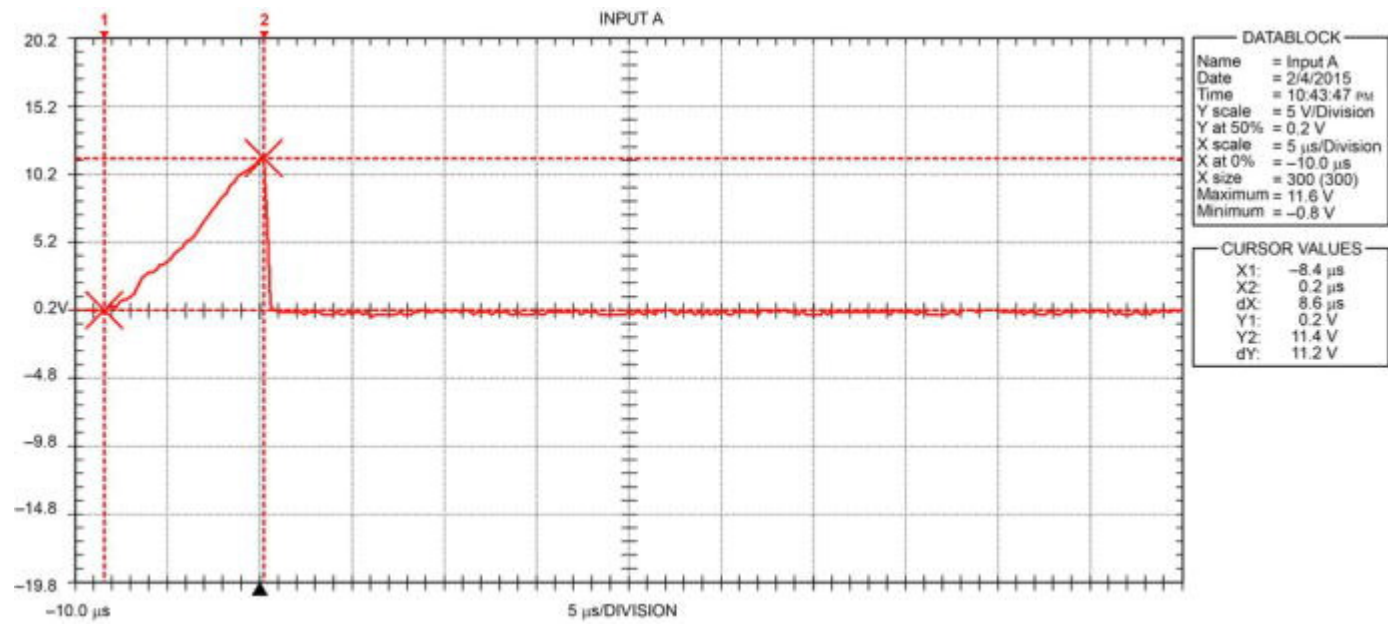


Figure 11. 11.4 V Peak Shaft Voltage, Discharge Detected

The second method requires no contact with the motor's shaft. It uses a commercially available device that uses an antenna to detect the signature radio frequency signature of a discharge across a bearing. The advantages of this method are that (1) it requires little setup, because it does not need to be in contact with the motor's shaft, and (2) it can be used to count the number of discharges over a period of time. Its disadvantages are that (1) the user must be careful to avoid external noise sources that might appear to be discharges while placing the antenna in a good position to pick up actual shaft discharges, and (2) the meter does not indicate the peak value of the voltage on the motor's shaft.

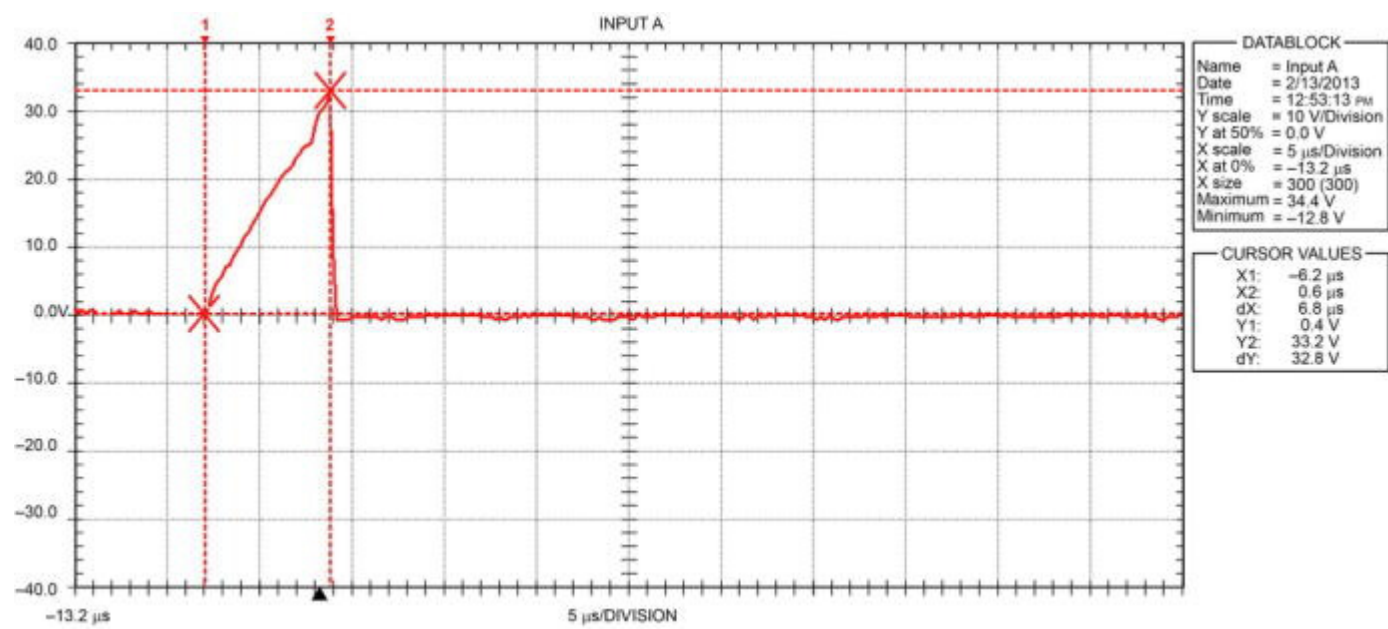


Figure 12. 32.2 V Peak Shaft Voltage, Discharge Detected

Strategies for Mitigating Bearing Currents

Motor bearing damage caused by the discharge of motor shaft voltage is not common, but it does occur on occasion when a PWM VFD is used to control the speed of the motor. This section describes actions that can be taken to reduce the likelihood of encountering such discharges and damage.

System Installation. Because of the use of high-voltage pulses to control the speed of the driven motor, it is important to take care when wiring the drive/motor system. Because common-mode voltages and currents are often the cause of the induced shaft voltage, wiring techniques that reduce their impact on the motor are important. These include the following:

- Providing a low-impedance ground at the motor for the high-frequency components in the VFD's output.
- Routing the motor cables and ground wire inside a continuous metallic shield or conduit. This is done to provide a low-impedance return path to the VFD for the common-mode current that the motor receives. If such a path is not provided, the common-mode current will attempt to return to the VFD through any other available paths. These may include paths through the motor's bearings. To ensure a low impedance path, if conduit is used, care must be taken to provide a reliable electrical bonding between sections of conduit.
 - Ideally, the ground wire to the motor should be a gage comparable with the gage of the motor leads and should have a high strand count. This is done to maximize the surface area of the ground wire in recognition of the fact that high-frequency currents tend to flow along the outside of a wire.
 - The conduit or other shield should be solidly bonded to both the VFD's and the motor's frame. It may be necessary to remove paint at the conduit connections to ensure a good electrical connection.
- Providing low-impedance ground connection at the VFD.

Following these wiring practices will reduce not only the opportunities for motor bearing damage, but also the amount of high-frequency common mode noise [radio frequency interference (RFI)/electromagnetic interference (EMI)] that may be conducted through the building's electrical power grid or be radiated from the VFD or the equipment that is connected to it.

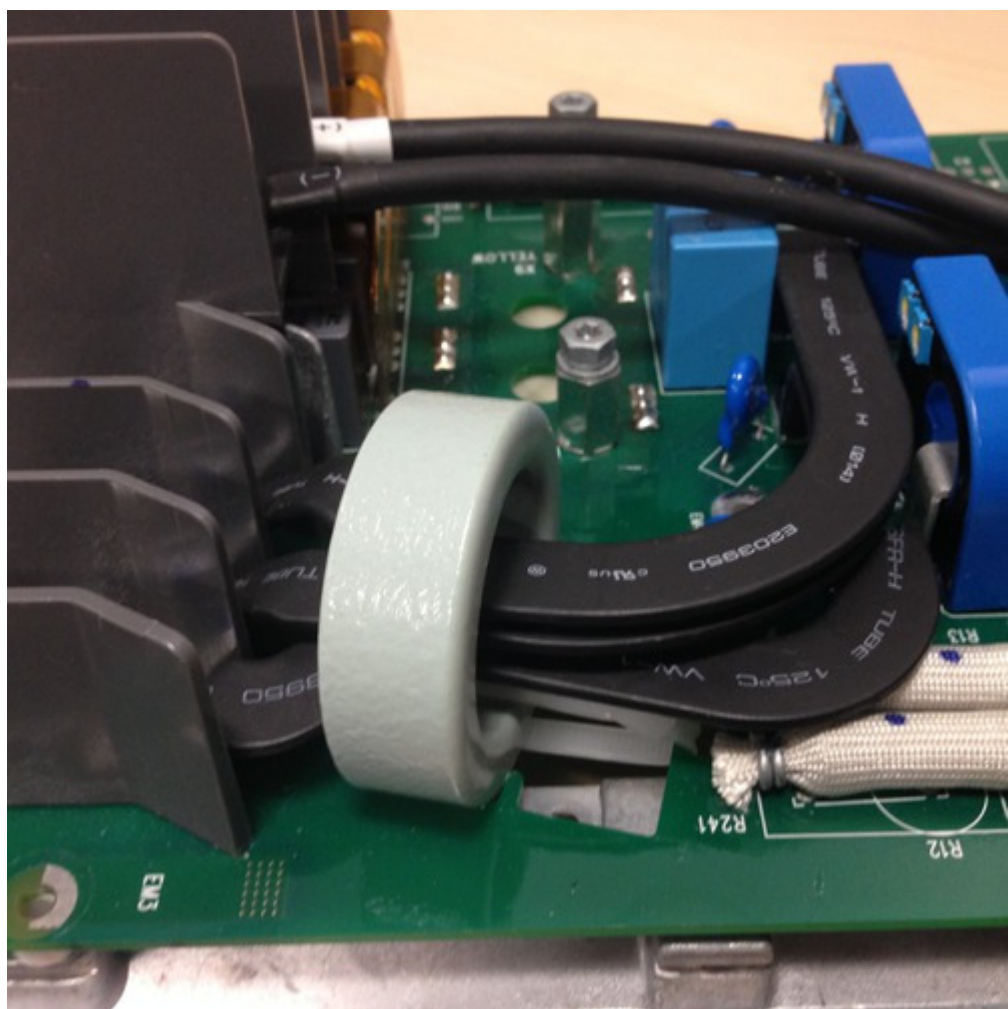


Figure 13. Common Mode Toroid Built into Output of VFD

Common-Mode Filters. The recommendations in the System Installation section are intended to divert the high-frequency, common-mode component of the VFD's PWM output from taking a return path through the motor's bearings. Common-mode filters mounted near the output of the VFD act to reduce the amplitude of the common-mode component of the VFD's output. Common-mode filters can be included as a part of an output filter. They can also take the form of a ferrite toroid that is placed around the three output motor leads from the VFD (Figure 13). In some cases, these are built into the VFD, although they are also available in a variety of sizes for retrofitting into existing applications.

A **Faraday shield** may be used as a conductive shield between the rotor and stator of the motor. It is used to reduce the capacitive coupling of voltage onto the motor's shaft. Although this is effective against capacitively coupled shaft voltage, it has little impact on circulating currents in the motor. The Faraday shield cannot be retrofitted in the field, has a significant impact on the cost of the motor, and may reduce the motor's efficiency.

Insulating Motor Bearings. Electrically insulating a motor's bearings blocks the path of current through the bearing. Because the induced voltage on a motor's shaft is quite low, the insulating material does not require a high dielectric strength. This can be accomplished in a variety of ways, including the following:

- Machining the motor's housing to allow room for a ring of insulating material to be installed between the bearing's outer race and the motor's bearing holder. This remains effective as long as the insulator does not break down or conductive dirt does not bridge the insulation. A concern about this method is the need to make the required modifications to the motor.
- Standard-dimensioned bearings with an insulated coating are available from some bearing manufacturers. This eliminates the need to modify the motor's housing. Such bearings are not presently available in all sizes used in motors.
- The rolling element of the bearing can be replaced by a nonconducting material, such as ceramic. When considering this solution, the load and service life rating of the bearing should be compared against the requirements of the application. Using different materials, such as ceramic bearings, can offer other benefits, such as increased mechanical life.



Figure 14. Typical Common-Mode Toroids for Retrofitting into Output of VFD

Insulating the motor's bearings is most appropriate for applications such as motor-shaft-mounted fans, which are not connected to other bearing-mounted shafts. If the motor is connected to equipment that contains its own shaft bearings, insulating the motor's bearings may simply move the bearing damage from the motor to the driven equipment. In such cases, it may be necessary to provide an insulated coupling between the motor and the driven equipment. It may also be advisable to bond the frame of the motor to the frame of the driven equipment using a grounding strap.

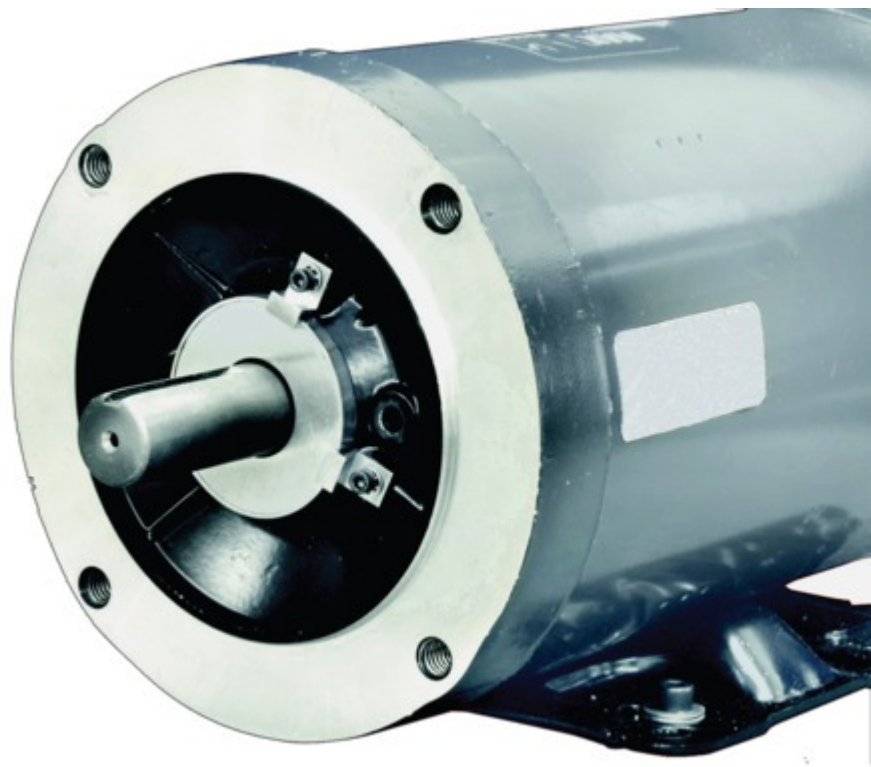


Figure 15. Shaft Grounding Ring Installed on Motor
(Oh and Willwerth 2008)

Although insulating just one of the motor's bearings may be effective in interrupting a circulating current along the length of the motor, doing this when the voltage is capacitively coupled to the motor's shaft will simply cause the noninsulated motor bearing to fail.

Motor Shaft Grounding. This method provides a low-impedance path around the motor's bearings, allowing the shaft voltage to discharge to the motor's frame without damaging its bearings.

One method that had been considered was to use electrically **conductive grease** in the motor's bearings. While this seemed promising, the conductive particles in the lubricant tended to increase mechanical wear in the motor's bearings. As a result, this method has largely been abandoned. Several methods are based on using a device that mechanically contacts the motor's shaft and provides an electrical connection between it and the motor's frame. The following are examples of this approach:

- Rotary contact that is axially mounted at the opposite-drive end (ODE) of the motor's shaft
- Carbon brush that makes radial contact to the motor's shaft
- Metal brush that can be used in various configurations
- Conductive fiber brush that makes radial contact to the motor's shaft as shown in Figure 15 through a series of brushes or a continuous ring of brushes

When considering a shaft-grounding solution, the following aspects should be considered *for each specific application*:

- Surface preparation for the motor's shaft that is recommended by the device's manufacturer
- Ease of mounting the device onto the motor
- Compatibility of the device with the application's environment
- Recommended periodic maintenance and the ease of performing it

Combination solutions, such as insulating one bearing in a motor and using shaft grounding at the other side of the motor, may be recommended in certain applications. When multiple layers of protection are desired, such as for a hermetic-motor-driven chiller, more than one solution may also be applied. In all cases, avoiding motor bearing damage should always begin with ensuring the proper installation and wiring of the VFD/motor system.

2. AIR VOLUME CONTROL

This section uses fan and air volume control as an example, but the same principles apply to centrifugal pumps and compressors.

The fan laws ([Chapter 21](#)) show that volume delivered by a fan is directly proportional to its speed, pressure is proportional to the square of the speed, and power is proportional to the cube of the speed. According to these laws, a fan operating at 50% volume requires only 12.5% of the power required at 100% volume. Although the fan in a typical VAV system is sized to handle peak volume, the system operates at reduced volume most of the time. For example, [Figure 16](#) shows the volume levels of a typical VAV system operating below 70% volume over 87% of the time. Thus, adjustable-speed operation of the fan for this duty cycle could provide a significant energy saving. Centrifugal fans have usually been driven by fixed-speed AC motors, and volume has been varied by outlet dampers, variable inlet guide vanes, or eddy current couplings.

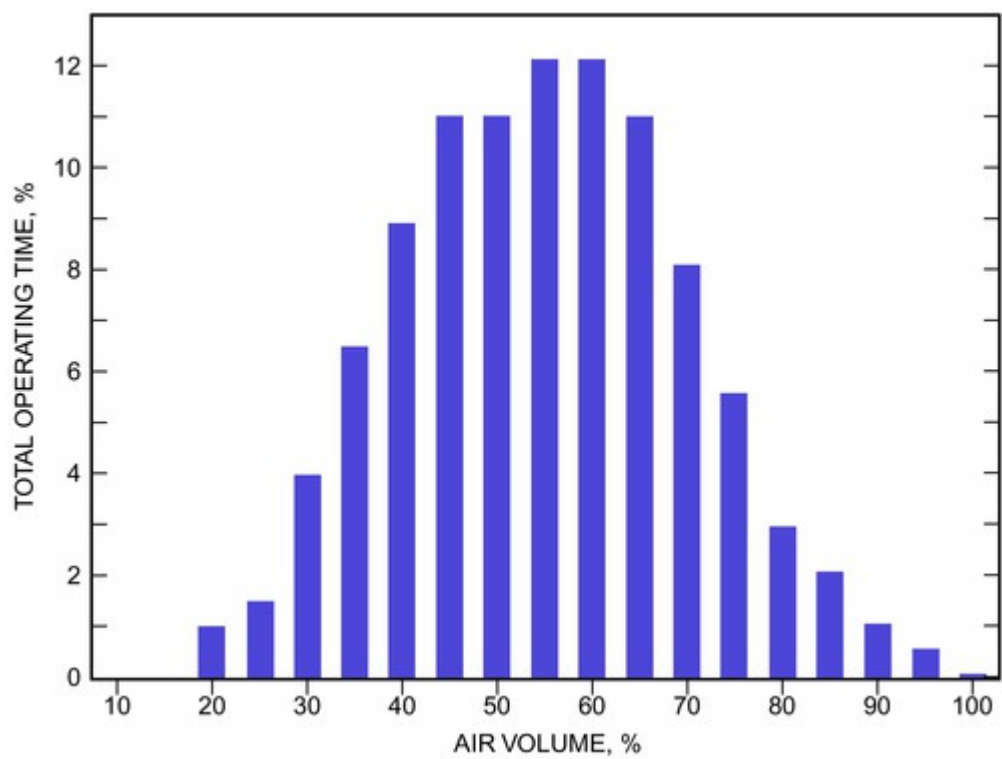


Figure 16. Typical Fan Duty Cycle for VAV System

Outlet dampers are mounted in the airstream on the outlet side of the fan. Closing the damper reduces the volume, but at the expense of increased pressure. Points B and C on the fan performance curve in [Figure 17](#) show the modified system curves for two closed damper positions. The natural operating point corresponds to a wide-open damper position (point A). The input power profile is also shown for the referenced points. **Variable inlet vanes** are mounted on the fan inlet to control air volume. Altering the pitch of the vane imparts a spin to air entering the fan wheel, which results in a family of fan performance curves as shown in [Figure 18](#). With reference to the required power at reduced flows, the inlet vane is more efficient than an outlet damper.

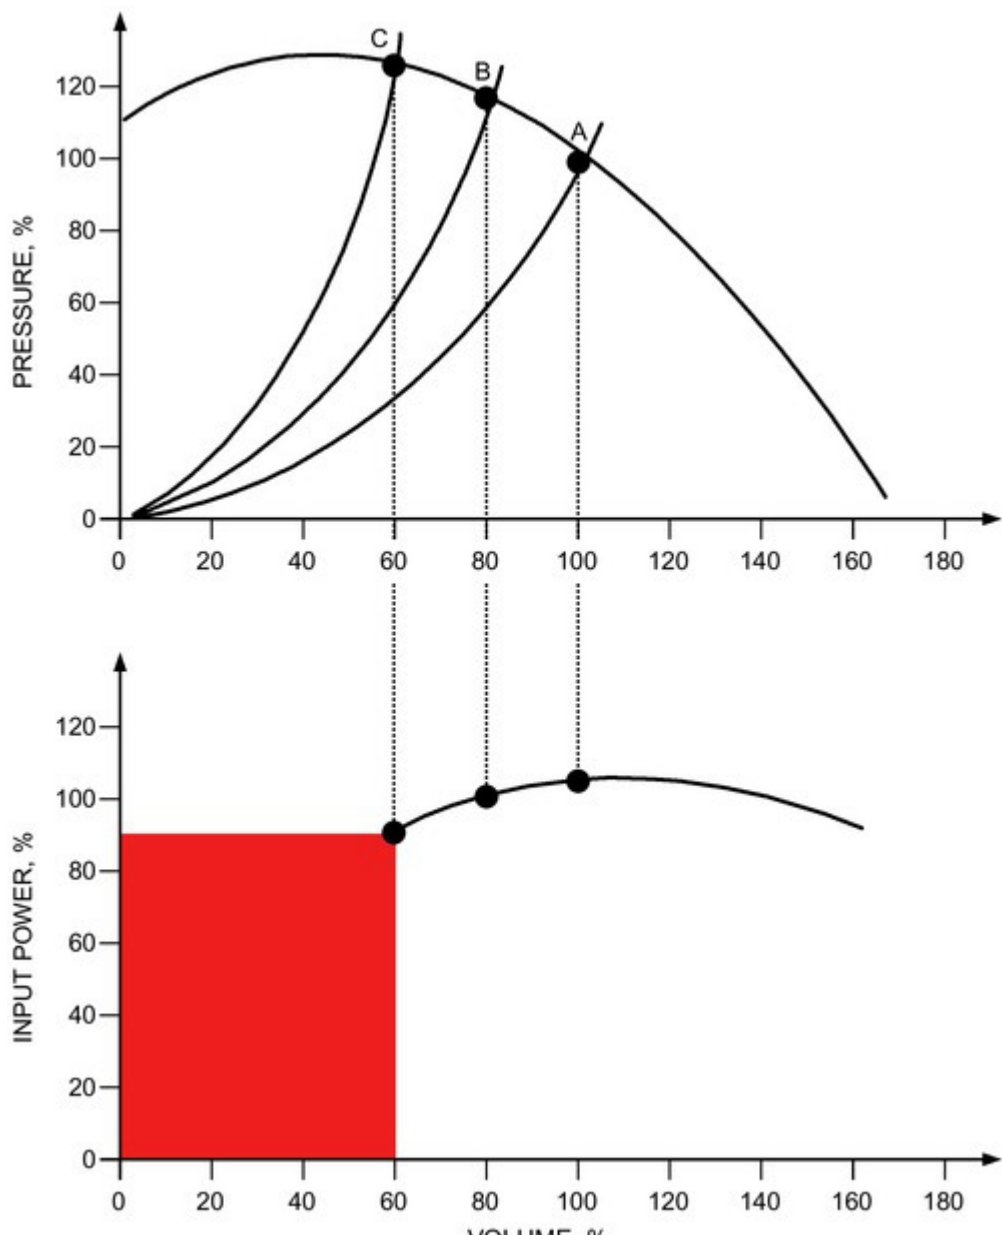


Figure 17. Outlet Damper Control

An **eddy current coupling** connects an AC-motor-driven fixed-speed input shaft to a variable-speed output shaft through a magnetic flux coupling. Reducing the level of flux density in the coupling increases slip between the coupling's input and output shafts and reduces speed. **Slip** is wasted energy in the form of heat that must be dissipated by fan cooling or by water cooling for large motors. [Figure 19](#) shows that reducing fan speed also generates a family of performance curves, but the required input power still remains relatively high because the speed of the induction motor remains relatively constant.

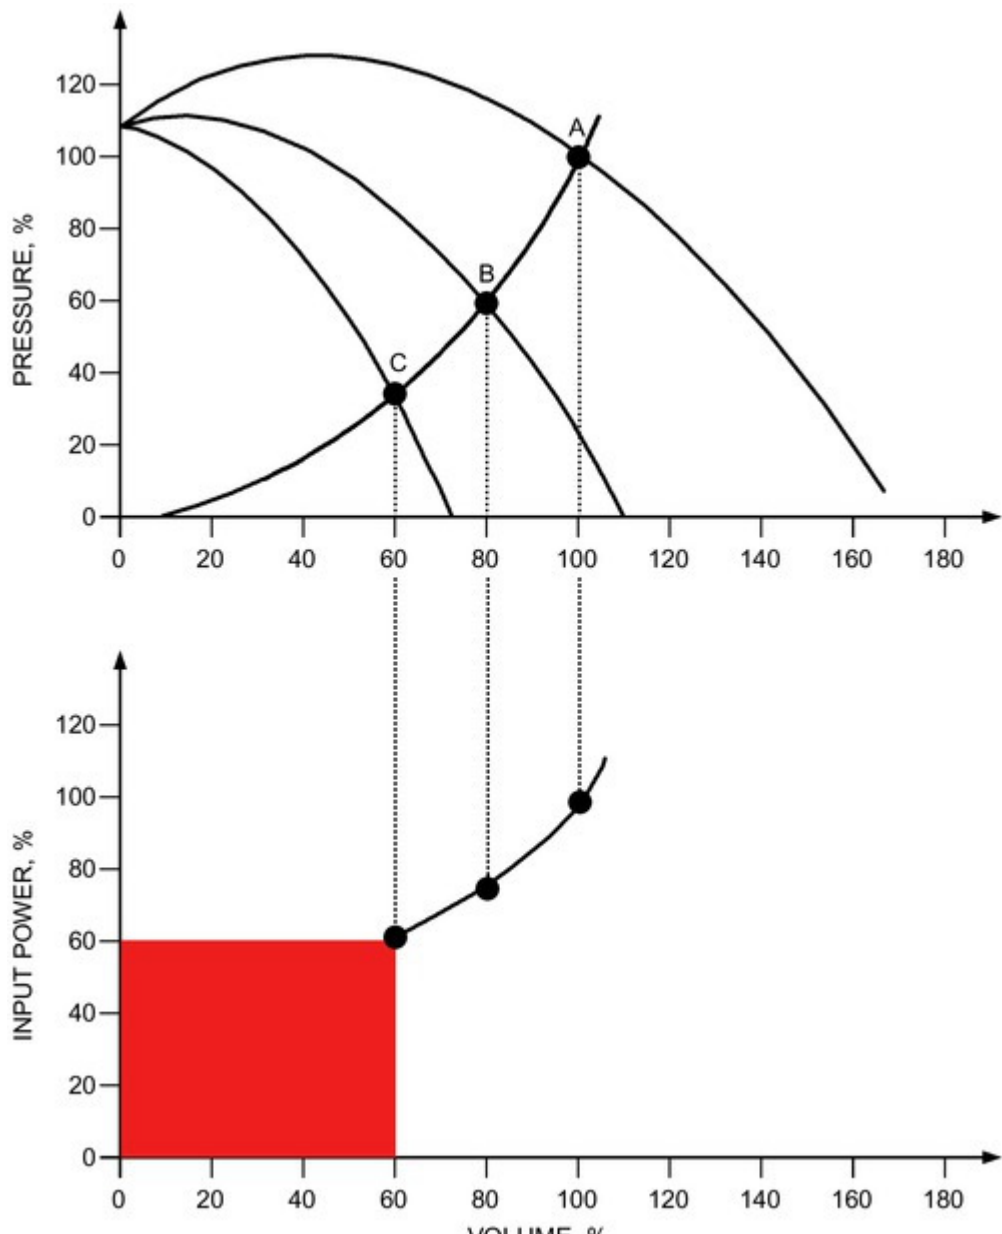


Figure 18. Variable Inlet Vane Control

2.1 VARIABLE-FREQUENCY DRIVES

An alternative to VAV flow control methods is the variable-frequency drive (VFD). [In this section, the term variable-frequency drive is considered synonymous with variable-speed drive (VSD), pulse-width modulated (PWM) drive, adjustable-speed drive (ASD), and adjustable-frequency drive (AFD).] An alternating-current variable-speed drive consists of a diode bridge AC-to-DC converter, and a pulse-width modulation (PWM) controller with fast-rise power transistors, usually insulated-gate bipolar transistors (IGBTs). These very fast-switching power transistors generate a variable-voltage, variable-frequency waveform that changes the speed of the AC motor. As shown in [Figure 20](#), as speed decreases, input power is reduced substantially because the power required varies as the cube of the speed (plus losses).

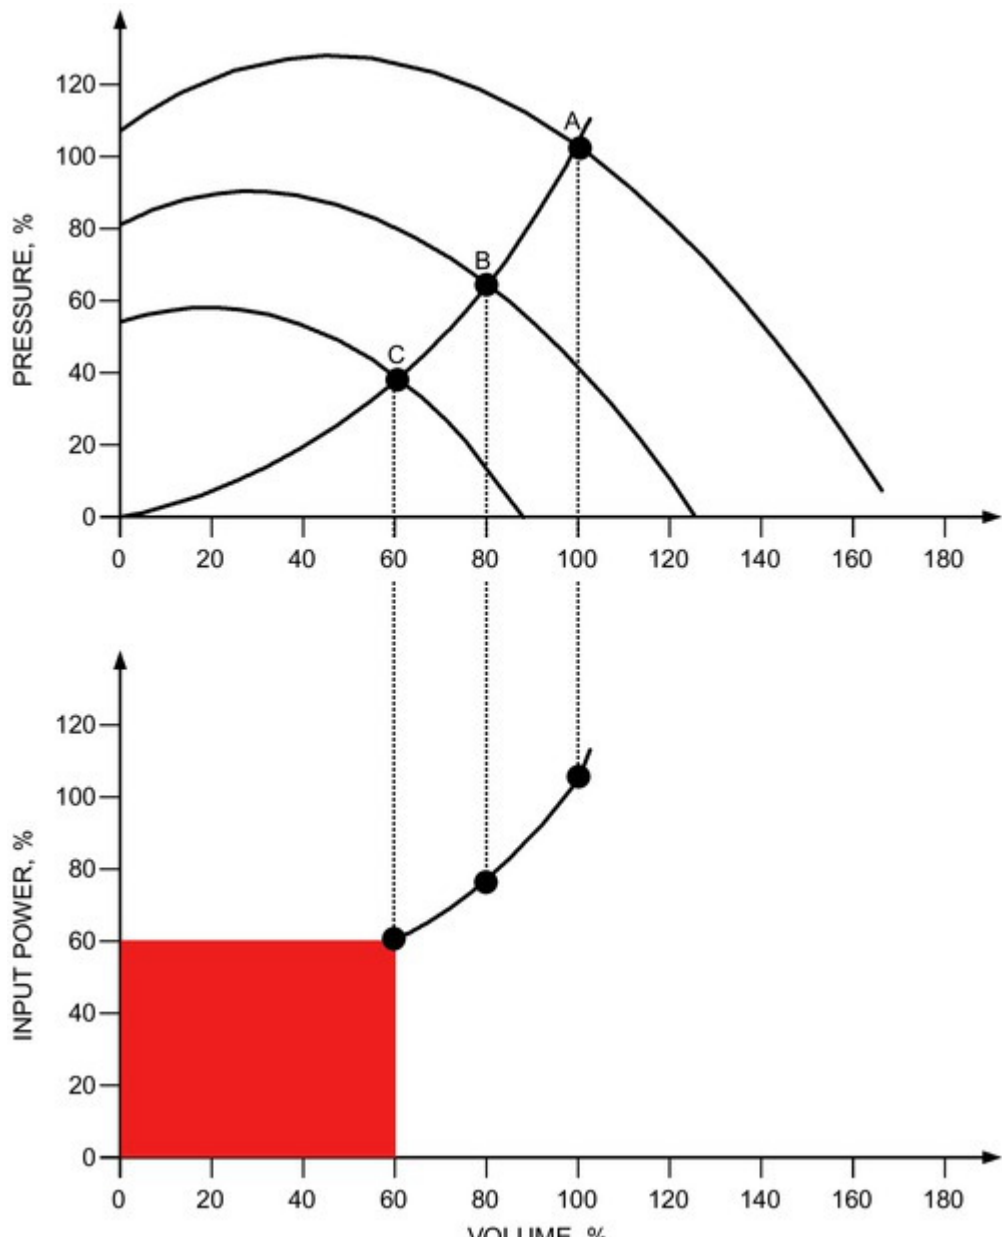


Figure 19. Eddy Current Coupling Control

Comparison of [Figures 17 to 20](#) shows that significant energy can be saved by using a VFD to achieve variable-air-volume control. Very high efficiencies can be achieved by using the VFD, which is typically over 96% efficient, controlling with a NEMA premium-rated AC motor. [Table 5](#) shows typical annual energy use for the four VAV control techniques.

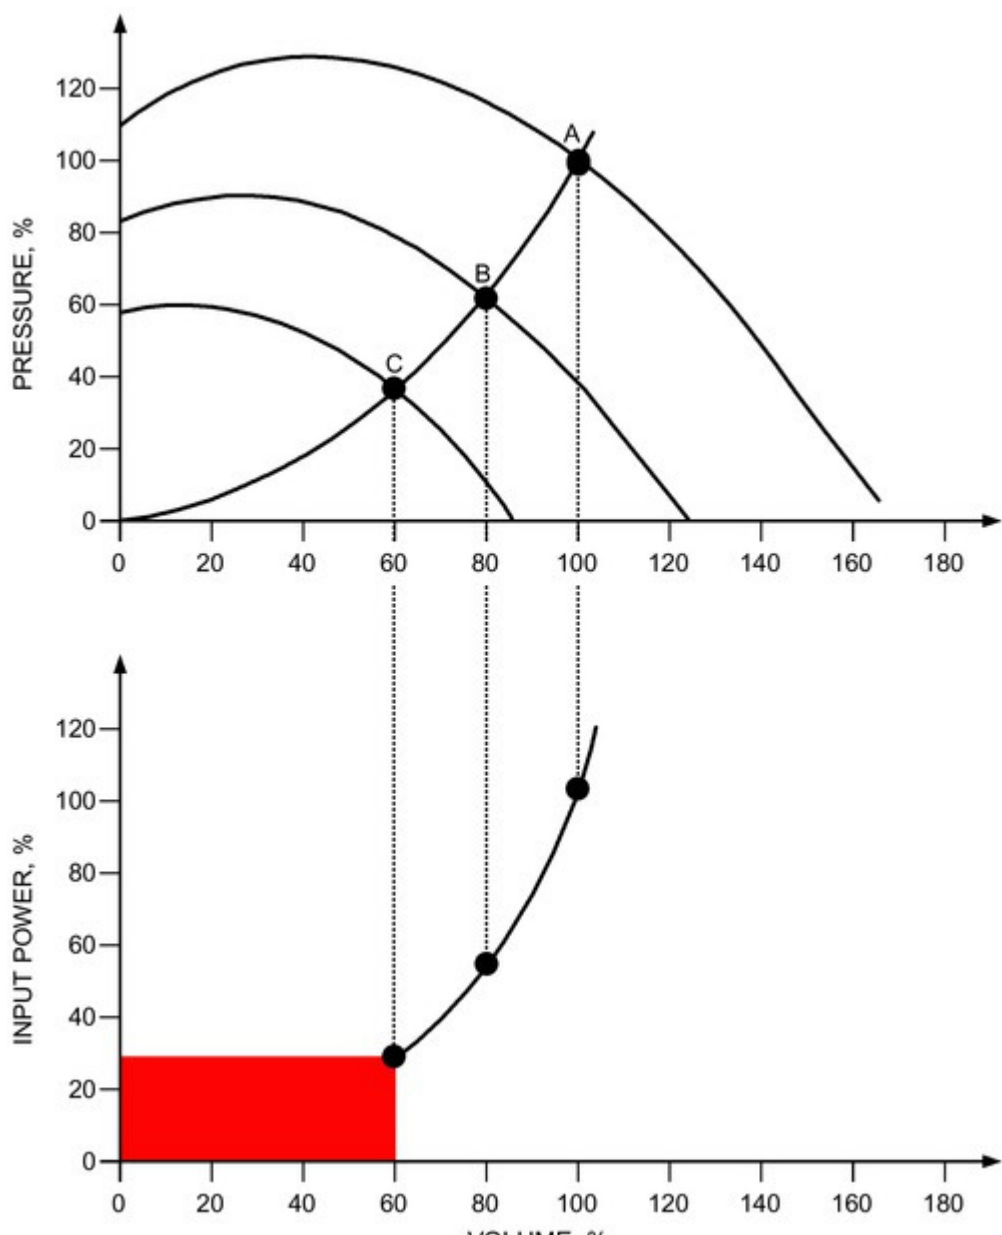


Figure 20. AC Drive Control

Table 5. Comparison of VAV Energy Consumption with Various Volume Control Techniques

	Outlet Damper	Inlet Guide Vane	Eddy Current Coupling	AC PWM Drive
% Input Power	85	62	40	30
Annual kWh	335,000	244,000	158,000	118,000
NEMA Premium 100 hp motor producing 60% flow for 5000 h, driving fan system that requires 100 hp at unrestricted flow.				

Power Transistor Characteristics
The key technology used to generate the output waveform is the IGBT. This transistor changes the characteristics of waveforms applied to a motor by varying (modulating) the width of pulses applied to the motor over each cycle of drive output voltage. Pulse-width modulation has been used for many years for variable-frequency drives; however, as transistor switching speeds increased, the pulse repetition rate (also known as the carrier or switching frequency) used also tended to increase, from 1 or 2 kHz to 8, 15, or as high as 20 kHz. This allowed motor drive manufacturers to provide a purer motor current waveform from the drive. Increased transistor switching speed and higher carrier frequencies introduced concerns over phenomena previously seen only in wave transmission devices such as antennae and broadcast signal equipment, and began to change the application variables such as drive-to-motor lead. These factors must be considered when applying newer IGBT-based VFDs.
Switching Times and dV/dt . [Figure 21](#) shows the switching of a bipolar junction transistor (BJT) versus an IGBT as an example of how increased power device switching speeds can affect turn-on and turn-off times as a ratio of the overall cycle. Note that the BJT switches at 1.0 μ s at a carrier frequency of 2 kHz, and the IGBT switches at 0.1 μ s at a carrier frequency of 8 kHz. The IGBT switches at a speed 10 times faster than the BJT and generates 4 times the number of pulses over the same time period.
The rate of change of drive output voltage as the power device is switching is known as the dV/dt of the voltage pulse. The magnitude of the dV/dt is determined by measuring the time difference between 10 and 90% of the steady-state magnitude of the output pulses, and dividing this time difference into the 90%/10% steady-state pulse voltage magnitude. Note that the dV/dt and carrier frequency of the pulses are both a function of the drive design. Often, the carrier frequency is user settable. The maximum design carrier frequency sets the limits on how fast a transistor must cycle on and off.

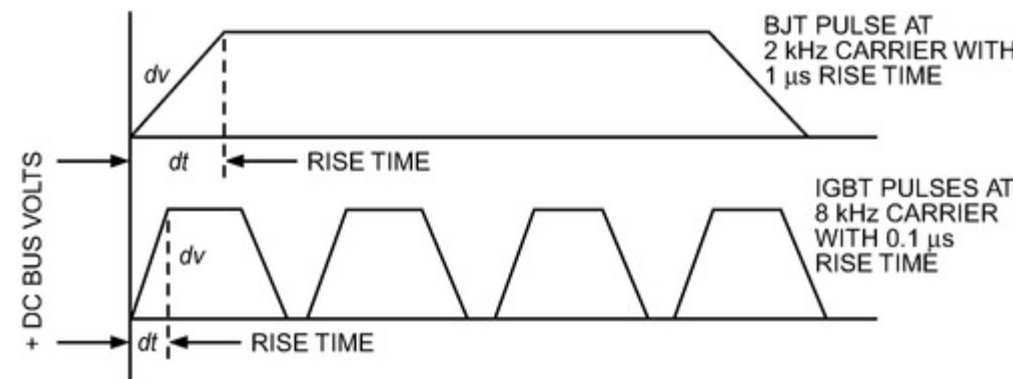


Figure 21. Bipolar Versus IGBT PWM Switching

Motor and Conductor Impedance

The waveform shown at the output of the drive may not be identical to the waveform presented at the motor terminals. Impedance in AC circuits affects the high-speed voltage pulses as they travel from the drive to the motor. When the cable impedance closely matches the motor impedance, the voltage pulses received at the motor closely approximate those generated by the inverter. However, when the motor surge impedance is much larger than the cable surge impedance, the drives' pulses may be reflected, causing standing waves and very high peak motor voltages. [Figure 22](#) shows the surge impedance of both the motor and a specific type of cable for different-sized drives and motors. Note that a relatively small motor (less than 2 hp) has a very high impedance with respect to the typical cable and can be problematic. Larger motors (greater than 100 hp) closely match cable impedance values and are generally less of a concern.

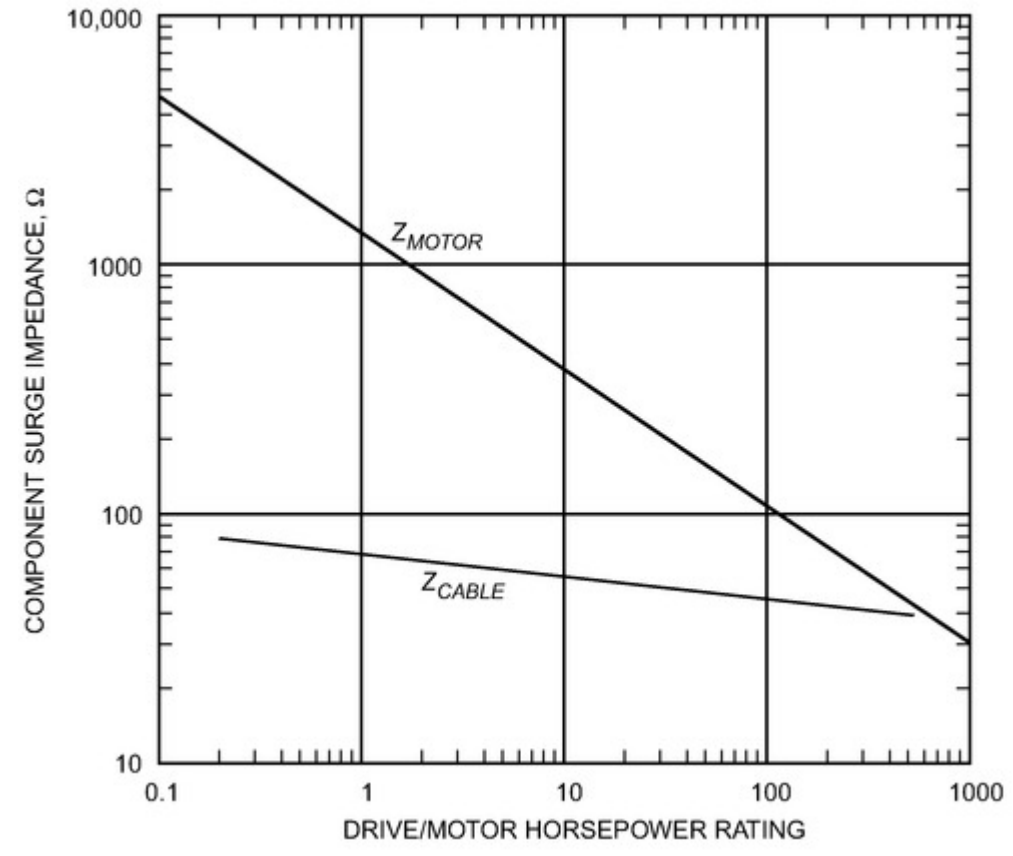


Figure 22. Motor and Drive Relative Impedance

Potential for Damaging Reflected Waves. Reflected waves damage motors because transmitted and reflected pulses can add together, causing very high voltages to occur at the motor terminals and within the motor-to-drive wiring. Because these voltage pulses are transmitted through the conductor over specific distances, cable length and type are both variables when examining the potential for damaging voltages. [Figure 23](#) shows the typical relationship between cable type and distance, power device switching times, and ratio of peak motor voltage at motor terminals to peak voltage generated at the drive's output. Damaging reflected waves are most likely to occur in smaller motors because of the mismatch in surge impedance values. If multiple small motors are operated from a single VFD, the potential for reflected-wave insulation damage increases, because the cable length is the sum of all the motor cables connected to the VFD's output.

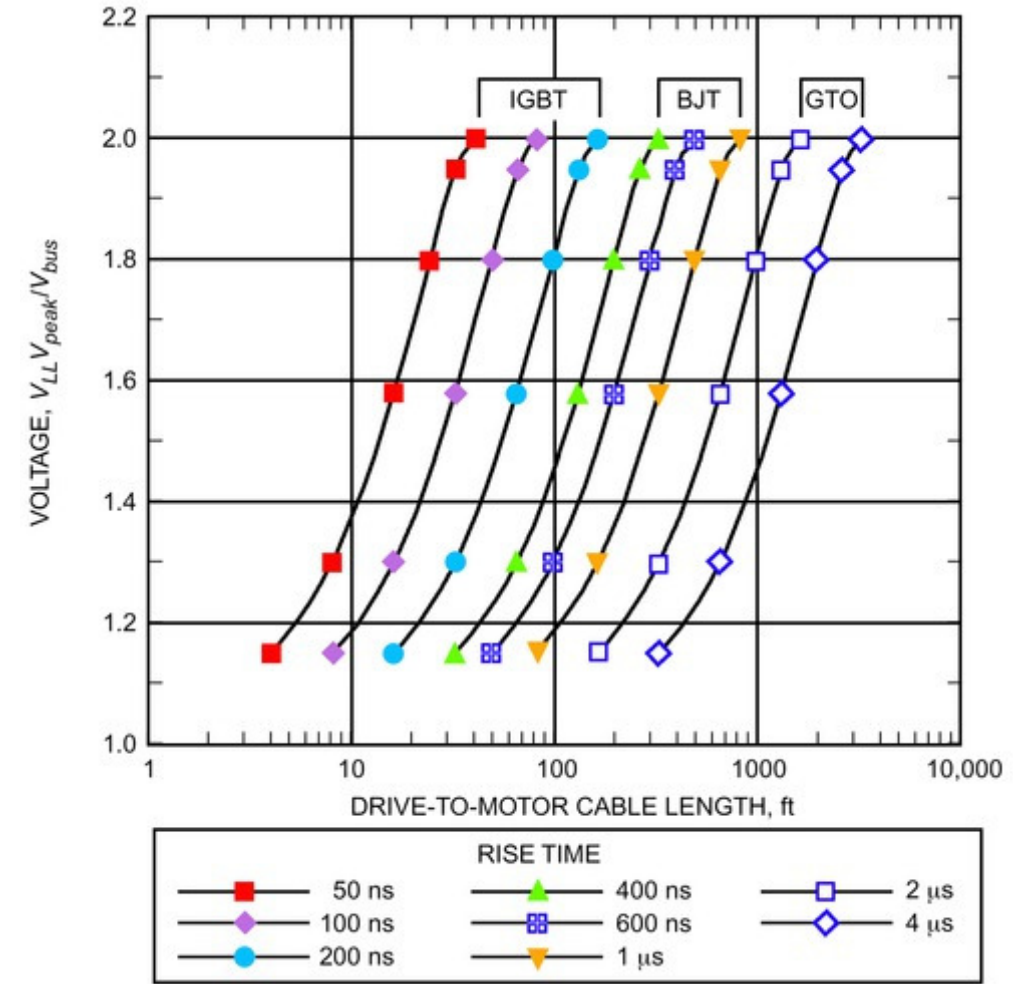


Figure 23. Typical Switching Times, Cable Distance, and Pulse Peak Voltage

[Figure 24](#) shows typical oscilloscope measurements taken at each end of a drive-to-motor conductor to describe the reflected wave phenomena. The time scale is set to display a single pulse. The two traces demonstrate the effect of transmitted and reflected pulses adding together to form damaging voltages. The induction motor must be designed to withstand these voltage levels.

Motor Ratings and NEMA Standards

The term "inverter duty motor" is commonly used in the industry, although there is currently no commonly accepted technical definition of this term. The following sections are intended to assist engineers in specifying motors that are fed from VFDs. An induction motor is often constructed to withstand voltage levels higher than the nameplate suggests. The specific maximum voltage withstand value should be obtained from the manufacturer, but typical values for 208 and 460 V ac motors range from 1000 to 1800 V peak. Higher-voltage motors, such as 575 V ac motors, may be rated up to 2000 V peak. NEMA Standard MG 1, Revision 1, Part 30.2.2.8, gives established voltage limits for general-purpose motors, which are shown graphically in [Figure 25](#). For motors rated less than 600 V, there is a peak of 1000 V and a minimum rise time of 2 μs. Revision 1, Part 31, of this standard gives requirements for definite-purpose inverter-fed motors, which are required to have a somewhat higher voltage withstand value. Part 31.4.4.2 states that these motors must withstand a peak of 3.1 times rated voltage (e.g., 1426 V for a 460 V rating). The minimum rise time for these motors is 1 μs. When specifying motors for operation on variable-frequency PWM drives, the voltage withstand level (based on the drives and the known cable type and distance) should be specified.

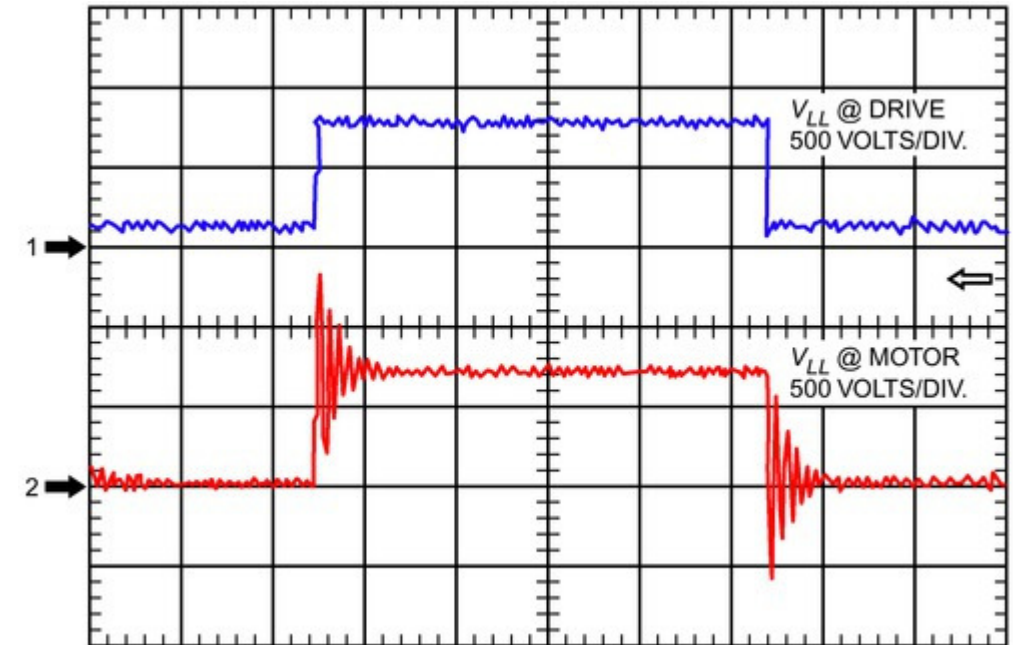


Figure 24. Typical Reflected Wave Voltage Levels at Drive and Motor Insulation

Motor Insulation Breakdown. If reflected waves generate voltage levels higher than the allowable peak, insulation begins to break down. This phenomenon is known as **partial discharge (PD)** or **corona**. When two phases or two turns in the motor pass next to each other, high voltage peaks can ionize the intervening air and cause localized arcing, damaging the insulation. The voltage at which this effect begins is referred to as the **corona inception voltage (CIV)** rating of the motor ([Figure 26](#)).

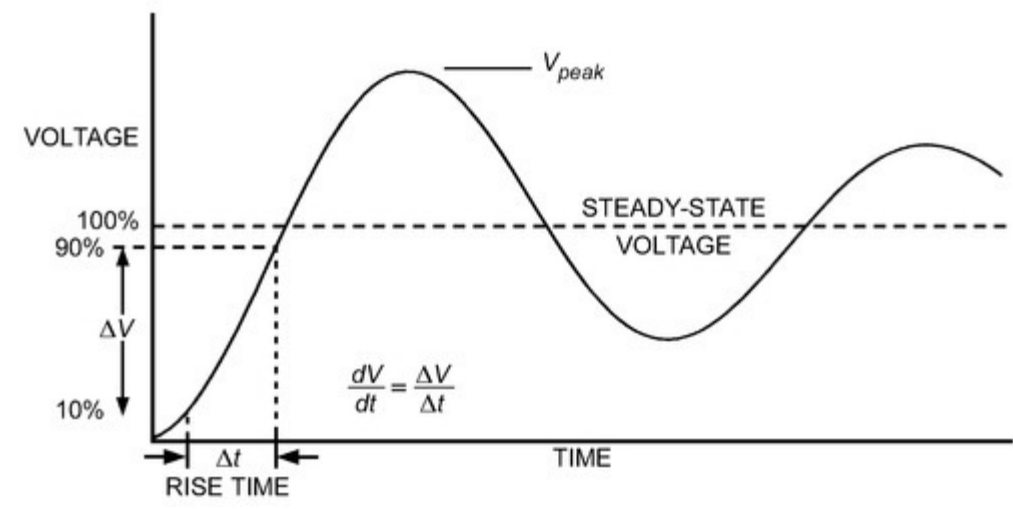


Figure 25. Motor Voltage Peak and Limits

(Reprinted from NEMA Standard MG 1, Part 30, Figure 30-5 by permission of the National Electrical Manufacturers Association)

Insulation subjected to PD eventually erodes, causing phase-to-phase or turn-to-turn short circuits. This causes microscopic insulation breakdown, which may not be detected by the drive current sensors and may result in nuisance overcurrent drive trips. Under this short-circuit condition, a motor may operate properly when run across the line or in bypass mode but consistently trip when run from drive power. Factory testing or special diagnostic equipment may be required to confirm this failure mode.

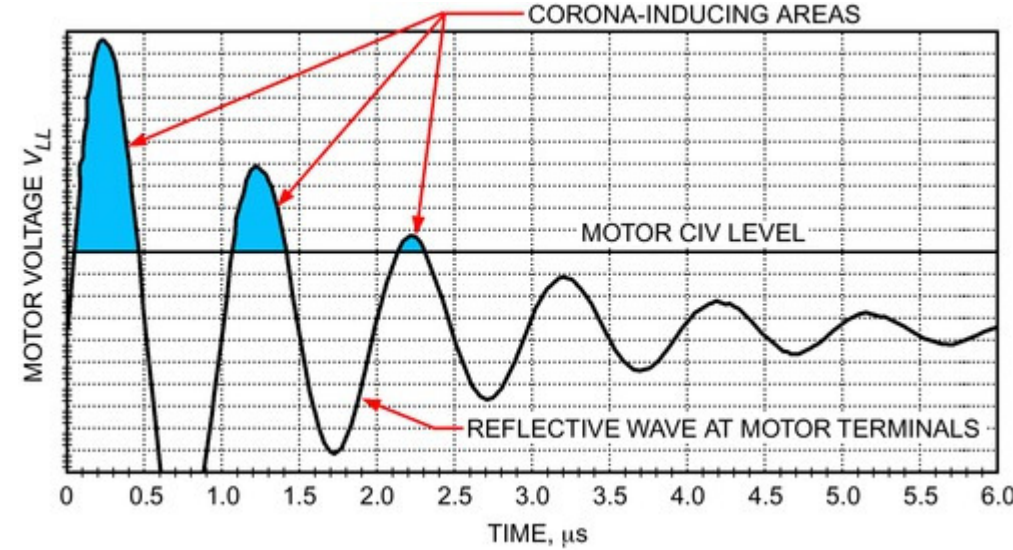


Figure 26. Damaging Reflected Waves above Motor CIV Levels

For short cable lengths and slower rise times, general-purpose motors may operate safely without reaching CIV. With longer cable lengths and higher rise times, even definite-purpose inverter-fed motors require mitigation. If details of the motor and cable run are specified, a VFD vendor should be able to prescribe any necessary mitigation filters to keep motor terminal peak voltage within a safe level.

Motor Noise and Drive Carrier Frequencies

Early PWM drives produced extreme motor noise at objectionable frequencies. IGBT technology allows drive designers to increase the carrier frequency to levels that minimize objectionable noise in the human hearing spectrum. Drive designs can switch up to 20 kHz, if required; however, some engineering compromises must be made to optimize the design. During the transition between turning off and on, the transistor generates heat that must be dissipated. This heat loss rises with the carrier frequency. Although higher carrier frequencies eliminate objectionable audible noise, they also require larger heat sinks and yield lower efficiency.

Audible noise measured in the dBA-weighted scale does not increase proportionally with drive carrier frequency. Additionally, concern with noise may not be over the measured total mean pressure level but a particular frequency band that is objectionable. [Figure 27](#) shows typical audible noise test results measured on a 100 hp energy-efficient motor. Note that the dominant octave band is at the drive carrier frequency setting. Sine wave power is used as a reference point on the left side of the graph. When running at 2 kHz, the total sound pressure is almost 6 dBA over the sine wave power recordings. This represents four times the sound pressure from the motor, because the scale is logarithmic and an increase of 3 dBA doubles the mean pressure level. By comparison, running the drive at 4 kHz increases the mean pressure by only 3 dBA, or half the mean pressure of the 2 kHz setting. (For reference, a 10 dB rise in sound pressure is perceived by the human ear as being twice as loud.)

Carrier Frequencies and Drive Ratings

In some manufacturers' drives, the carrier frequency is user-selectable. However, as carrier frequency increases, drive output ampere ratings often decrease, largely because of the additional heat that must be dissipated from the IGBT. If the rated carrier frequency of a drive is 2 kHz, setting the carrier frequency up to 8 kHz decreases the ampere output. Generally, for every 1 kHz increase in carrier frequency, the drive output current must be derated by 2%, although the specific derating should be determined by the drive manufacturer. As an example, a 10 hp, 460 V drive rated at 2 kHz may have an output of 14 A. If this drive is run at 10 kHz, or an increase of 8 kHz, it must be derated to 11.76 A, or a 16% decrease in current. If the motor nameplate full load were 14 A, this drive would not generate enough output current to obtain the full 10 hp. In effect, the drive and motor would only generate 8.4 hp continuously. This may not be enough power to drive a fan or pump at the performance specified for the application. For this reason, the specifying engineer should always state the desired audible sound level of the motor as applied to the drive to ensure proper operation.

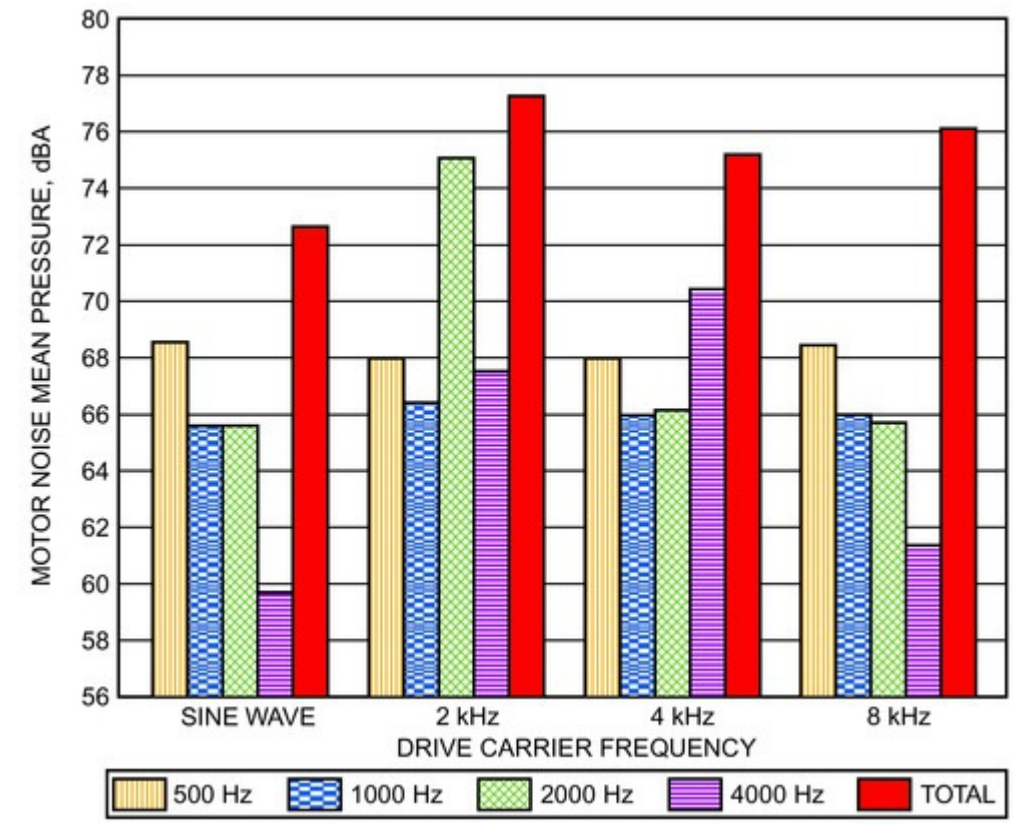


Figure 27. Motor Audible Noise

2.2 POWER DISTRIBUTION SYSTEM EFFECTS

Variable-frequency drives draw harmonic current from the power line. It is important to distinguish these lower-order harmonics from high-frequency disturbances on the motor side of the drive caused by the PWM inverter. Line harmonics are particularly critical to AC drive users for the following reasons:

- Current harmonics cause additional heating in transformers, conductors, and switchgear. Current harmonics flowing through the impedance of the power system cause voltage harmonics in accord with Ohm's law.
- Voltage harmonics upset the smooth, predictable voltage waveform in a normal sine wave. A power system severely distorted by voltage harmonics may damage components connected to the line or cause erratic operation of some equipment.
- High-frequency components of voltage distortion can interfere with signals transmitted on the AC line for some control systems.

However, PWM AC drives with built-in bus reactors or external reactors ahead of the drive significantly mitigate any disturbance to the input power.

A **linear load**, such as a three-phase induction motor operated across the line, may cause a phase displacement between the voltage and current waveforms (phase lag or lead), but the shapes of these waveforms are nearly pure sine waves and contain very little harmonics.

In contrast, a **nonlinear load** may draw current only from the peaks of the AC voltage sine wave. This flattens the top of the voltage waveform in single-phase circuits, and depresses it on either side of the peaks in three-phase circuits. Nonlinear loads draw current from the power source that are rich in current harmonics. Many nonlinear loads connected to a power system can cumulatively inject harmonics. Single-phase equipment (e.g., TVs, VCRs, computers, electronic-ballast lighting) and three-phase equipment (e.g., VFDs, uninterruptible power supplies (UPSs), electric arc furnaces, electric heaters, welders) convert AC voltage to DC voltage and contain circuitry that draws current in a PWM full-wave rectification VFD may distort the voltage waveform measured at the input terminals.

A single-phase load is not necessarily too small to be of concern. With AC-to-DC converters, the demand current occurs around the peak of the voltage sine wave. A thousand 100 W fluorescent light fixtures consume 100 kW of power. If the lights are nonlinear loads, the peaks add directly and cause the voltage waveform to dip. This distortion in the single-phase voltage waveform contributes to the harmonic distortion of the three-phase power source. On single-phase harmonic distortion, these loads produce even-numbered harmonics such as 2nd, 4th, 6th, etc. Thus, if a balanced system is experiencing even-numbered harmonics, they must originate from a single-phase load and not from the drives. These loads may also use the neutral connection of the power source to conduct current; the neutral connection may overload if proper precautions are not taken to alleviate harmonic currents drawn by nonlinear loads.

